

Design Guide

# VLT® HVAC Drive FC 102

1.1–90 kW, Enclosure Sizes A–C





# Contents

## 1 Introduction

1.1 Purpose of this Design Guide	9
1.2 Trademarks	9
1.3 Additional Resources	9
1.4 Version History	9

## 2 Safety

2.1 Safety	11
2.2 Safety Symbols	11
2.3 Qualified Personnel	11

## 3 Approvals and Certifications

3.1 Regulatory/Compliance Approvals for VLT® HVAC Drive FC 102	13
3.2 Typical Product Approvals and Certifications for VLT® Drives	13
3.3 Marine Type Approvals	16
3.4 Export Control Regulation	16
3.5 Enclosure Protection Rating	16

## 4 Product Overview

4.1 VLT® Drive Systems	18
4.2 Enclosure Size by Power Rating	19
4.3 Overview of Enclosures	23
4.4 Kit Availability	31

## 5 Product Features

5.1 Automated Operational Features	32
5.1.1 Automatic Energy Optimization	32
5.1.2 Short-circuit Protection	32
5.1.3 Overvoltage Protection	33
5.1.4 Missing Motor Phase Detection	34
5.1.5 Imbalance of Supply Voltage Detection	34
5.1.6 Service Switch on the Output	34
5.1.7 Overload Protection	34

5.1.8 Locked Rotor Protection	35
5.1.9 Automatic Derating	35
5.1.9.1 Overview of Automatic Derating	35
5.1.9.2 How Automatic Derating Works	35
5.1.9.3 High Internal Temperature	38
5.1.9.4 High Motor Load	38
5.1.9.5 High Voltage on the DC link	39
5.1.9.6 Low Motor Speed	39
5.1.10 Power Fluctuation Performance	41
5.1.11 Resonance Damping	41
5.1.12 Temperature-controlled Fans	41
5.1.13 EMC Compliance	41
5.1.14 Galvanic Isolation of Control Terminals	41
5.2 Custom Application Features	41
5.2.1 Motor Thermal Protection	42
5.2.2 Built-in PID Controller	42
5.2.3 Safe Torque Off	43
5.3 Load Sharing	43
5.3.1 Preconditions and Special Conditions	43
5.3.2 Combinations of Enclosure Sizes	44
5.4 Regen Overview	45

## 6 Options and Accessories Overview

6.1 Introduction	47
6.2 VLT® Fieldbus Options	47
6.3 VLT® Functional Extensions	48
6.4 VLT® Programmable Controllers	48
6.5 Kits and Accessories	49
6.5.1 Panel Through Mounting Kits for VLT® FC Series Enclosure Sizes A, B, and C	49
6.5.2 Panel Through Mounting Kits for VLT® FC Series Enclosure Sizes A, B, and C (IP21)	49
6.5.3 IP21/UL Type 1 Enclosure Kits for VLT® FC Series Enclosure Sizes A, B, and C	50
6.5.4 Mounting Brackets for VLT® FC Series Enclosure Sizes A5, B1, B2, C1, and C2	55
6.5.5 Remote Mounting Kits for LCP	56
6.5.6 VLT® Wireless Communication Panel LCP 103	60

## 7 Specifications

7.1 Electrical Data, 200–240 V and 3x115Y/200–139Y/240 V	61
7.2 Electrical Data, 380–480 V and 3x220Y/380–277Y/480 V	63
7.3 Electrical Data, 525–600 V	66
7.4 Electrical Data, 525–690 V	68
7.5 Mains Supply	71
7.6 Motor Output and Motor Data	72
7.7 Ambient Conditions	72
7.8 Cable Specifications	73
7.9 Control Input/Output and Control Data	74
7.10 Connection Tightening Torques	78
7.11 Power Ratings, Weight, and Dimensions	79

## 8 Mechanical Installation Considerations

8.1 Storage	84
8.2 Operating Environment	84
8.3 Maintenance Considerations	88
8.3.1 DrivePro® Preventive Maintenance	88
8.3.2 Service Access	88
8.4 Drive Placement	88
8.4.1 Side-by-side Mounting	88
8.4.2 Wall Mounting	90
8.5 Derating	90
8.5.1 Derating for Running at Low Speed	90
8.5.2 Derating for Low Air Pressure	90
8.5.3 Derating for Ambient Temperature and Switching Frequency	91

## 9 Electrical Installation Considerations

9.1 Safety Instructions	99
9.2 Wiring Diagram	101
9.3 Cables	101
9.3.1 EMC-correct Cables	101
9.3.2 Preparing Cable Entry Holes	102
9.3.3 Specifications of Entry Holes	103

9.3.4	Tightening Torques for Cable Entry Plate	111
9.4	Control Wiring and Terminals	111
9.4.1	Shielded Control Cables	111
9.4.2	Control Terminal Types	112
9.4.3	Terminal Descriptions	114
9.5	Fuses and Circuit Breakers	115
9.5.1	Fuse Recommendations	115
9.5.2	CE Compliance	116
9.5.3	UL Compliance (61800-5-1)	119
9.5.4	UL Compliance (508C)	122
9.6	Disconnects and Contactors	127
9.7	Motor	128
9.7.1	Motor Thermal Protection	128
9.7.2	Parallel Connection of Motors	129
9.7.3	Motor Insulation	130
9.7.4	Motor Bearing Currents	130
9.8	Braking	131
9.8.1	Selection of Brake Resistor	131
9.8.2	Control with Brake Function	134
9.9	Residual Current Device	134
9.10	Leakage Current	134
9.11	Efficiency	137
9.12	dU/dt	138
9.12.1	dU/dt Conditions	138
9.12.2	dU/dt Values, 200–240 V (T2)	138
9.12.3	dU/dt Values, 380–480 V (T4)	140
9.13	Acoustic Noise and Airflow	142
9.14	Electromagnetic Compatibility (EMC)	143
9.15	Harmonics	148
9.16	EMC-compliant Installation	154
9.17	Connections	157
9.17.1	Power Connections	157
9.17.2	IT Grid Connection	158
9.17.3	DC-Bus Connection	159
9.17.4	Load Sharing Connection	159

9.17.5 Brake Cable Connection	160
9.17.6 Grounding	160
9.17.7 Safety Ground Connection	160
<b>10 Basic Operating Principles</b>	
10.1 Introduction	161
10.2 Drive Controls	161
10.2.1 Control Principle	161
10.2.2 Local (Hand On) and Remote (Auto On) Control	162
10.3 Reference Limits	164
10.4 Control Principle	166
10.4.1 Control Structure Open Loop	166
10.4.2 Control Structure Closed Loop	167
10.4.3 Example of Closed-loop PID Control	167
10.4.4 Control Structure in VVC+	168
<b>11 Basic I/O Configurations</b>	
11.1 Application Examples	170
11.1.1 Wiring Configuration for Automatic Motor Adaptation (AMA)	170
11.1.2 Wiring Configuration for Automatic Motor Adaptation without T27	171
11.1.3 Wiring Configuration: Speed	171
11.1.4 Wiring Configuration: Feedback	173
11.1.5 Wiring Configuration: Run/Stop	175
11.1.6 Wiring Configuration: Start/Stop	177
11.1.7 Wiring Configuration: External Alarm Reset	179
11.1.8 Wiring Configuration: RS485	180
11.1.9 Wiring Configuration: Motor Thermistor	180
11.1.10 Wiring Configuration for a Relay Setup with Smart Logic Control	182
<b>12 How to Order a Drive</b>	
12.1 Drive Configurator	183
12.1.1 Type Code	183
12.1.2 Language Packages	185
12.2 Code Numbers for Options and Accessories	186
12.2.1 Code Numbers for Options for Slot A	186

---

12.2.2 Code Numbers for Options for Slot B	186
12.2.3 Code Numbers for Options for Slot C	187
12.2.4 Code Numbers for Options for Slot D	187
12.2.5 Code Numbers for Miscellaneous Hardware	187
12.2.6 Code Numbers for Local Control Panel Options	188
12.2.7 Code Numbers for PC Software	189
12.2.8 Ordering of Brake Resistors	189
12.2.9 Code Numbers for Accessory Bags	203
12.2.10 Ordering of Harmonic Filters	204
12.2.11 Code Numbers for VLT® Sine-wave Filters MCC 101	212
12.2.12 Code Numbers for VLT® dU/dt Filters MCC 102	214
12.2.13 Spare Parts	216

## 13 Appendix

13.1 Symbols and Abbreviations	217
--------------------------------	-----

---

# 1 Introduction

## 1.1 Purpose of this Design Guide

This design guide is intended for qualified personnel, such as:

- Project and systems engineers.
- Design consultants.
- Application and product specialists.

The design guide provides technical information to understand the capabilities of the VLT® HVAC Drive FC 102 for integration into motor control and monitoring systems. Its purpose is to provide design considerations and planning data for integration of the drive into a system. Reviewing the detailed product information in the design stage enables developing a well-conceived system with optimal functionality and efficiency.

This guide is targeted at a worldwide audience. Therefore, wherever occurring, both SI and imperial units are shown.

VLT® is a registered trademark for Danfoss A/S.

## 1.2 Trademarks

VLT® is a registered trademark of Danfoss A/S.

## 1.3 Additional Resources

Various resources are available to understand advanced drive operation, programming, and directives compliance.

- The **operating guide** provides detailed information for the installation and start-up of the drive.
- The **programming guide** provides greater detail on how to work with parameters. It also contains application examples.
- The **VLT® Safe Torque Off Operating Guide** describes how to use Danfoss VLT® drives in functional safety applications. This guide is supplied with the drive when the Safe Torque Off option is present.
- The **VLT® Brake Resistor MCE 101 Design Guide** describes how to select the optimal brake resistor.
- The **VLT® Advanced Harmonic Filters AHF 005/AHF 010 Design Guide** describes harmonics, various mitigation methods, and the operation principle of the advanced harmonic filter. This guide also describes how to select the correct advanced harmonics filter for a particular application.
- The **Output Filter Design Guide** explains why it is necessary to use output filters for certain applications and how to select the optimal dU/dt or sine-wave filter.
- Supplemental publications and guides are available at <https://www.danfoss.com/en/products/dds/low-voltage-drives/#tab-vlt-drives>.

Optional equipment is available that may change some of the information described in these publications. Be sure to follow the instructions supplied with the options for specific requirements.

Contact a Danfoss supplier or visit <http://www.danfoss.com> for more information.

## 1.4 Version History

This guide is regularly reviewed and updated. All suggestions for improvement are welcome.

The original language of this guide is English.

Table 1: Guide Version

Edition	Remarks
AJ299549559248-0101	Added UL 61800-5-1 updates to Electrical Data and Fuse sections.
AJ299549559248-0201	Updated UL Compliance (61800-5-1) fuse tables and added Permissible Ventilation Opening content within that section.

## 2 Safety

### 2.1 Safety

When designing AC drives, some residual dangers cannot be avoided constructively. One example is the discharge time, which is very important to observe to avoid potential death or serious injury. For the Danfoss VLT® drives, the discharge time is from 4–40 minutes depending on the drive size.

#### CAUTION

##### IDENTIFYING HAZARDOUS SITUATIONS

Hazardous situations must be identified by the machine builder/integrator who is responsible for taking the necessary preventive means into consideration. Failure to identify hazardous situations can result in death or serious injury.

- Install extra monitoring and protective devices according to local and national safety regulations.

For further information on safety precautions, refer to the product-specific operating guide.

### 2.2 Safety Symbols

The following symbols are used in this guide:

#### DANGER

Indicates a hazardous situation which, if not avoided, will result in death or serious injury.

#### WARNING

Indicates a hazardous situation which, if not avoided, could result in death or serious injury.

#### CAUTION

Indicates a hazardous situation which, if not avoided, could result in minor or moderate injury.

#### NOTICE

Indicates information considered important, but not hazard-related (for example, messages relating to property damage).

### 2.3 Qualified Personnel

To allow trouble-free and safe operation of the unit, only qualified personnel with proven skills are allowed to transport, store, assemble, install, program, commission, maintain, and decommission this equipment.

Persons with proven skills:

- Are qualified electrical engineers, or persons who have received training from qualified electrical engineers and are suitably experienced to operate devices, systems, plant, and machinery in accordance with pertinent laws and regulations.
- Are familiar with the basic regulations concerning health and safety/accident prevention.
- Have read and understood the safety guidelines given in all guides provided with the unit, especially the instructions given in the operating guide.

- Have good knowledge of the generic and specialist standards applicable to the specific application.

## 3 Approvals and Certifications

### 3.1 Regulatory/Compliance Approvals for VLT® HVAC Drive FC 102

This section provides a brief description of the various approvals and certifications that may be found on Danfoss VLT® drives. Not all listed approvals and certifications are valid for all drives, as they can be product-, application-, and country-specific.

The product label identifies which certifications apply to that individual drive. Specific certificates for VLT® HVAC Drive FC 102 can be found on the Danfoss homepage <https://www.danfoss.com/en/products/dds/low-voltage-drives/vlt-drives/vlt-hvac-drive-fc-102/>

#### NOTICE

##### IMPOSED LIMITATIONS ON THE OUTPUT FREQUENCY

The output frequency of the drive is limited to 590 Hz due to export control regulations. The software versions cannot be flashed.

### 3.2 Typical Product Approvals and Certifications for VLT® Drives

The VLT® HVAC Drive product series complies with a wide scope of required standards and directives. Information on the specific product certifications can be found on the product label.

#### 3.2.1 CE Mark



The drive complies with relevant directives and their related standards for the extended Single Market in the European Economic Area.

Table 2: EU Directives Applicable to Drives

EU Directive	Version
Low Voltage Directive	2014/35/EU
EMC Directive	2014/30/EU
Machinery Directive	2014/42/EU
ErP Directive	2009/125/EU
ATEX Directive	2014/34/EU
RoHS Directive	2011/65/EU
Radio Equipment Directive	2014/53/EU
REACH Directive	1907/2006/EC

1) Machinery Directive conformance is only required for drives with an integrated safety function.

2) For China RoHS, contact Danfoss application support to get the certificate.

3) Radio Equipment Directive is only required for interfaces supporting wireless communication.

#### 3.2.1.1 Low Voltage Directive

The aim of the Low Voltage Directive is to protect persons, domestic animals, and property against dangers caused by the electrical equipment, when operating electrical equipment that is installed and maintained correctly, in its intended application. The directive applies to all electrical equipment in the 50–1000 V AC and the 75–1500 V DC voltage ranges.

### 3.2.1.2 EMC Directive

The purpose of the EMC (electromagnetic compatibility) Directive is to reduce electromagnetic interference and enhance the immunity of electrical equipment and installations. The basic protection requirement of the EMC Directive states that devices that generate electromagnetic interference (EMI), or whose operation could be affected by EMI, must be designed to limit the generation of electromagnetic interference and shall have a suitable degree of immunity to EMI when properly installed, maintained, and used as intended. Electrical equipment devices used alone or as part of a system must bear the CE mark. Systems do not require the CE mark, but must comply with the basic protection requirements of the EMC Directive.

### 3.2.1.3 Machinery Directive

The aim of the Machinery Directive is to ensure personal safety and avoid property damage to mechanical equipment used in its intended application. The Machinery Directive applies to a machine consisting of an aggregate of interconnected components or devices of which at least 1 is capable of mechanical movement. Drives with an integrated functional safety function must comply with the Machinery Directive. Drives without a functional safety function do not fall under the Machinery Directive. If a drive is integrated into a machinery system, Danfoss can provide information on safety aspects relating to the drive. When drives are used in machines with at least 1 moving part, the machine manufacturer must provide a declaration stating compliance with all relevant statutes and safety measures.

### 3.2.1.4 ErP Directive

The ErP Directive is the European Ecodesign Directive for energy-related products. The directive sets ecodesign requirements for energy-related products, including drives, and aims at reducing the energy consumption and environmental impact of products by establishing minimum energy-efficiency standards.

### 3.2.1.5 ATEX Directive



Figure 1: ATEX Logo

The ATEX Directive is an EU directive that describes equipment and protective systems allowed in an environment with a potentially explosive atmosphere. Motors installed in areas with the presence of gases or combustible dust can be exposed to a risk of explosion. Danfoss offers built-in optional safety components that comply with the ATEX directive to ensure safe operation of installed motors. For detailed information on the specific categories covered, see the compliance information.

### 3.2.1.6 RoHS Directive

The Restriction of Hazardous Substances (RoHS) Directive is an EU directive that restricts the use of hazardous materials in the manufacturing of electronic and electrical products. Read more on [www.danfoss.com](http://www.danfoss.com).

### 3.2.1.7 Radio Equipment Directive

Devices that emit or receive radio waves as part of radio communication are required to comply with the Radio Equipment Directive. The drive itself does not contain a radio device, and hence compliance with the directive is not relevant. However, user interfaces containing active radio devices, such as the control panel with wireless communication capabilities, comply with the directive.

## 3.2.2 REACH Directive

Compliance with European REACH regulation on Registration, Evaluation, Authorization, and Restriction of Chemicals. Read more on [www.danfoss.com](http://www.danfoss.com).

### 3.2.3 UL Listing



The Underwriters Laboratory (UL) mark indicates the safety of products and their environmental claims based on standardized testing. Drives of voltage 525–690 V are UL-certified for only 525–600 V. The drive complies with UL 61800-5-1 thermal memory retention requirements.

### 3.2.4 CSA/cUL



The CSA/cUL approval is for drives of voltage rated at 600 V or lower. Compliance with the relevant UL/CSA standard makes sure that safety design together with relevant information and markings, ensures that when the drive is installed and maintained according to the provided operating/installation guide, the equipment meets the UL standards for electrical and thermal safety. This mark shows that the product complies with all required engineering specifications and testing. A certificate of compliance is provided on request.

### 3.2.5 TÜV

TÜV is a European safety organization which certifies the functional safety of the drive in accordance to EN/IEC 61800-5-2. The TÜV both tests products and monitors their production to ensure that companies stay compliant with their regulations.

### 3.2.6 EAC



Figure 2: EAC Mark

The EurAsian Conformity (EAC) Mark indicates that the product conforms to all requirements and technical regulations applicable to the product per the EurAsian Customs Union, which is composed of the member states of the EurAsian Economic Union. The EAC logo must be both on the product label and on the package label. All products used within the EAC area must be bought at Danfoss inside the EAC area.

### 3.2.7 UkrSEPRO



The UkrSEPRO certificate indicates the quality and safety of both products and services, in addition to manufacturing stability according to Ukrainian regulatory standards. The UkrSEPRO certificate is a required document to clear customs for any products coming into and out of the territory of Ukraine.

### 3.2.8 RCM Mark Compliance



The RCM Mark label indicates compliance with the applicable technical standards for Electromagnetic Compatibility (EMC). An RCM Mark label is required for placing electrical and electronic devices on the market in Australia and New Zealand. The RCM Mark regulatory arrangements only deal with conducted and radiated emission. For drives, the emission limits specified in EN/IEC 61800-3 apply. A declaration of conformity can be provided on request.

### 3.2.9 Moroccan Conformity Mark



The drive complies with relevant directives and their related standards for the Morocco market.

## 3.3 Marine Type Approvals

VLT® HVAC Drive has several marine type approvals. For a list of the approvals and certifications, see the FC 102 product page at <https://www.danfoss.com/en/products/dds/low-voltage-drives/vlt-drives/vlt-hvac-drive-fc-102/>.

## 3.4 Export Control Regulation

AC drives can be subject to regional and/or national export control regulations. Both the EU and US have regulations for so-called dual-use products (products for both military and non-military use), which currently includes AC drives with a capacity to operate from 600 Hz upwards. These products can still be sold, but it requires a set of measures, for example a license, or an end-user statement.

The US also has regulations for AC drives with a capacity to operate 300–600 Hz with restrictions on sales for certain countries. US regulations apply to all products manufactured in the US, exported from or via the US, or with a US content of more than 25%, or 10% for some countries.

An ECCN number is used to classify all AC drives that are subject to export control regulations. The ECCN number is provided in the documentation accompanying the AC drive. If the AC drive is re-exported, it is the responsibility of the exporter to ensure compliance with the relevant export control regulations.

For further information, contact Danfoss.

## 3.5 Enclosure Protection Rating

The VLT® drives series are available in various enclosure protection ratings to accommodate the needs of the application. Enclosure protection ratings are provided based on 2 international standards:

- UL type validates that the enclosures meet NEMA (National Electrical Manufacturers Association) standards. The construction and testing requirements for enclosures are provided in NEMA Standards Publication 250-2003 and UL 50, eleventh edition.
- IP (Ingress Protection) ratings outlined by the IEC (International Electrotechnical Commission) in the rest of the world. The standard Danfoss VLT® drive series are available in various enclosure protections to meet the requirements of IP00 (UL Open Type), IP20 (UL Open Type), IP21 (UL Type 1), or IP54 (UL Type 12).

### 3.5.1 UL Type Standard

Type 1 – Enclosures constructed for indoor use to provide a degree of protection to personnel against incidental contact with the enclosed units and to provide a degree of protection against falling dirt.

Type 12 – General-purpose enclosures are intended for use indoors to protect the enclosed units against the following:

- Fibers
- Lint

- Dust and dirt
- Light splashing
- Seepage
- Dripping and external condensation of noncorrosive liquids

There can be no holes through the enclosure and no conduit knockouts or conduit openings, except when used with oil resistant gaskets to mount oil-tight or dust-tight mechanisms. Doors are also provided with oil-resistant gaskets. In addition, enclosures for combination controllers have hinged doors, which swing horizontally and require a tool to open.

### 3.5.2 IP Standard

[Table 3](#) provides a cross-reference between the 2 standards. [Table 4](#) demonstrates how to read the IP number and then defines the levels of protection. The drives meet the requirements of both standards.

**Table 3: NEMA and IP Number Cross-reference**

NEMA and UL	IP
Chassis	IP00
Protected chassis	IP20
Type 1	IP21
Type 12	IP54

**Table 4: IP Number Breakdown**

1st digit	2nd digit	Level of protection
0	–	No protection.
1	–	Protected to 50 mm (2.0 in). No hands would be able to get into the enclosure.
2	–	Protected to 12.5 mm (0.5 in). No fingers would be able to get into the enclosure.
3	–	Protected to 2.5 mm (0.1 in). No tools would be able to get into the enclosure.
4	–	Protected to 1.0 mm (0.04 in). No wires would be able to get into the enclosure.
5	–	Protected against dust – limited entry.
6	–	Protected totally against dust.
–	0	No protection.
–	1	Protected from vertical dripping water.
–	2	Protected from dripping water at 15° angle.
–	3	Protected from water at 60° angle.
–	4	Protected from splashing water.
–	5	Protected from water jets.
–	6	Protected from strong water jets.
–	7	Protected from temporary immersion.
–	8	Protected from permanent immersion.

## 4 Product Overview

### 4.1 VLT® Drive Systems

Danfoss offers drives in different enclosure types for a wide range of applications.

#### Standalone AC drives

The Danfoss standalone AC drives are so robust that they can be mounted outside of cabinets almost anywhere, even right beside the motor. Equipped for the toughest of environment, they suit any application.

More uncompromising features:

- Enclosure sizes with protection ratings up to IP66/UL Type 4X.
- Full EMC compliance according to international standards.
- Ruggedized and coated PCBs.
- Wide temperature range, operating from -20 °C to +50 °C (-4 °F to 122 °F).
- Motor cable lengths up to 150 m (492 ft) shielded/300 m (984 ft) unshielded as standard with uncompromised performance.

#### Enclosed drives

Danfoss drives are designed with the installer and operator in mind to save time on installation, commissioning, and maintenance.

VLT® enclosed drives are designed for full access from the front. After opening the cabinet door, all components can be reached without removing the drive, even when mounted side by side.

Several cooling options, including back-channel cooling, provide optimum adaption to the installation location and application.

An intuitive user interface with an award-winning local control panel (LCP) and a common control platform that streamlines start-up and operating procedures.

#### Modules

The compact design of the VLT® high-power drive modules makes them easy to fit even in small spaces. Integrated filters, options, and accessories provide extra capabilities and protection without increasing the enclosure size.

Built-in DC-link reactors for harmonic suppression eliminate the need for higher loss external AC line reactors.

Optional built-in RFI filters are available throughout the power range.

Optional input fuses and load share terminals are available within the standard enclosures.

In addition to the many valuable features that the Danfoss drives offer as standard, there are several other control, monitoring, and power options available in pre-engineered factory configurations.

For more details on the enclosure types, the modularity, and the applications, see the product-specific selection guides on <http://www.danfoss.com>.

## 4.2 Enclosure Size by Power Rating

### Enclosure Power Ratings, 200–240 V

Table 5: Enclosure Power Ratings, 200–240 V

kW <sup>(1)</sup>	Hp <sup>(1)</sup>	Available Enclosures
1.1	1.5	A2/A4/A5
1.5	2.0	A2/A4/A5
2.2	3.0	A2/A4/A5
3.0	4.0	A3/A5
3.7	5.0	A3/A5
5.5	7.5	B1/B3
7.5	10	B1/B3
11.0	15	B1/B3
15.0	20	B2/B4
18.5	25	B4/C1
22.0	30	C1/C3
30.0	40	C1/C3
37.0	50	C2/C4
45.0	60	C2/C4

1) All power ratings are taken at high overload. Output is measured at 400 V (kW) and 460 V (hp).

**Enclosure Power Ratings, 380–480 V**
**Table 6: Enclosure Power Ratings, 380–480 V**

kW <sup>(1)</sup>	Hp <sup>(1)</sup>	Available Enclosures
1.1	1.5	A2/A4/A5
1.5	2.0	A2/A4/A5
2.2	2.9	A2/A4/A5
3.0	4.0	A2/A4/A5
4.0	5.0	A2/A4/A5
5.5	7.5	A3/A5
7.5	10	A3/A5
11	15	B1/B3
15	20	B1/B3
18.5	25	B1/B3
22	30	B2/B4
30	40	B2/B4
37	50	B4/C1
45	60	C1/C3
55	75	C1/C3
75	100	C2/C4
90	125	C2/C4

1) All power ratings are taken at high overload. Output is measured at 400 V (kW) and 460 V (hp).

## Enclosure Power Ratings, 525–600 V

Table 7: Enclosure Power Ratings, 525–600 V

kW	Hp	Available Enclosures
1.1	1.5	A3/A5
1.5	2.0	A3/A5
2.2	2.9	A3/A5
3.0	4.0	A3/A5
4.0	5.0	A3/A5
5.5	7.5	A3/A5
7.5	10	A3/A5
11	15	B1/B3
15	20	B1/B3
18.5	25	B1/B3
22	30	B2/B4
30	40	B2/B4
37	50	B4/C1
45	60	C1/C3
55	75	C1/C3
75	100	C2/C4
90	125	C2/C4

1) All power ratings are taken at high overload. Output is measured at 400 V (kW) and 460 V (hp).

## Enclosure Power Ratings, 525–690 V

Table 8: Enclosure Power Ratings, 525–690 V

kW	Hp	Available Enclosures
1.1	1.5	A3
1.5	2.0	A3
2.2	2.9	A3
3.0	4.0	A3
4.0	5.0	A3
5.5	7.5	A3
7.5	10	A3
11	15	B2/B4
15	20	B2/B4
18	25	B2/B4
22	30	B2/B4
30	40	B2/B4
37	50	B4/C2
45	60	C2/C3
55	75	C2/C3
75	100	C2
90	125	C2

1) All power ratings are taken at high overload. Output is measured at 400 V (kW) and 460 V (hp).

## 4.3 Overview of Enclosures

### Overview of Enclosures, 200–240 V

Table 9: A2/A3/A4/A5/B1/B2 Drives, 200–240 V

Enclosure size	A2	A3	A4	A5	B1	B2
<b>Power rating<sup>(1)</sup></b>						
Output at 400 V (kW)	1.1–2.2	3.0–3.7	1.1–2.2	1.1–3.7	5.5–11	15
Output at 460 V (hp)	1.5–2.9	4.0–4.9	1.5–2.9	1.5–4.9	7.5–15	20
<b>Protection rating</b>						
IP	IP20/21	IP20/21	IP55/66	IP55/66	IP21/55/66	IP21/55/66
NEMA	Type Chassis/1	Type Chassis/1	Type 12/4X	Type 12/4X	Type 1/12/4X	Type 1/12/4X
<b>Hardware options<sup>(2)</sup></b>						
RFI filter (Class A1)	–	–	–	–	–	–
RFI filter (Class A2)	–	–	–	–	–	–
RFI filter (Class A1/B)	–	–	–	–	–	–
RFI filter (Class A2 Marine)	–	–	–	–	–	–
Brake chopper	–	–	–	–	O	O
Safe torque off	–	–	–	–	S	S
No LCP	O	O	O	O	O	O
Numerical LCP	O	O	O	O	O	O
Graphical LCP	O	O	O	O	O	O
Disconnect	–	–	O	O	O	O
Disconnect + load-share	–	–	–	–	O	O
Loadshare terminals	–	–	–	–	O	O
24 V DC supply	O	O	O	O	O	O

1) All power ratings are taken at high overload.

2) S = standard, O = optional, and a dash indicates that the option is unavailable.

Table 10: B3/B4/C1/C2/C3/C4 Drives, 200–240 V

Enclosure size	B3	B4	C1	C2	C3	C4
Output at 400 V (kW)	5.5–11	15–18.5	18.5–30	37–45	22–30	37–45
Output at 460 V (hp)	7.5–15	20–25	25–40	50–60	30–40	50–60
<b>Protection rating</b>						
IP	IP20	IP20	IP21/55/66	IP21/55/66	IP20	IP20
NEMA	Type Chassis	Type Chassis	Type 1/12/4X	Type 1/12/4X	Type Chassis	Type Chassis
<b>Hardware options<sup>(1)</sup></b>						
RFI filter (Class A1)	–	–	–	O	–	–
RFI filter (Class A2)	–	–	–	–	O	–
RFI filter (Class A1/B)	–	–	O	–	–	–
RFI filter (Class A2 Marine)	–	–	–	–	O	–
Brake chopper	O	O	O	O	O	O
Safe torque off	S	S	S	S	S	S
No LCP	O	O	O	O	O	O
Numerical LCP	O	O	O	O	O	O
Graphical LCP	O	O	O	O	O	O
Disconnect	–	–	O	O	–	–
Disconnect + load-share	–	–	O	O	–	–
Loadshare terminals	–	–	O	O	–	–
24 V DC supply	O	O	O	O	O	O

1) S = standard, O = optional, and a dash indicates that the option is unavailable.

## Overview of Enclosures, 380–480 V

Table 11: A2/A3/A4/A5/B1/B2 Drives, 380–480 V

Enclosure size	A2	A3	A4	A5	B1	B2
<b>Power rating<sup>(1)</sup></b>						
Output at 400 V (kW)	1.1–2.2	3.0–3.7	1.1–2.2	1.1–3.7	5.5–11	15
Output at 460 V (hp)	1.5–2.9	4.0–4.9	1.5–2.9	1.5–4.9	7.5–15	20
<b>Protection rating</b>						
IP	IP20/21	IP20/21	IP55/66	IP55/66	IP21/55/66	IP21/55/66
NEMA	Type Chassis/1	Type Chassis/1	Type 12/4X	Type 12/4X	Type 1/12/4X	Type 1/12/4X
<b>Hardware options<sup>(2)</sup></b>						
RFI filter (Class A1)	–	–	–	–	–	–
RFI filter (Class A2)	–	–	–	–	–	–
RFI filter (Class A1/B)	–	–	–	–	–	–
RFI filter (Class A2 Marine)	–	–	–	–	–	–
Brake chopper	–	–	–	–	O	O
Safe torque off	–	–	–	–	S	S
No LCP	O	O	O	O	O	O
Numerical LCP	O	O	O	O	O	O
Graphical LCP	O	O	O	O	O	O
Disconnect	–	–	O	O	O	O
Disconnect + load-share	–	–	–	–	O	O
Loadshare terminals	–	–	–	–	O	O
24 V DC supply	O	O	O	O	O	O

1) All power ratings are taken at high overload.

2) S = standard, O = optional, and a dash indicates that the option is unavailable.

Table 12: B3/B4/C1/C2/C3/C4 Drives, 380–480 V

Enclosure size	B3	B4	C1	C2	C3	C4
Output at 400 V (kW)	5.5–11	15–18.5	18.5–30	37–45	22–30	37–45
Output at 460 V (hp)	7.5–15	20–25	25–40	50–60	30–40	50–60
<b>Protection rating</b>						
IP	IP20	IP20	IP21/55/66	IP21/55/66	IP20	IP20
NEMA	Type Chassis	Type Chassis	Type 1/12/4X	Type 1/12/4X	Type Chassis	Type Chassis
<b>Hardware options<sup>(1)</sup></b>						
RFI filter (Class A1)	–	–	–	O	–	–
RFI filter (Class A2)	–	–	–	–	O	–
RFI filter (Class A1/B)	–	–	O	–	–	–
RFI filter (Class A2 Marine)	–	–	–	–	O	–
Brake chopper	O	O	O	O	O	O
Safe torque off	S	S	S	S	S	S
No LCP	O	O	O	O	O	O
Numerical LCP	O	O	O	O	O	O
Graphical LCP	O	O	O	O	O	O
Disconnect	–	–	O	O	–	–
Disconnect + load-share	–	–	O	O	–	–
Loadshare terminals	–	–	O	O	–	–
24 V DC supply	O	O	O	O	O	O

1) S = standard, O = optional, and a dash indicates that the option is unavailable.

**Overview of Enclosures, 525–600 V**
**Table 13: A2/A3/A4/A5/B1/B2 Drives, 525–600 V**

Enclosure size	A2	A3	A4	A5	B1	B2
<b>Power rating<sup>(1)</sup></b>						
Output at 400 V (kW)	1.1–2.2	3.0–3.7	1.1–2.2	1.1–3.7	5.5–11	15
Output at 460 V (hp)	1.5–2.9	4.0–4.9	1.5–2.9	1.5–4.9	7.5–15	20
<b>Protection rating</b>						
IP	IP20/21	IP20/21	IP55/66	IP55/66	IP21/55/66	IP21/55/66
NEMA	Type Chassis/1	Type Chassis/1	Type 12/4X	Type 12/4X	Type 1/12/4X	Type 1/12/4X
<b>Hardware options<sup>(2)</sup></b>						
RFI filter (Class A1)	–	–	–	–	–	–
RFI filter (Class A2)	–	–	–	–	–	–
RFI filter (Class A1/B)	–	–	–	–	–	–
RFI filter (Class A2 Marine)	–	–	–	–	–	–
Brake chopper	–	–	–	–	O	O
Safe torque off	–	–	–	–	S	S
No LCP	O	O	O	O	O	O
Numerical LCP	O	O	O	O	O	O
Graphical LCP	O	O	O	O	O	O
Disconnect	–	–	O	O	O	O
Disconnect + loadshare	–	–	–	–	O	O
Loadshare terminals	–	–	–	–	O	O
24 V DC supply	O	O	O	O	O	O

1) All power ratings are taken at high overload.

2) S = standard, O = optional, and a dash indicates that the option is unavailable.

Table 14: B3/B4/C1/C2/C3/C4 Drives, 525–600 V

Enclosure size	B3	B4	C1	C2	C3	C4
Output at 400 V (kW)	5.5–11	15–18.5	18.5–30	37–45	22–30	37–45
Output at 460 V (hp)	7.5–15	20–25	25–40	50–60	30–40	50–60
<b>Protection rating</b>						
IP	IP20	IP20	IP21/55/66	IP21/55/66	IP20	IP20
NEMA	Type Chassis	Type Chassis	Type 1/12/4X	Type 1/12/4X	Type Chassis	Type Chassis
<b>Hardware options<sup>(1)</sup></b>						
RFI filter (Class A1)	–	–	–	O	–	–
RFI filter (Class A2)	–	–	–	–	O	–
RFI filter (Class A1/B)	–	–	O	–	–	–
RFI filter (Class A2 Marine)	–	–	–	–	O	–
Brake chopper	O	O	O	O	O	O
Safe torque off	S	S	S	S	S	S
No LCP	O	O	O	O	O	O
Numerical LCP	O	O	O	O	O	O
Graphical LCP	O	O	O	O	O	O
Disconnect	–	–	O	O	–	–
Disconnect + loadshare	–	–	O	O	–	–
Loadshare terminals	–	–	O	O	–	–
24 V DC supply	O	O	O	O	O	O

1) S = standard, O = optional, and a dash indicates that the option is unavailable.

## Overview of Enclosures, 525–690 V

Table 15: A2/A3/A4/A5/B1/B2 Drives, 525–690 V

Enclosure size	A2	A3	A4	A5	B1	B2
<b>Power rating<sup>(1)</sup></b>						
Output at 400 V (kW)	1.1–2.2	3.0–3.7	1.1–2.2	1.1–3.7	5.5–11	15
Output at 460 V (hp)	1.5–2.9	4.0–4.9	1.5–2.9	1.5–4.9	7.5–15	20
<b>Protection rating</b>						
IP	IP20/21	IP20/21	IP55/66	IP55/66	IP21/55/66	IP21/55/66
NEMA	Type Chassis/1	Type Chassis/1	Type 12/4X	Type 12/4X	Type 1/12/4X	Type 1/12/4X
<b>Hardware options<sup>(2)</sup></b>						
RFI filter (Class A1)	–	–	–	–	–	–
RFI filter (Class A2)	–	–	–	–	–	–
RFI filter (Class A1/B)	–	–	–	–	–	–
RFI filter (Class A2 Marine)	–	–	–	–	–	–
Brake chopper	–	–	–	–	O	O
Safe torque off	–	–	–	–	S	S
No LCP	O	O	O	O	O	O
Numerical LCP	O	O	O	O	O	O
Graphical LCP	O	O	O	O	O	O
Disconnect	–	–	O	O	O	O
Disconnect + load-share	–	–	–	–	O	O
Loadshare terminals	–	–	–	–	O	O
24 V DC supply	O	O	O	O	O	O

1) All power ratings are taken at high overload.

2) S = standard, O = optional, and a dash indicates that the option is unavailable.

Table 16: B3/B4/C1/C2/C3/C4 Drives, 525–690 V

Enclosure size	B3	B4	C1	C2	C3	C4
Output at 400 V (kW)	5.5–11	15–18.5	18.5–30	37–45	22–30	37–45
Output at 460 V (hp)	7.5–15	20–25	25–40	50–60	30–40	50–60
<b>Protection rating</b>						
IP	IP20	IP20	IP21/55/66	IP21/55/66	IP20	IP20
NEMA	Type Chassis	Type Chassis	Type 1/12/4X	Type 1/12/4X	Type Chassis	Type Chassis
<b>Hardware options<sup>(1)</sup></b>						
RFI filter (Class A1)	–	–	–	O	–	–
RFI filter (Class A2)	–	–	–	–	O	–
RFI filter (Class A1/B)	–	–	O	–	–	–
RFI filter (Class A2 Marine)	–	–	–	–	O	–
Brake chopper	O	O	O	O	O	O
Safe torque off	S	S	S	S	S	S
No LCP	O	O	O	O	O	O
Numerical LCP	O	O	O	O	O	O
Graphical LCP	O	O	O	O	O	O
Disconnect	–	–	O	O	–	–
Disconnect + load-share	–	–	O	O	–	–
Loadshare terminals	–	–	O	O	–	–
24 V DC supply	O	O	O	O	O	O

1) S = standard, O = optional, and a dash indicates that the option is unavailable.

## 4.4 Kit Availability

Table 17:

Kit description <sup>(1)</sup>	A2	A3	A4	A5	B1	B2	B3	B4	C1	C2	C3	C4
LCP, numerical	S	S	S	S	S	S	S	S	S	S	S	S
LCP, graphical	O	O	O	O	O	O	O	O	O	O	O	O
LCP cable, 3 m (9 ft)	O	O	O	O	O	O	O	O	O	O	O	O
Mounting kit for LCP (LCP, fasteners, gasket, and cable)	O	O	O	O	O	O	O	O	O	O	O	O
Terminal blocks	O	O	O	O	O	O	O	O	O	O	O	O
Terminal block for DC-link	O	O	-	-	-	-	-	-	-	-	-	-
Sub-D9 connector	O	O	O	O	O	O	O	O	O	O	O	O
Top entry kit for fieldbus cable	O	O	-	-	-	-	O	O	-	-	O	O
Backplate	-	-	-	O	O	O	-	-	O	O	-	-
IP21/Type 1 kit	O	O	-	-	-	-	O	O	-	-	O	O
Panel through mounting kit	-	-	-	O	O	O	-	-	O	O	-	-

1) S = standard, O = optional, and a dash indicates that the kit is unavailable for that enclosure. For kit descriptions and part numbers, see

## 5 Product Features

### 5.1 Automated Operational Features

#### 5.1.1 Automatic Energy Optimization

Automatic energy optimization (AEO) directs the drive to monitor the load on the motor continuously and adjust the output voltage to maximize efficiency. Under light load, the voltage is reduced and the motor current is minimized. The motor benefits from:

- Increased efficiency.
- Reduced heating.
- Quieter operation.

When using induction motors, the drive can optimize the energy efficiency of the motor in part load conditions by reducing the magnetization of the motor. This optimization leads to reduced losses in the motor.

The AEO function can also be used in applications where a higher starting torque is required (for example, wastewater pumps) or there are step load changes (such as conveyors). There is no need to select a V/Hz curve because the drive automatically adjusts motor voltage.

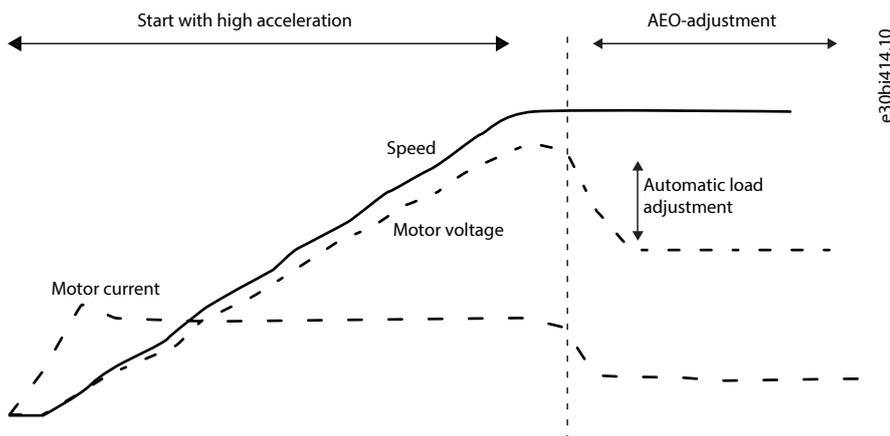


Figure 3: Automatic Energy Optimization

The AEO requires correct advanced motor data meaning that a complete automatic motor adaptation (AMA) has to be run.

#### 5.1.2 Short-circuit Protection

##### Motor (phase-to-phase)

The drive is protected against short circuits on the motor side by current measurements in each of the 3 motor phases. A short circuit between 2 output phases causes an overcurrent in the inverter. The inverter is turned off when the short-circuit current exceeds the allowed value (*Alarm 16, Trip Lock*).

##### Mains side

A drive that works correctly limits the current it can draw from the supply. Still, it is recommended to use fuses and/or circuit breakers on the supply side as protection if there is a component breakdown inside the drive (1st fault). Mains side fuses are mandatory for UL compliance.

**NOTICE**

To ensure compliance with IEC 60364 for CE or NEC 2017 for UL, it is mandatory to use fuses and/or circuit breakers.

**Brake resistor**

The drive is protected from a short circuit in the brake resistor.

**Load sharing**

To protect the DC bus against short circuits and the drives from overload, install DC fuses in series with the load sharing terminals of all connected units.

### 5.1.3 Overvoltage Protection

**Motor-generated overvoltage**

The DC-link voltage is increased when the motor acts as a generator. This increase occurs in the following situations:

- The load drives the motor (at a constant output frequency from the drive), that is, the load generates energy.
- During deceleration (ramp-down) if the moment inertia is high, the friction is low, and the ramp-down time is too short for the energy to be dissipated as a loss in the drive, the motor, and the installation.
- Incorrect slip compensation setting may cause higher DC-link voltage.
- Back EMF from permanent magnet motor operation. If coasted at high RPM, the permanent magnet motor back EMF may potentially exceed the maximum voltage tolerance of the drive and cause damage. To help prevent situation, the value of parameter **4-19 Max Output Frequency** is automatically limited based on an internal calculation. This calculation is based on the value of parameter **1-40 Back EMF at 1000 RPM**, parameter **1-25 Motor Nominal Speed**, and parameter **1-39 Motor Poles**.

**NOTICE**

To avoid that the motor overspeeds (for example, due to excessive windmilling effects), equip the drive with a brake resistor.

The overvoltage can be handled either via using a brake function (parameter **2-10 Brake Function**) and/or using overvoltage control (parameter **2-17 Over-voltage Control**).

**Brake functions**

Connect a brake resistor to dissipate surplus brake energy. Connecting a brake resistor allows a higher DC-link voltage during braking. AC brake is an alternative to improve braking without using a brake resistor. This function controls an overmagnetization of the motor when running regenerative, which can improve the OVC. Increasing the electrical losses in the motor allows the OVC function to increase the braking torque without exceeding the overvoltage limit.

**NOTICE**

An AC brake is not as efficient as dynamic braking with a resistor and should not be used on frequently repeated braking applications as it may overheat the motor.

**Overvoltage control (OVC)**

OVC reduces the risk of the drive tripping due to an overvoltage on the DC link. This risk is managed by automatically extending the ramp-down time.

**NOTICE**

OVC can be activated for permanent magnet motors with control core, PM VVC+, Flux open-loop control, and Flux closed-loop control.

**NOTICE****LOSS OF HOIST CONTROL**

If OVC is used with a hoist, the OVC will try to regulate the DC bus by spinning the motor faster, resulting in loss of hoisting control and/or damage to the hoist.

- Do not enable OVC in hoisting applications.

### 5.1.4 Missing Motor Phase Detection

The missing motor phase function (parameter *4-58 Missing Motor Phase Function*) is enabled by default to avoid motor damage if a motor phase is missing. The default setting is 1000 ms, but it can be adjusted for a faster detection.

### 5.1.5 Imbalance of Supply Voltage Detection

Operation under severe supply voltage imbalance conditions reduces the lifetime of the drive. Conditions are considered severe if the motor is operated continuously near nominal load. The default setting trips the drive if supply voltage imbalance occurs (parameter *14-12 Function at Mains Imbalance*).

### 5.1.6 Service Switch on the Output

Adding a service switch to the output between the motor and the drive is allowed. When parameter *4-58 Missing Motor Phase Function* is set to *[5] Motor Check*, the drive automatically detects when the motor is disconnected. The drive then issues *Warning 3, No Motor* and resumes operation when the motor is connected again. Danfoss recommends not to use this feature for 525–690 V drives connected to an IT mains network.

### 5.1.7 Overload Protection

#### Torque limit

The torque limit feature protects the motor against overload, independent of the speed. Torque limit is controlled in parameter *4-16 Torque Limit Motor Mode* and parameter *4-17 Torque Limit Generator Mode*. The time before the torque limit warning trips is controlled in parameter *14-25 Trip Delay at Torque Limit*.

#### Current limit

The current limit is controlled in parameter *4-18 Current Limit*, and the time before the drive trips is controlled in parameter *14-24 Trip Delay at Current Limit*.

#### Speed limit

Minimum speed limit: Parameter *4-11 Motor Speed Low Limit [RPM]* or parameter *4-12 Motor Speed Low Limit [Hz]* limit the minimum operating speed range of the drive. Maximum speed limit: Parameter *4-13 Motor Speed High Limit [RPM]* or parameter *4-19 Max Output Frequency* limit the maximum output speed that the drive can provide.

#### Electronic thermal relay (ETR)

ETR is an electronic feature that simulates a bimetal relay based on internal measurements. See [5.2.1 Motor Thermal Protection](#).

## Voltage limit

The inverter turns off to protect the transistors and the DC-link capacitors when a certain hard-coded voltage level is reached.

## Overtemperature

The drive has built-in temperature sensors and reacts immediately to critical values via hard-coded limits.

### 5.1.8 Locked Rotor Protection

There can be situations when the rotor is locked due to excessive load or other factors. The locked rotor cannot produce enough cooling, which in turn can overheat the motor winding. The drive is able to detect the locked rotor situation with PM VVC+ control (parameter **30-22 Locked Rotor Detection**).

### 5.1.9 Automatic Derating

#### 5.1.9.1 Overview of Automatic Derating

The drive is designed for continuous, full-load operation at switching frequencies between 1.5–2 kHz for 380–480 V, and 1–1.5 kHz for 525–690 V. The frequency range depends on power size and voltage rating. A switching frequency exceeding the maximum allowed range generates increased heat in the drive and requires the output current to be derated. An automatic feature of the drive is load-dependent switching frequency control. This feature allows the motor to benefit from as high a switching frequency as the load allows.

The drive also constantly checks for critical levels:

- Critical high temperature on the control card or heat sink.
- High motor load.
- High DC-link voltage.
- Low motor speed.

As a response to a critical level, the drive automatically adjusts the switching frequency. For critical high internal temperatures and low motor speed, the drive can also force the PWM pattern to SFAVM.

#### NOTICE

##### DERATING WITH SINE-WAVE FILTER

When using sine-wave filters, it is important to operate the filters within a safe range of switching frequencies. If the switching frequency is too low, the current through the filter rises and increases the temperature. High temperatures risk damage to the filter.

- Set parameter **14-55 Output Filter** to **[2] Sine-Wave Filter Fixed** to prevent the switching frequencies from being too low. Refer to the programming guide for more information

#### 5.1.9.2 How Automatic Derating Works

The automatic derating is made up of contributions from separate functions that evaluate the need. Their interrelationship is shown in [Figure 5](#).

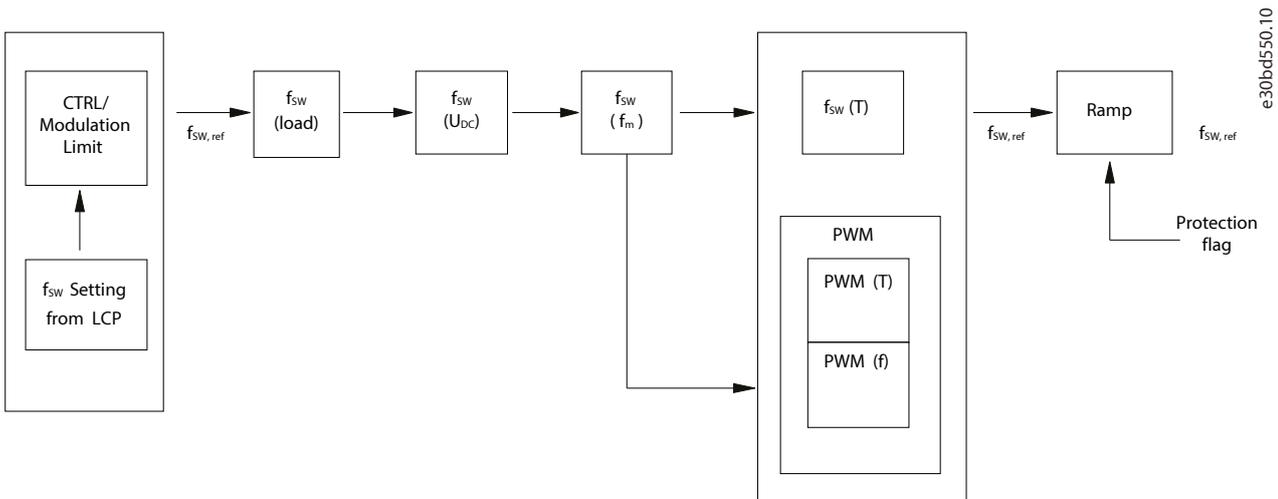


Figure 4: Automatic Derating Function Block

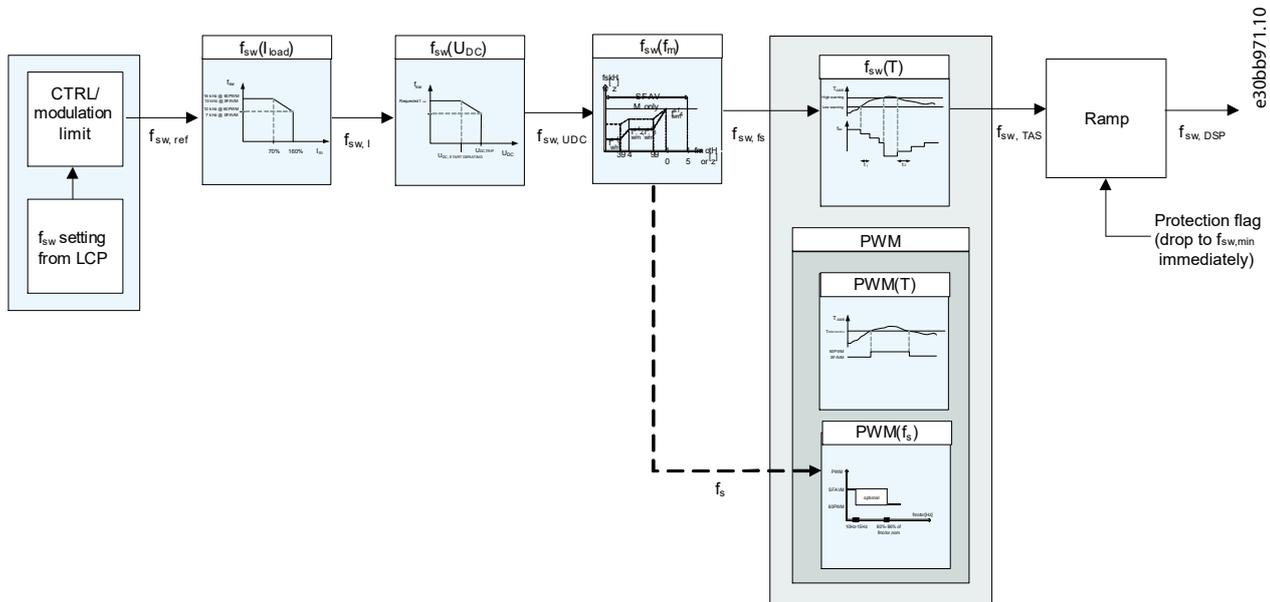


Figure 5: Interrelationship Between the Automatic Derating Contributions

The switching frequency is first derated due to motor current, followed by DC-link voltage, motor frequency, and then temperature. If multiple deratings occur on the same iteration, the resulting switching frequency would be the same as though only the most significant derating occurred by itself (the deratings are not cumulative). Each of these functions is presented in the following sections.

Table 18: Derating Functions

Background for derating	PWM - Functions that adjust the switching pattern	$f_{sw}$ – Functions that derate the switching frequency
$I_{load} \uparrow$	No automatic derating	
$U_{dc} \uparrow$	No automatic derating	
$f_s$		
$T \uparrow$		


### 5.1.9.3 High Internal Temperature

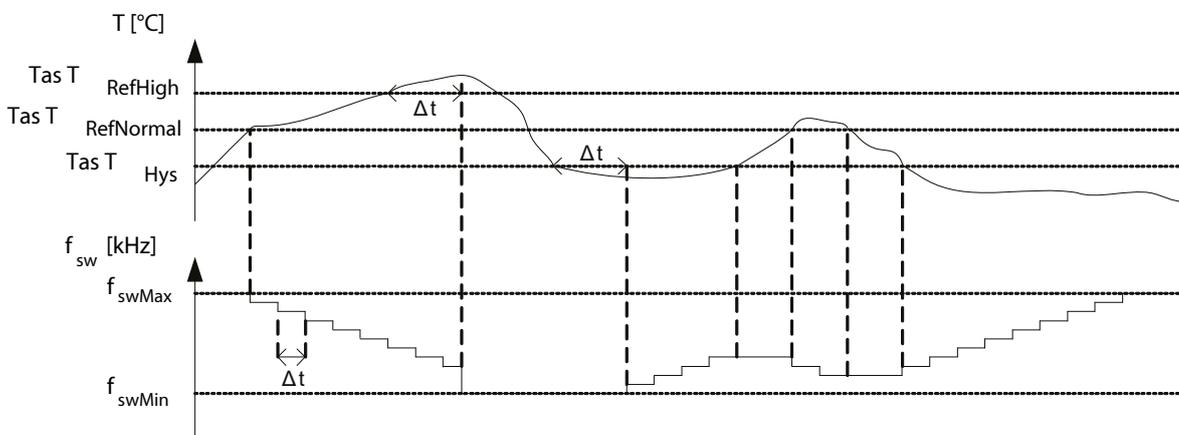Derate the output current at high temperatures. This calculation takes place after the calculations for derating the switching frequency. The result is an attempt to lower the temperatures by first lowering the switching frequency, and then lowering the output current. Current derating only takes place if you have programmed the unit to derate in overtemperature situations. If trip function is selected for overtemperature situations, the current derate factor is not lowered.

The switching frequency is derated based on both control card- and heat sink temperature. This function may sometimes be referred to as the temperature-adaptive switching frequency function (TAS).

#### NOTICE

In the example, 1 temperature affects the derating. In fact there are 2 limiting temperatures: control card temperature and heat sink temperature. Both have their own set of control temperatures.



e30bb981.12

Figure 6: Switching Frequency Derating due to High Temperature


#### NOTICE

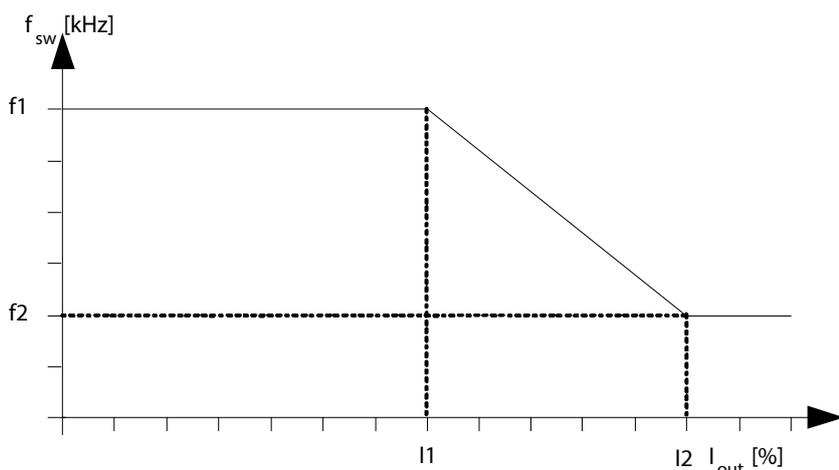dt is 10 s when the control card is too hot but 0 s when the heat sink is too hot (more critical).

The high warning can only be violated for a certain time before the drive trips.

### 5.1.9.4 High Motor Load

The switching frequency is adjusted automatically according to the motor current. When a certain percentage of the nominal HO motor load is reached, the switching frequency is derated. This percentage is individual for each enclosure size and a value that is coded in the EEPROM along with the other points that limit the derating.




e30b977.11

Figure 7: Derating of Switching Frequency According to Motor Load.  $f_1$ ,  $f_2$ ,  $I_1$ , and  $I_2$  are Coded in EEPROM.

In EEPROM, the limits depend on the modulation mode. In  $60^\circ$  AVM,  $f_1$  and  $f_2$  are higher than for SFAVM.  $I_1$  and  $I_2$  are independent of the modulation mode.

### 5.1.9.5 High Voltage on the DC link

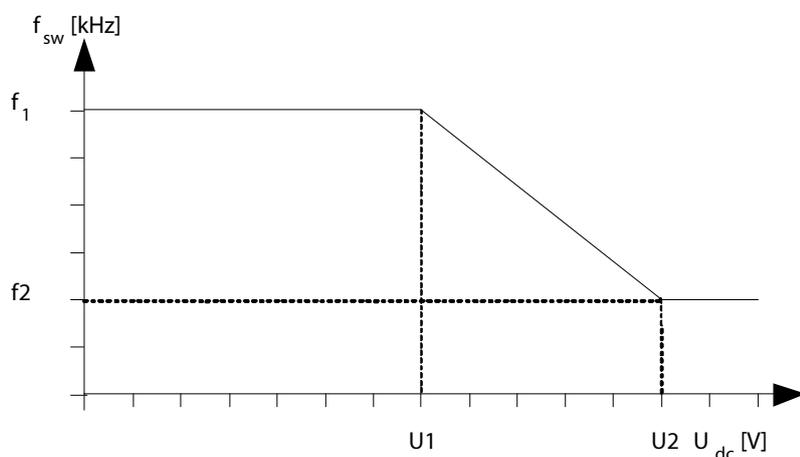The switching frequency is adjusted automatically according to the voltage on the DC link. When the DC link reaches a certain magnitude, the switching frequency is derated. The points that limit the derating are individual for each enclosure size and are coded in the EEPROM.




e30b978.11

Figure 8: Derating of Switching Frequency According to Voltage on the DC Link.  $f_1$ ,  $f_2$ ,  $U_1$ , and  $U_2$  are Coded in EEPROM.

In EEPROM, the limits depend on the modulation mode. In  $60^\circ$  AVM,  $f_1$  and  $f_2$  are higher than for SFAVM.  $U_1$  and  $U_2$  are independent of the modulation mode.

### 5.1.9.6 Low Motor Speed

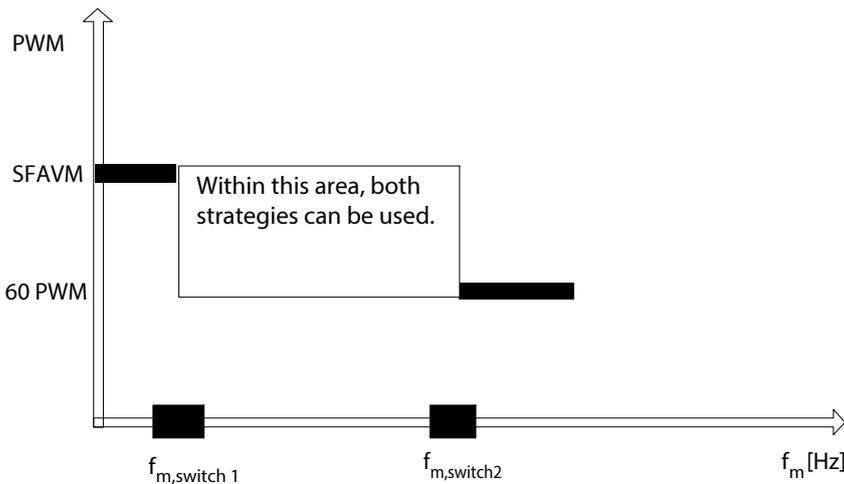The selection of PWM strategy depends on the stator frequency. To prevent that the same IGBT is running for too long (thermal consideration),  $f_{m,switch1}$  is specified as the minimum stator frequency for  $60^\circ$  PWM.  $f_{m,switch2}$  is specified as the maximum stator frequency for SFAVM to protect the drive.  $60^\circ$  PWM helps to reduce the inverter loss above  $f_{m,switch1}$  as the switch loss is reduced by 1/3 by changing from SFAVM to  $60^\circ$  AVM.




e30bb979.12

**Figure 9: Selection of PWM Strategy**

The shape of the average temperature is constant regardless of the stator frequency. The peak temperature, however, follows the shape of the output power for small stator frequencies and goes towards the average temperature for increasing stator frequency. This results in higher temperature variations for small stator frequencies. This means that the expected lifetime of the component decreases for small stator frequencies if no compensation is used. Therefore, for low values of the stator frequency where the temperature variations are large, the switching frequency can be reduced to lower the peak temperature and thereby the temperature variations.

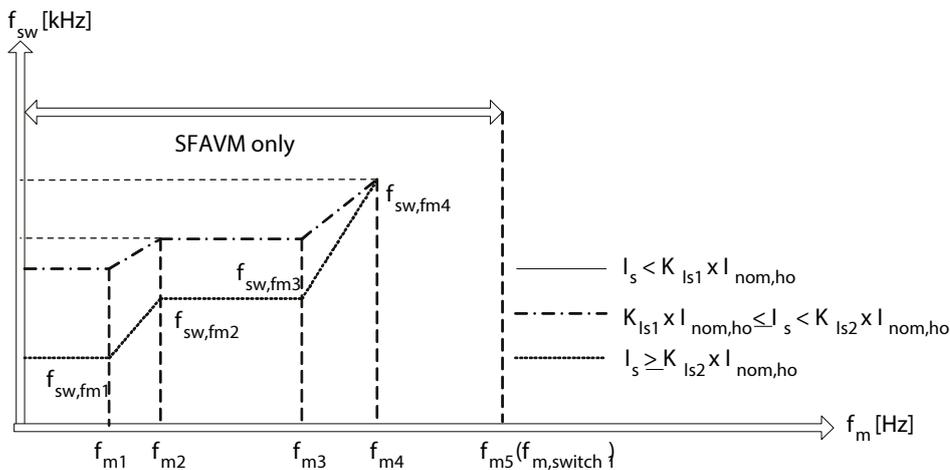For VT applications, the load current is relatively small for small stator frequencies and the temperature variations are thus not as large as for the CT applications. For this reason, also the load current is considered.



e30bb980.11

**Figure 10: Switching Frequency ( $f_{sw}$ ) Variation for Different Stator Frequencies ( $f_m$ )**

The points that limit the derating are individual for each enclosure size and are coded in the EEPROM. For VT applications, the load current is considered before derating the switching frequency at low motor speed.

### NOTICE

The VLT® HVAC FC 102 Drive never derates the current automatically. Automatic derating refers to adaptation of the switching frequency and pattern.

### 5.1.10 Power Fluctuation Performance

The drive withstands mains fluctuations such as:

- Transients.
- Momentary dropouts.
- Short voltage drops.
- Surges.

The drive automatically compensates for input voltages  $\pm 10\%$  from the nominal to provide full rated motor voltage and torque. With auto restart selected, the drive automatically powers up after a voltage trip. With flying start, the drive synchronizes to motor rotation before start.

### 5.1.11 Resonance Damping

Resonance damping eliminates the high-frequency motor resonance noise. Automatic or manually selected frequency damping is available.

### 5.1.12 Temperature-controlled Fans

Sensors in the drive regulate the operation of the internal cooling fans. Often, the cooling fans do not run during low load operation, or when in sleep mode or standby. These sensors reduce noise, increase efficiency, and extend the operating life of the fan.

### 5.1.13 EMC Compliance

Electromagnetic interference (EMI) and radio frequency interference (RFI) are disturbances that can affect an electrical circuit due to electromagnetic induction or radiation from an external source. The drive is designed to comply with the EMC product standard for drives IEC 61800-3 and the European standard EN 55011. Motor cables must be shielded and properly terminated to comply with the emission levels in EN 55011. For more information regarding EMC performance, see the *EMC Test Results* section.

### 5.1.14 Galvanic Isolation of Control Terminals

All control terminals and output relay terminals are galvanically isolated from mains power, which completely protects the controller circuitry from the input current. The output relay terminals require their own grounding. This isolation meets the stringent protective extra low voltage (PELV) requirements for isolation.

The components that make up the galvanic isolation are:

- Supply, including signal isolation.
- Gate drive for the IGBTs, trigger transformers, and optocouplers.
- The output current Hall effect transducers.

## 5.2 Custom Application Features


Custom application functions are the most common features programmed in the drive for enhanced system performance. They require minimum programming or setup. See the programming guide for instructions on activating these functions.

### 5.2.1 Motor Thermal Protection

Motor thermal protection can be provided via:

- Direct temperature sensing using a
  - PTC- or KTY sensor in the motor windings and connected on a standard AI or DI.
  - PT100 or PT1000 in the motor windings and motor bearings, connected on VLT® Sensor Input Card MCB 114 and VLT® Programmable I/O MCB 115.
  - PTC thermistor input on VLT® PTC Thermistor Card MCB 112 (ATEX-approved).
- Mechanical thermal switch (Klixon type) on a DI.
- Built-in electronic relay (ETR).

ETR calculates motor temperature by measuring current, frequency, and operating time. The drive shows the thermal load on the motor in percentage and can issue a warning at a programmable overload setpoint. Programmable options at the overload allow the drive to stop the motor, reduce output, or ignore the condition. Even at low speeds, the drive meets I2t Class 20 electronic motor overload standards.

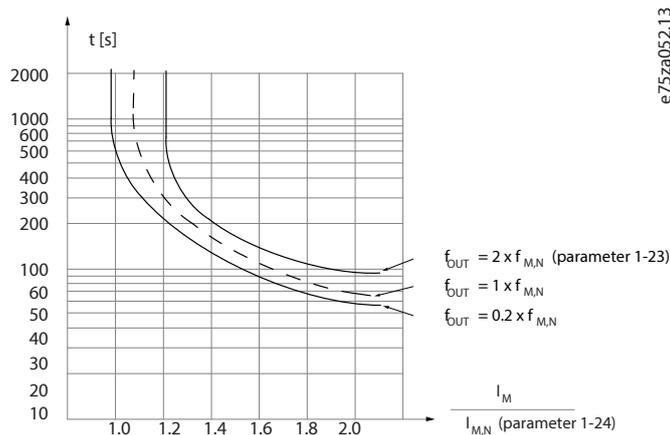

**Figure 11: ETR Characteristics**

The X-axis shows the ratio between  $I_{\text{motor}}$  and  $I_{\text{motor}}$  nominal. The Y-axis shows the time in seconds before the ETR cuts off and trips the drive. The curves show the characteristic nominal speed at twice the nominal speed and at 0.2 x the nominal speed. At lower speed, the ETR cuts off at lower heat due to less cooling of the motor. In that way, the motor is protected from being overheated even at low speed. The ETR feature calculates the motor temperature based on actual current and speed. The calculated temperature is visible as a readout parameter in parameter **16-18 Motor Thermal**. A special version of the ETR is also available for EX-e or EX-n motors in ATEX areas. This function makes it possible to enter a specific curve to protect the Ex-e motor. See the programming guide for setup instructions.

### 5.2.2 Built-in PID Controller

The built-in proportional, integral, derivative (PID) controller eliminates the need for auxiliary control devices. The PID controller maintains constant control of closed-loop systems where regulated pressure, flow, temperature, or other system requirements must be maintained.

The drive can use 2 feedback signals from 2 different devices, allowing the system to be regulated with different feedback requirements. The drive makes control decisions by comparing the 2 signals to optimize system performance.

### 5.2.3 Safe Torque Off

To run STO, extra wiring for the drive is required. Refer to the *VLT® Safe Torque Off Operating Guide* for further information.

#### Liability conditions

The customer is responsible for ensuring that personnel know how to install and operate the Safe Torque Off function by:

- Reading and understanding the safety regulations concerning health, safety, and accident prevention.
- Understanding the generic and safety guidelines provided in the *VLT® Safe Torque Off Operating Guide*.
- Having a good knowledge of the generic and safety standards for the specific application.

## 5.3 Load Sharing

Load sharing enables the connection of multiple Danfoss VLT® drives over the same DC link with the following benefits:

- Energy savings:
  - A motor running in regenerative mode can supply drives that are running in motoring mode. Alternatively, the motor running in regenerative mode can supply any brake resistors used with the drives.
- Reduced need for spare parts:
  - Usually, only 1 brake resistor is required for the installation instead of a brake resistor for each drive.
- Power backup:
  - If there was mains failure, all Danfoss VLT® drives can be supplied through the DC link from a backup. The application can thus continue running or go through a controlled shutdown process.

### 5.3.1 Preconditions and Special Conditions

Before considering load sharing, ensure that the following preconditions are met:

- Equip the drives with load sharing terminals. Enclosure sizes A1–A5 and B3 have load sharing terminals by default.
- Enclosure sizes B, C, and F must be configured for load sharing when ordering. The standard load share selection in character 21 or the type code is D, but other selections are available. For more configuration options, see [Drivecat](#). It is not possible to retrofit load sharing terminals on enclosure sizes B, C, and F.
- Enclosure sizes D and E must be configured for load sharing either when ordering or by using a retrofit kit. The standard load share selection in character 21 of the type code is D, but other options are available. For more configuration options, see [Drivecat](#).
- The drives considered for load sharing must be of the same product series.
- The drives must all have the same voltage rating, for example, use T5 with T5 only.
- Place the drives physically close to each other to allow the wiring between to be as short as possible (maximum 25 m (82 ft)). Build the wiring symmetrically around the drives with the highest power. Moreover, run the 2 wires closely together and, if possible, twisted.
- When adding a brake resistor in a load sharing configuration, equip all drives with a brake chopper.
- A brake chopper is specified in the type code when ordering and cannot be retrofitted. The standard selection in character 18 of the type code is B. For enclosure size A1, selection U, brake chopper + STO, is also a possibility.
- The fan in enclosure sizes D, E, and F must be supplied from an external power supply.

### NOTICE

Continuously monitor the *Drive ready* signal of the drives. The *Drive ready* signal impacts the overall application control.

### NOTICE

#### MISSING PHASE AND OVERCURRENT PROTECTION REQUIRED

Drives can have their rectifier overloaded even though the DC link does not show a high level of voltage ripple. Therefore, the mains supply must be equipped with missing phase and overcurrent protection.

### NOTICE

#### UNINTENDED WARNINGS OR REDUCED PERFORMANCE

In a load sharing application, the AC-brake function does not work as expected. The function checks for regenerative power, but in a load sharing application, the regenerative power can come from another drive.

- Turn off the AC-brake function in load sharing applications (parameter **2-10 Brake Function**). Example: A drive without a brake is combined with a drive with a brake. When the drive with a brake is braked, the other drive receives an overcurrent warning. Performance is not affected.

### NOTICE

The start-up time of the drive may be slightly longer than normal.

### NOTICE

According to the EMC Directive, a system is defined as a combination of several types of equipment, finished products, and/or components combined, designed and/or put together by the same person (system manufacturer) intended to be placed on the market for distribution as a single functional unit for an end user and intended to be installed and operated together to perform a specific task. The EMC directive applies to products/systems and installations, but in case the installation is built up of CE marked products/systems the installation can also be considered compliant with the EMC directive. Installations shall not be CE-marked.

According to the EMC Directive, Danfoss Drives as a manufacturer of product/systems is responsible for obtaining the essential requirements of the EMC directive and attaching the CE mark. For systems involving load sharing and other DC terminals, Danfoss Drives can only ensure compliance with EMC Directive when you connect combinations of Danfoss Drives products as described in our technical documentation.

If any third-party products are connected to the load share or other DC terminals on the AC drives, Danfoss Drives cannot guarantee that the EMC requirements are fulfilled.

## 5.3.2 Combinations of Enclosure Sizes

The concept for limiting inrush current in the DC-link capacitors is not the same for all enclosure sizes. Therefore, options for combining different enclosure sizes in load sharing applications are limited.

### NOTICE

#### RISK OF DRIVE FAILURE

Combining enclosure sizes that have different inrush control principles may lead to drive failure.

- Ensure that the applied inrush control principles are compatible before combining drives in a load sharing application.

Table 19: Inrush Control Principles for Individual Enclosure Sizes

Enclosure size	Principle
A	DC inrush self-limited
B	
C	AC inrush thyristor limited
D	AC inrush resistor limited
E	
F	

The following enclosure size combinations are possible in load sharing applications:

- A and B enclosures can be combined with other A or B enclosures.
- C, D, E, and F enclosures can be combined with other C, D, E, or F enclosures. However, C enclosures can only be combined with F enclosures under the following circumstances:
  - All drives are connected to mains or
  - only the F enclosure is connected to mains.
- It is not possible to combine F and C enclosures if only the C enclosure is connected to mains.
- If the A/B enclosure drive is not connected to mains, A and B enclosures can be combined with C, D, E, or F enclosures.

#### NOTICE

##### RISK OF DRIVE FAILURE

Combining A or B enclosures connected to mains with C, D, E, or F enclosures causes overload of the rectifier in the A and B enclosures during inrush and normal load conditions.

- Ensure that A and B enclosures are not connected to mains when combining them with C, D, E, or F enclosures.

To have the correct design of a load sharing circuit, consult the *Application Note Load Sharing* for more details.

## 5.4 Regen Overview

Regen typically occurs in applications with continuous braking such as cranes/hoists, downhill conveyors, and centrifuges where energy is pulled out of a decelerated motor.

- The load drives the motor when the drive is operated at a constant output frequency. This process is referred to as an overhauling load.
- During deceleration, if the inertia of the load is high and the deceleration time of the drive is set to a short value.

As standard, the drive cannot regenerate energy back to the input. The drive can use the internal brake chopper, which allows the excess energy to be dissipated in the form of heat within the external connected brake resistor.

Drives equipped with Active Front End (AFE) enables removal of excess energy using 1 of the following options:

- Brake chopper allows the excess energy to be dissipated in the form of heat within the brake resistor coils.
- Regen terminals allow a 3rd-party Regen to be connected to the drive, allowing the excess energy to be returned to the power grid.

Returning excess energy back to the power grid is the most efficient use of regenerated energy in applications using continuous braking.

### NOTICE

According to the EMC Directive, a system is defined as a combination of several types of equipment, finished products, and/or components combined, designed and/or put together by the same person (system manufacturer) intended to be placed on the market for distribution as a single functional unit for an end-user and intended to be installed and operated together to perform a specific task. The EMC directive applies to products/systems and installations, but in case the installation is built up of CE marked products/systems, the installation can also be considered compliant with the EMC directive. Installations shall not be CE-marked.

According to the EMC Directive, Danfoss Drives as a manufacturer of product/systems is responsible for obtaining the essential requirements of the EMC directive and attaching the CE mark. For systems involving load sharing and other DC terminals, Danfoss Drives can only ensure compliance with EMC Directive when end-users connect combinations of Danfoss Drives products as described in our technical documentation.

If any third-party products are connected to the load share or other DC terminals on the AC drives, Danfoss Drives cannot guarantee that the EMC requirements are fulfilled.

## 6 Options and Accessories Overview

### 6.1 Introduction

Danfoss offers an extensive range of options and accessories.

This chapter provides an overview of the different hardware options and accessories for the VLT® FC drives series:

- Fieldbus options
- Functional extensions
- Programmable controllers
- Power options
- Kits and accessories

### 6.2 VLT® Fieldbus Options

This topic gives an overview of currently available option cards related to fieldbus communication for the VLT® FC AC drives series. The fieldbus solutions brochure can be downloaded from [www.danfoss.com](http://www.danfoss.com) in the [Options and Accessories](#) section. More detailed descriptions of the fieldbus option cards can be found in the installation guides, programming guides, and operating guides for the individual options.

**Table 20: Fieldbus Options**

Option name	Slot	FC 102	FC 103	FC 202	FC 301	FC 302
VLT® PROFIBUS DP MCA 101	A	x	x	x	x	x
VLT® DeviceNet MCA 104	A	x	–	x	x	x
VLT® CANopen MCA 105	A	–	–	–	x	x
VLT® AK-LonWorks MCA 107 for ADAP-Kool®	A	–	x	–	–	–
VLT® LonWorks MCA 108	A	x	–	–	–	–
VLT® BACnet MCA 109	A	x	x	–	–	–
VLT® PROFIBUS Converter MCA 113 (VLT® 3000 to VLT® FC 302)	A	–	–	–	–	x
VLT® PROFIBUS Converter MCA 114 (VLT® 5000 to VLT® FC 302)	A	–	–	–	–	x
VLT® PROFINET MCA 120	A	x	x	x	x	x
VLT® EtherNet/IP MCA 121	A	x	–	x	x	x
VLT® Modbus TCP MCA 122	A	x	x	x	x	x
VLT® POWERLINK MCA 123	A	–	–	–	x	x
VLT® EtherCAT MCA 124	A	–	–	–	x	x
VLT® BACnet/IP MCA 125	A	x	–	x	–	–
VLT® DeviceNet Converter MCA 194	A	–	–	–	–	x

## 6.3 VLT® Functional Extensions

This topic gives an overview of currently available option cards for functional extension.

The functional extension option cards documentation can be downloaded from [www.danfoss.com](http://www.danfoss.com) in the [Options and Accessories](#) section. More detailed descriptions of the functional extension option cards can be found in the installation guides, programming guides, and operating guides for the individual options.

**Table 21: Functional Extensions**

Option name	Slot	FC 102	FC 103	FC 202	FC 301	FC 302
VLT® General Purpose I/O Option MCB 101	B	x	x	x	x	x
VLT® Encoder Option MCB 102	B	–	–	–	x	x
VLT® Resolver Input MCB 103	B	–	–	–	x	x
VLT® Relay Card MCB 105	B	x	x	x	x	x
VLT® 24 V DC Supply Option MCB 107	D	x	x	x	–	x
VLT® Safe PLC Interface Option MCB 108	B	–	–	–	–	x
VLT® Analog I/O MCB 109 (incl. RTC backup)	B	x	x	x	–	–
VLT® PTC Thermistor Card MCB 112	B	x	–	x	x	x
VLT® Extended Relay Card MCB 113	C	–	–	–	–	x
VLT® Sensor Input MCB 114	B	x	–	x	x	x
VLT® Programmable I/O MCB 115	B	x	x	x	x	x
VLT® Real-time Clock MCB 117	D	x	x	x	x	x
VLT® Safety Option MCB 150 (TTL)	B	–	–	–	–	x
VLT® Safety Option MCB 151 (HTL)	B	–	–	–	–	x
VLT® Safety Option MCB 152 (PROFIsafe)	B	–	–	–	–	x
VLT® Sensorless Safety MCB 159	–	–	–	–	–	x

1) MCB 159 is factory-mounted and must be ordered with VLT® Safety Option MCB 151.

## 6.4 VLT® Programmable Controllers

**Table 22: VLT® Programmable Controllers**

Option name		FC 102	FC 103	FC 202	FC 301	FC 302
VLT® Extended Cascade Controller MCO 101	B	–	–	x	–	–
VLT® Advanced Cascade Controller MCO 102	C	–	–	x	–	–
VLT® Motion Control Option MCO 305	C	–	–	–	x	x
VLT® Synchronizing Controller MCO 350	C	–	–	–	–	x
VLT® Position Controller MCO 351	C	–	–	–	–	x
Integrated Motion Controller IMC S067 (software option)	–	–	–	–	–	x

## 6.5 Kits and Accessories

### 6.5.1 Panel Through Mounting Kits for VLT® FC Series Enclosure Sizes A, B, and C

The panel through mounting kit can be used for cooling the heat sink via an external air stream, or where there is a wish to use a separate air duct. The electronics are sealed from the external air by use of the mounting flange and sealing gasket. This way the electronics are housed within the control panel, while the heat sink protrudes through the panel.

There are specific kits available for enclosure sizes A5, B1, B2, C1, C2. See [12.2.5 Code Numbers for Miscellaneous Hardware](#).

The mounting plate (must be purchased separately) is used if an air duct is not available. Mounted in a duct construction, the built-in fan can be removed and the cooling air provided by an external fan.



Figure 12: Panel Through Mounting Kit on a VLT® Drive

A	Drive mounted with a panel through mounting kit.	B	Panel through mounting kit with mounting plate for use with internal fan.
C	Panel through mounting kit without mounting plate for installation in air duct.	1	Mounting flange with sealing gasket.
2	Mounting plate.		

### 6.5.2 Panel Through Mounting Kits for VLT® FC Series Enclosure Sizes A, B, and C (IP21)

The panel through mounting kit is designed for IP21 enclosures and can be used for cooling the heat sink via an external air stream, or where there is a wish to use a separate air duct. The electronics are sealed from the external air by use of the mounting flange and sealing gasket. This way the electronics are housed within the control panel, while the heat sink protrudes through the panel.

There are specific kits available for enclosure sizes A5, B1, B2, C1, C2. See [12.2.5 Code Numbers for Miscellaneous Hardware](#).

The mounting plate (must be purchased separately) is used if an air duct is not available. Mounted in a duct construction, the built-in fan can be removed and the cooling air provided by an external fan.

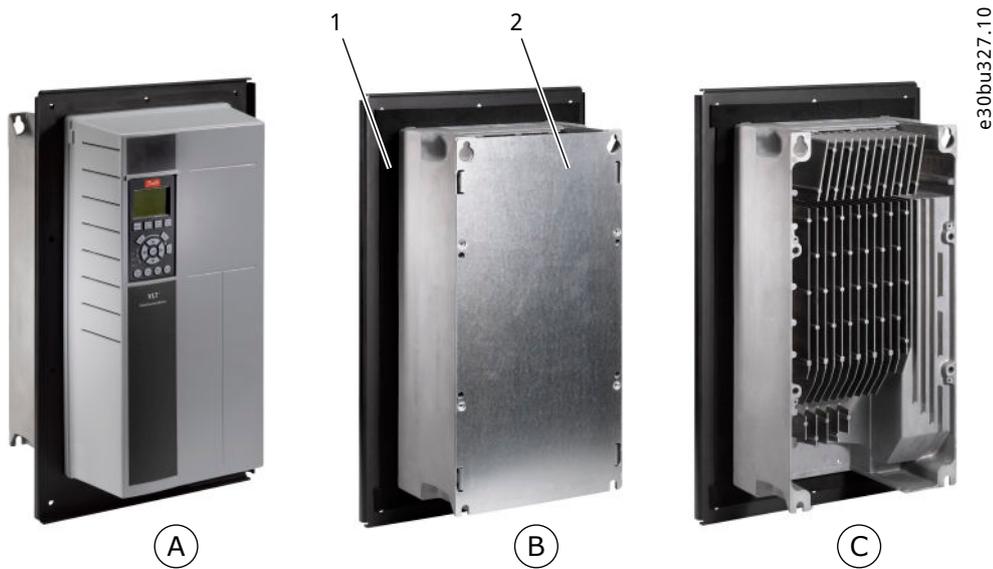


Figure 13: Panel Through Mounting Kit on a VLT® Drive

<p><b>A</b> Drive mounted with a panel through mounting kit.</p>	<p><b>B</b> Panel through mounting kit with mounting plate for use with internal fan.</p>
<p><b>C</b> Panel through mounting kit without mounting plate for installation in air duct.</p>	<p><b>1</b> Mounting flange with sealing gasket.</p>
<p><b>2</b> Mounting plate.</p>	

### 6.5.3 IP21/UL Type 1 Enclosure Kits for VLT® FC Series Enclosure Sizes A, B, and C

IP20/IP4X top/UL Type 1 is an optional enclosure element available for IP20 compact units. If the enclosure kit is used, an IP20 unit is upgraded to comply with enclosure IP21/4X top/UL Type 1. The IP4X top can be applied to all standard IP20 enclosure variants.

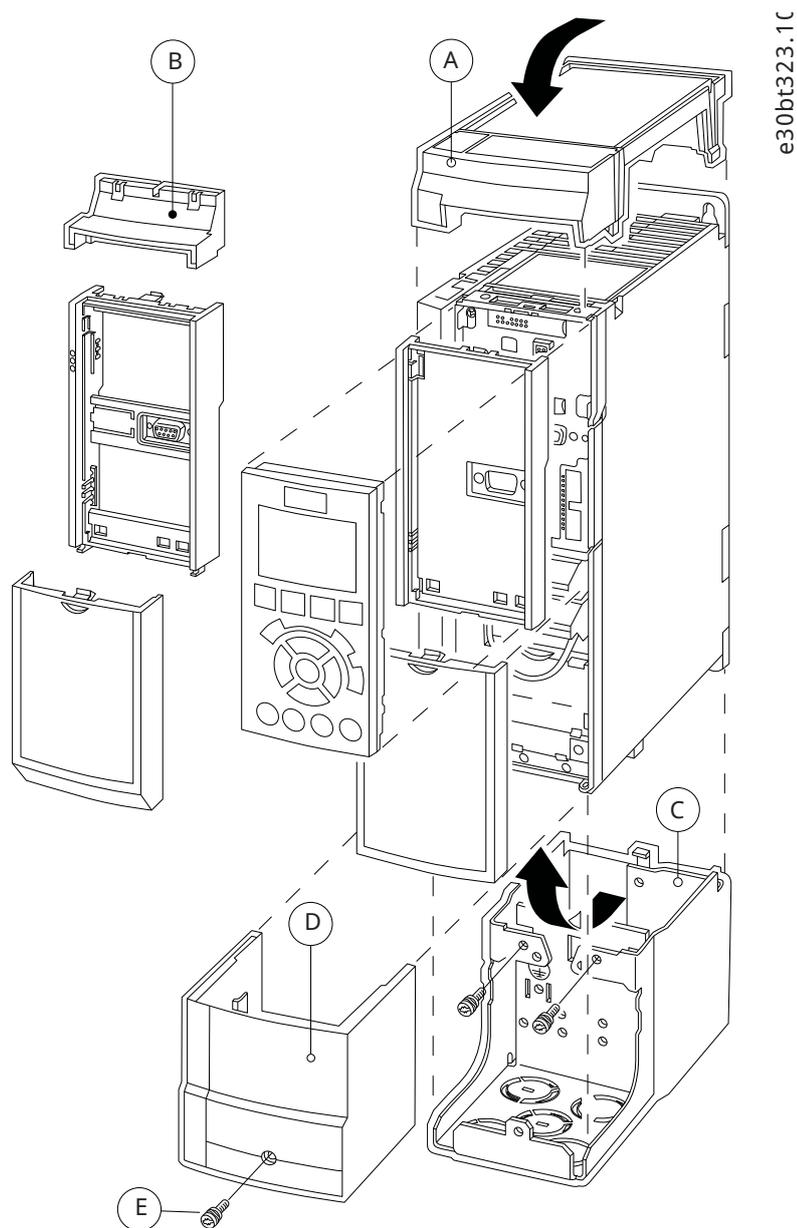


Figure 14: IP21/UL Type 1 Kit on an A2 Enclosure

A	Top cover	B	Brim
C	Pedestal part	D	Base cover
E	Screw(s)		

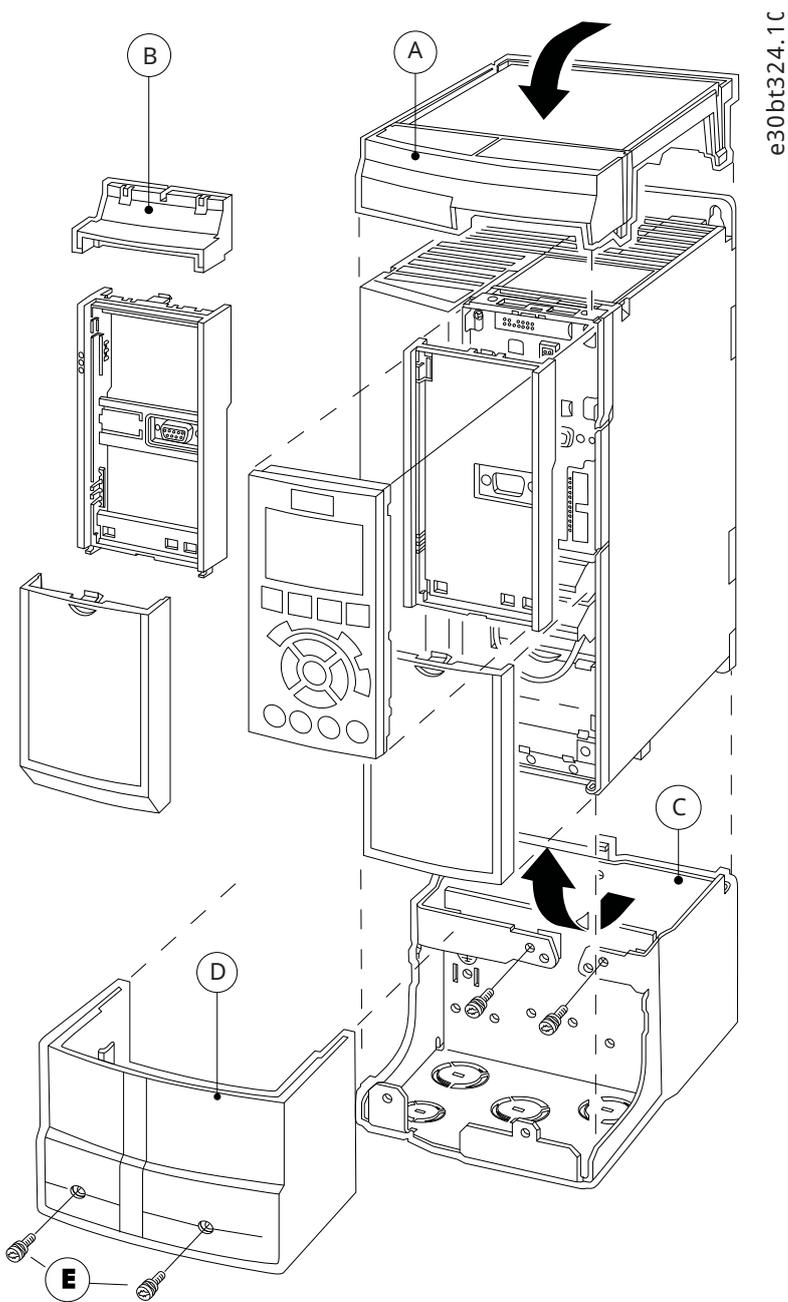


Figure 15: IP21/UL Type 1 Kit on an A3 Enclosure

A	Top cover	B	Brim
C	Pedestal part	D	Base cover
E	Screw(s)		

Place the top cover as shown. If an A or B option is used, fit the brim to cover the top inlet. Place the pedestal part C at the bottom of the drive and use the clamps from the accessory bag to fasten the cables correctly.

Holes for cable glands:

- Enclosure size A2: 2x M25 and 3xM32.
- Enclosure size A3: 3xM25 and 3xM32.

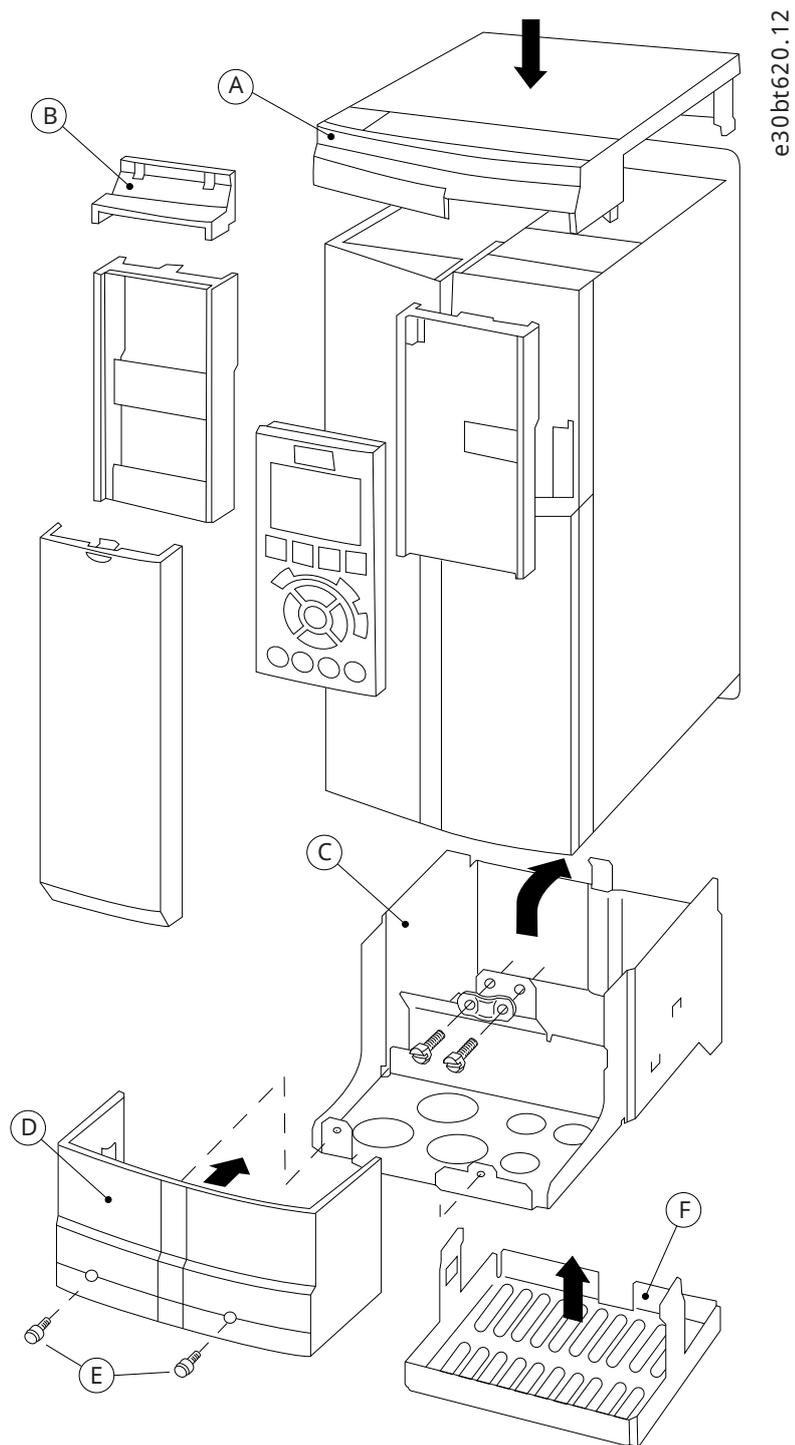


Figure 16: IP21/UL Type 1 Kit on a B3 Enclosure

A	Top cover	B	Brim
C	Pedestal part	D	Base cover
E	Screw(s)	F	Fan cover



<b>A</b>	Top cover	<b>C</b>	Pedestal part
<b>D</b>	Base cover	<b>G</b>	Top clip

When option module A and/or option module B is/are used, fit the brim (B) to the top cover (A).

### NOTICE

Side-by-side installation is not possible when using the IP21/IP4X/UL Type 1 Enclosure Kit.

**Table 23: Enclosure Dimensions with an Installed IP21/UL Type 1 Kit**

Enclosure size	Height A [mm (in)]	Width B [mm (in)]	Depth C [mm (in)]
A2	372 (14.6)	90 (3.5)	205 (8.1)
A3	372 (14.6)	130 (5.1)	205 (8.1)
B3	475 (18.7)	165 (6.5)	249 (9.8)
B4	670 (26.4)	255 (10.1)	246 (9.7)
C3	755 (29.7)	329 (13.0)	337 (13.3)
C4	950 (37.4)	391 (15.4)	337 (13.3)


1) If an A and/or B option is used, the depth increases.

## 6.5.4 Mounting Brackets for VLT® FC Series Enclosure Sizes A5, B1, B2, C1, and C2

The kits contain an upper and a lower bracket for the respective enclosure size.

**Table 24: Mounting Brackets, Dimensions**

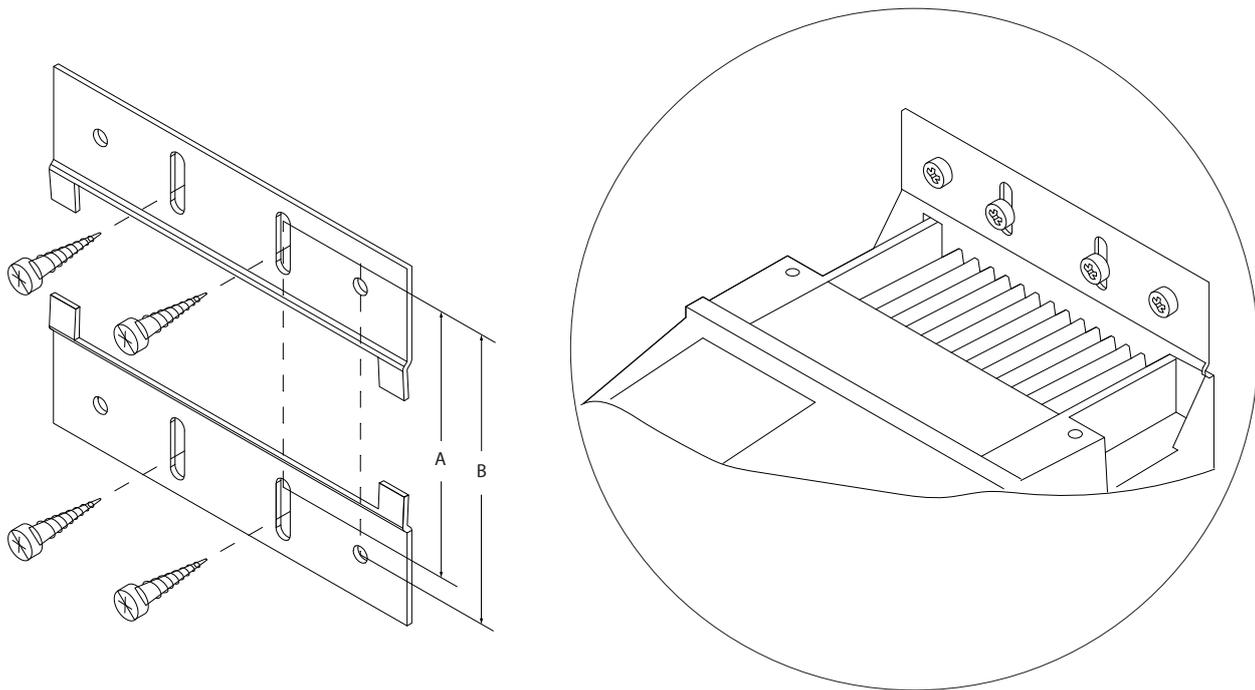Enclosure size	Protection rating	A [mm (in)]	B [mm (in)]
A5	IP55/66 (UL Type 12/4X)	480 (18.9)	495 (19.5)
B1	IP21/55/66 (UL Type 1/12/4X)	535 (21.1)	550 (21.7)
B2	IP21/55/66 (UL Type 1/12/4X)	705 (27.8)	720 (28.4)
C1	IP21/55/66 (UL Type 1/12/4X)	730 (28.7)	745 (29.3)
C2	IP21/55/66 (UL Type 1/12/4X)	820 (32.3)	835 (32.9)



e30ba845.11

Figure 18: Mounting Brackets for VLT®FC Series Enclosure Sizes A5, B1, B2, C2 and C2

### 6.5.5 Remote Mounting Kits for LCP

3 different remote mounting kits are available for the VLT® FC Series:

- Remote mounting kit for LCP with cover for outdoor mounting.
- Remote mounting kit with graphical LCP.
- Remote mounting kit with numerical LCP.

#### 6.5.5.1 Remote Mounting Kit for LCP 102 and LCP 103 with Cover for Outdoor Mounting

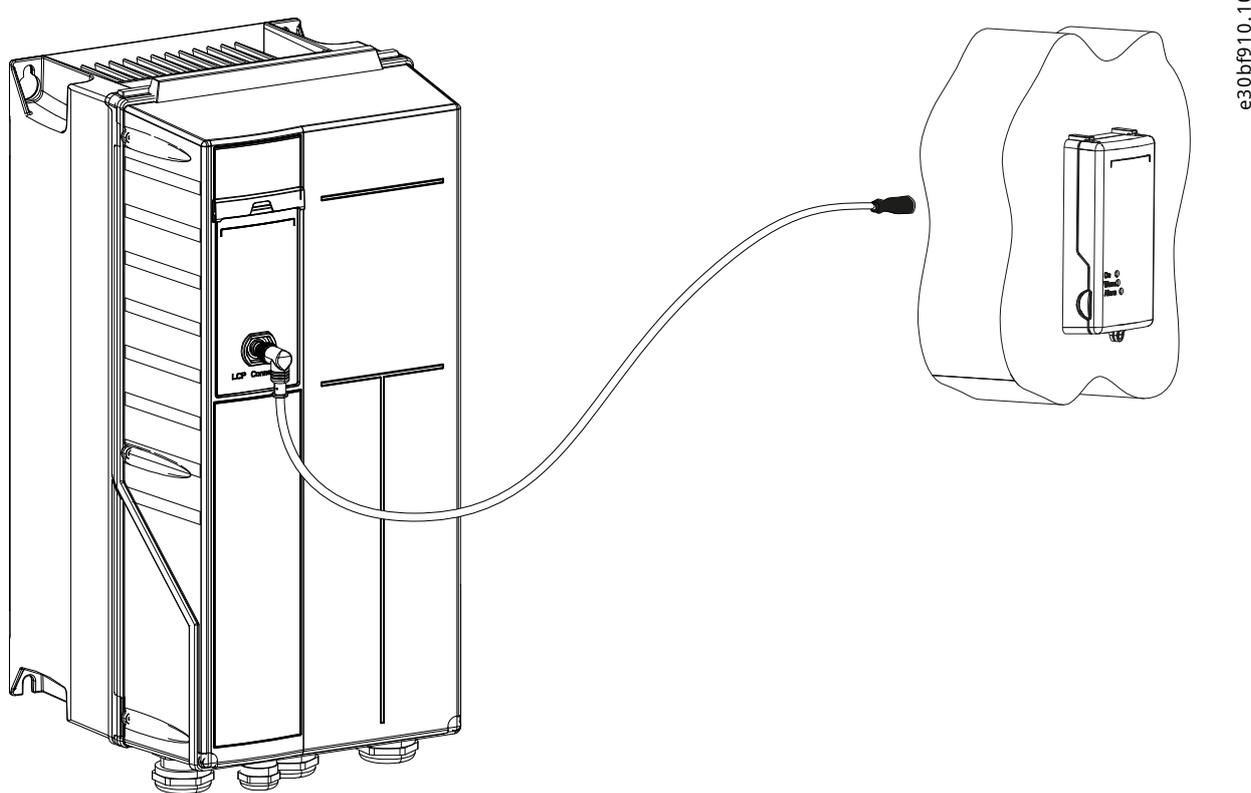
The kit allows the LCP to be mounted apart from the drive, for example, in a wall or panel. [12.2.6 Code Numbers for Local Control Panel Options](#). The LCP mounting kit provides the following features:

- Simple mounting, only one 24 mm bore required for mounting.
- IP54 protection rating of the LCP mounting.
- Protecting LCP from direct sunlight.
- Possibility to lock the LCP cover to prevent unauthorized access.
- LCP cover locking in an open position, for example, for commissioning.
- Indicators for alarms and warnings are visible through the cover.
- Can be mounted on a wall from 10–90 mm (0.4–3.5 in) thickness.

The kit contains the following parts:


- LCP cables with 2 M12 connectors (90° male connector and straight female connector).
- Cable to the LCP.

- Blind cover with M12 female connector.
- Base plate with D-SUB connector and M12 male connector.
- Two gaskets and 1 nut for the D-SUB connector.
- Intermediate cover with the front cover.
- Disassembly tool.



e30bf910.1c

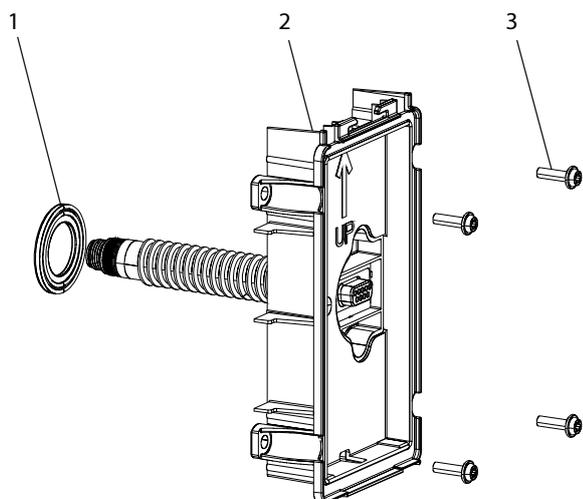Figure 19: Remote Connection of the LCP



e30bf904.11

Figure 20: Base Plate with D-SUB connector

---

1	Gasket	2	Base plate
3	Screws		

---

### 6.5.5.2 LCP Mounting Kit for LCP 102, LCP 101, and LCP 103

The kit allows the LCP to move the LCP to the front of a cabinet.

The kit contains the following parts:

- Optional: Graphical LCP 102, numerical LCP 101, or Wireless Control Panel LCP 103.
- 3 m (10 ft) cable to the LCP.
- Gasket.
- Fasteners.

To order the kit, see: [12.2.6 Code Numbers for Local Control Panel Options](#).

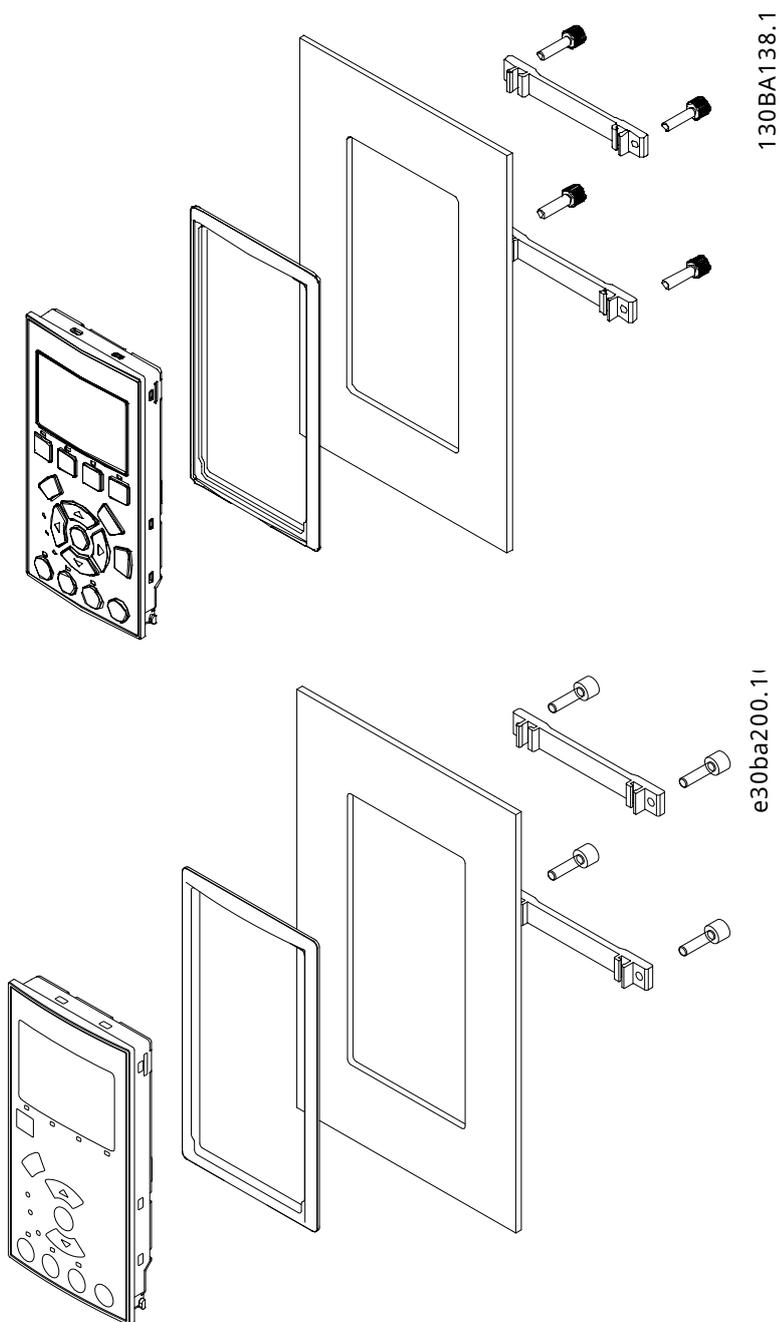


Figure 21: LCP Mounting Kit for LCP 102, LCP 101, and LCP 103

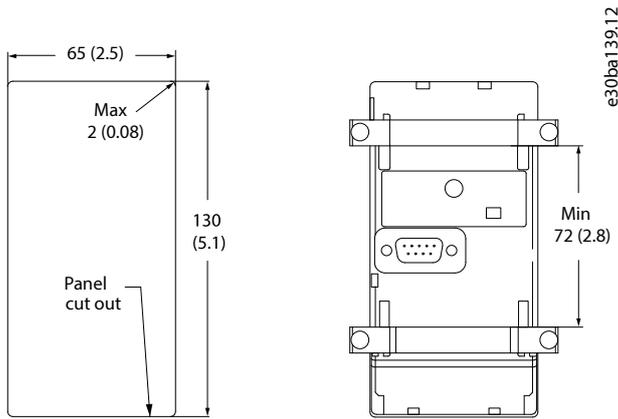


Figure 22: LCP Mounting Kit Dimensions

### 6.5.6 VLT® Wireless Communication Panel LCP 103

The VLT® Wireless Communication Panel LCP 103 communicates with VLT® Motion Control Tool MCT 10 or MyDrive® Connect – an app which can be downloaded to iOS- and Android-based smart devices.

MyDrive® Connect offers full access to the drive making it easier to perform commissioning, operation, monitoring, and maintenance tasks. Using the active point-to-point wireless connection, maintenance personnel can receive real-time error messages via the app to ensure a quick response to potential issues and reduce downtime.

The VLT® Wireless Communication Panel LCP 103 supports client mode, enabling multiple drives to connect with a common Wi-Fi point. The client mode allows remote access to different AC drives (but only 1 at a time) via VLT® Motion Control Tool MCT 10 or via the MyDrive® Connect App when the smart device is connected on the same network.

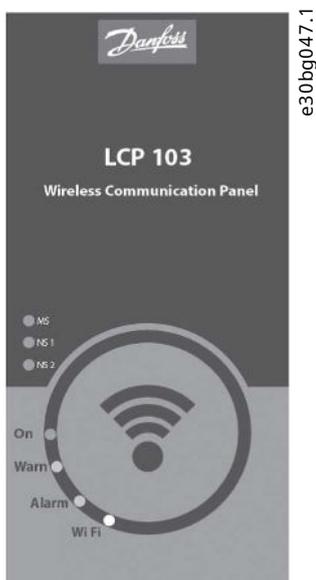


Figure 23: VLT® Wireless Communication Panel LCP 103

## 7 Specifications

### 7.1 Electrical Data, 200–240 V and 3x115Y/200–139Y/240 V

**Table 25: Mains Supply 3x200–240 V AC and 3x115Y/200–139Y/240 V AC, Normal Overload 110% for 1 minute, P1K1–P3K7**

Type designation	P1K1	P1K5	P2K2	P3K0	P3K7
Typical shaft output [kW]	1.1	1.5	2.2	3.0	3.7
Typical shaft output at 208 V [hp]	1.5	2.0	2.9	4.0	4.9
IP20/UL Open Type <sup>(1)</sup>	A2	A2	A2	A3	A3
IP55/UL Type 12	A4/A5	A4/A5	A4/A5	A5	A5
IP66/UL Type 4X	A4/A5	A4/A5	A4/A5	A5	A5
<b>Output current</b>					
Continuous (3x200–240 V) [A]	6.6	7.5	10.6	12.5	16.7
Intermittent (3x200–240 V) [A]	7.3	8.3	11.7	13.8	18.4
Continuous kVA (208 V AC) [kVA]	2.38	2.70	3.82	4.50	6.0
<b>Maximum input current</b>					
Continuous (3x200–240 V) [A]	5.9	6.8	9.5	11.3	15
Intermittent (3x200–240 V) [A]	6.5	7.5	10.5	12.4	16.5
<b>SCCR</b>					
A2/A3 with mains disconnect [kA <sub>rms</sub> ]	50 kA				
A4/A5 with mains disconnect [kA <sub>rms</sub> ]	65 kA				
Without mains disconnect [kA <sub>rms</sub> ]	100 kA				
<b>Power losses and efficiency</b>					
Estimated power loss at rated maximum load [W] <sup>(2)</sup>	63	82	116	155	185
Efficiency <sup>(3)</sup>	0.96	0.96	0.96	0.96	0.96

1) A2+A3 may be converted to IP21 using a conversion kit.

2) The typical power loss is at normal load conditions and expected to be within  $\pm 15\%$  (tolerance relates to variety in voltage and cable conditions). Values are based on a typical motor efficiency. Lower efficiency motors also add to the power loss in the drive and conversely. If the switching frequency is raised from nominal, the power losses may rise significantly. LCP and typical control card power consumptions are included. Further options and customer load may add up to 30 W to the losses. (Though typically only 4 W extra for a fully loaded control card or options for slot A or slot B, each). Although measurements are made with state-of-the-art equipment, some measurement inaccuracy must be allowed for ( $\pm 5\%$ ).

3) Measured using 5 m (16.4 ft) shielded motor cables at rated load and rated frequency.

**Table 26: Mains Supply 3x200–240 V AC and 3x115Y/200–139Y/240 V AC, Normal Overload 110% for 1 minute, P5K5–P15K**

Type designation	P5K5	P7K5	P11K	P15K
Typical shaft output [kW]	5.5	7.5	11	15
Typical shaft output at 208 V [hp]	7.5	10	15	20
IP20/UL Open Type <sup>(1)</sup>	B3	B3	B3	B4
IP21/UL Type 1	B1	B1	B1	B2

Table 26: Mains Supply 3x200–240 V AC and 3x115Y/200–139Y/240 V AC, Normal Overload 110% for 1 minute, P5K5–P15K - (continued)

Type designation	P5K5	P7K5	P11K	P15K
IP55/UL Type 12	B1	B1	B1	B2
IP66/UL Type 4X	B1	B1	B1	B2
<b>Output current</b>				
Continuous (3x200–240 V) [A]	24.2	30.8	46.2	59.4
Intermittent (3x200–240 V) [A]	26.6	33.9	50.8	65.3
Continuous kVA (208 V AC) [kVA]	8.7	11.1	16.6	21.4
<b>Maximum input current</b>				
Continuous (3x200–240 V) [A]	22	28	42	54
Intermittent (3x200–240 V) [A]	24.2	30.8	46.2	59.4
<b>SCCR</b>				
With mains disconnect [kA <sub>rms</sub> ]	65 kA	65 kA	65 kA	10 kA
Without mains disconnect [kA <sub>rms</sub> ]	100 kA	100 kA	100 kA	100 kA
<b>Power losses and efficiency</b>				
Estimated power loss at rated maximum load [W] <sup>(2)</sup>	269	310	447	602
Efficiency <sup>(3)</sup>	0.96	0.96	0.96	0.96

1) B3+4 and C3+4 may be converted to IP21 using a conversion kit.

2) The typical power loss is at normal load conditions and expected to be within ±15% (tolerance relates to variety in voltage and cable conditions). Values are based on a typical motor efficiency. Lower efficiency motors also add to the power loss in the drive and conversely. If the switching frequency is raised from nominal, the power losses may rise significantly. LCP and typical control card power consumptions are included. Further options and customer load may add up to 30 W to the losses. (Though typically only 4 W extra for a fully loaded control card or options for slot A or slot B, each). Although measurements are made with state-of-the-art equipment, some measurement inaccuracy must be allowed for (±5%).

3) Measured using 5 m (16.4 ft) shielded motor cables at rated load and rated frequency.

Table 27: Mains Supply 3x200–240 V AC and 3x115Y/200–139Y/240 V AC, Normal Overload 110% for 1 minute, P18K–P45K

Type designation	P18K	P22K	P30K	P37K	P45K
Typical shaft output [kW]	18.5	22	30	37	45
Typical shaft output at 208 V [hp]	25	30	40	50	60
IP20/UL Open Type <sup>(1)</sup>	B4	C3	C3	C4	C4
IP21/UL Type 1	C1	C1	C1	C2	C2
IP55/UL Type 12	C1	C1	C1	C2	C2
IP66/UL Type 4X	C1	C1	C1	C2	C2
<b>Output current</b>					
Continuous (3x200–240 V) [A]	74.8	88	115	143	170
Intermittent (3x200–240 V) [A]	82.3	96.8	127	157	187
Continuous kVA (208 V AC) [kVA]	26.9	31.7	41.4	51.5	61.2
<b>Maximum input current</b>					

Table 27: Mains Supply 3x200–240 V AC and 3x115Y/200–139Y/240 V AC, Normal Overload 110% for 1 minute, P18K–P45K - (continued)

Type designation	P18K	P22K	P30K	P37K	P45K
Continuous (3x200–240 V) [A]	68	80	104	130	154
Intermittent (3x200–240 V) [A]	74.8	88	114	143	169
<b>SCCR</b>					
With mains disconnect [kA <sub>rms</sub> ]	65 kA	65 kA	10 kA	10 kA	10 kA
Without mains disconnect [kA <sub>rms</sub> ]	100 kA				
<b>Power losses and efficiency</b>					
Estimated power loss at rated maximum load [W] <sup>(2)</sup>	737	845	1140	1353	1636
Efficiency <sup>(3)</sup>	0.96	0.97	0.97	0.97	0.97

1) B3+4 and C3+4 may be converted to IP21 using a conversion kit.

2) The typical power loss is at normal load conditions and expected to be within  $\pm 15\%$  (tolerance relates to variety in voltage and cable conditions). Values are based on a typical motor efficiency. Lower efficiency motors also add to the power loss in the drive and conversely. If the switching frequency is raised from nominal, the power losses may rise significantly. LCP and typical control card power consumptions are included. Further options and customer load may add up to 30 W to the losses. (Though typically only 4 W extra for a fully loaded control card or options for slot A or slot B, each). Although measurements are made with state-of-the-art equipment, some measurement inaccuracy must be allowed for ( $\pm 5\%$ ).

3) Measured using 5 m (16.4 ft) shielded motor cables at rated load and rated frequency.

## 7.2 Electrical Data, 380–480 V and 3x220Y/380–277Y/480 V

Table 28: Mains Supply 3x380–480 V AC and 3x220Y/380–277Y/480 V AC, Normal Overload 110% for 1 minute, P1K1–P7K5

Type designation	P1K1	P1K5	P2K2	P3K0	P4K0	P5K5	P5K5
Typical shaft output [kW]	1.1	1.5	2.2	3.0	4.0	5.5	7.5
Typical shaft output at 460 V [hp]	1.5	2.0	2.9	4.0	5.0	7.5	10
IP20/UL Open Type <sup>(1)</sup>	A2	A2	A2	A2	A2	A3	A3
IP55/UL Type 12	A4/A5	A4/A5	A4/A5	A4/A5	A4/A5	A5	A5
IP66/UL Type 4X	A4/A5	A4/A5	A4/A5	A4/A5	A4/A5	A5	A5
<b>Output current</b>							
Continuous (3x380–440 V) [A]	3	4.1	5.6	7.2	10	13	16
Intermittent (3x380–440 V) [A]	3.3	4.5	6.2	7.9	11	14.3	17.6
Continuous (3x441–480 V) [A]	2.7	3.4	4.8	6.3	8.2	11	14.5
Intermittent (3x441–480 V) [A]	3.0	3.7	5.3	6.9	9.0	12.1	15.4
Continuous kVA (400 V AC) [kVA]	2.1	2.8	3.9	5.0	6.9	9.0	11
Continuous kVA (460 V AC) [kVA]	2.4	2.7	3.8	5.0	6.5	8.8	11.6
<b>Maximum input current</b>							
Continuous (3x380–440 V) [A]	2.7	3.7	5.0	6.5	9.0	11.7	14.4
Intermittent (3x380–440 V) [A]	3.0	4.1	5.5	7.2	9.9	12.9	15.8
Continuous (3x441–480 V) [A]	2.7	3.1	4.3	5.7	7.4	9.9	13

Table 28: Mains Supply 3x380–480 V AC and 3x220Y/380–277Y/480 V AC, Normal Overload 110% for 1 minute, P1K1–P7K5 - (continued)

Type designation	P1K1	P1K5	P2K2	P3K0	P4K0	P5K5	P5K5
Intermittent (3x441–480 V) [A]	3.0	3.4	4.7	6.3	8.1	10.9	14.3
<b>SCCR</b>							
A2/A3 with mains disconnect [kA <sub>rms</sub> ]	50 kA						
A4/A5 with mains disconnect [kA <sub>rms</sub> ]	65 kA						
Without mains disconnect [kA <sub>rms</sub> ]	100 kA						
<b>Power losses and efficiency</b>							
Estimated power loss at rated maximum load [W] <sup>(2)</sup>	58	62	88	116	124	187	255
Efficiency <sup>(3)</sup>	0.96	0.97	0.97	0.97	0.97	0.97	0.97

1) A2+A3 may be converted to IP21 using a conversion kit.

2) The typical power loss is at normal load conditions and expected to be within ±15% (tolerance relates to variety in voltage and cable conditions). Values are based on a typical motor efficiency. Lower efficiency motors also add to the power loss in the drive and vice versa. If the switching frequency is raised from nominal, the power losses may rise significantly. LCP and typical control card power consumptions are included. Further options and customer load may add up to 30 W to the losses. (Though typically only 4 W extra for a fully-loaded control card or options for slot A or slot B, each). Although measurements are made with state-of-the-art equipment, some measurement inaccuracy must be allowed for (±5%).

3) Measured using 5 m (16.4 ft) shielded motor cables at rated load and rated frequency.

Table 29: Mains Supply 3x380–480 V AC and 3x220Y/380–277Y/480 V AC, Normal Overload 110% for 1 minute, P11K–P30K

Type designation	P11K	P15K	P18K	P22K	P30K
Typical shaft output [kW]	11	15	18.5	22	30
Typical shaft output at 460 V [hp]	15	20	25	30	40
IP20/UL Open Type <sup>(1)</sup>	B3	B3	B3	B4	B4
IP21/UL Type 1	B1	B1	B1	B2	B2
IP55/UL Type 12	B1	B1	B1	B2	B2
IP66/UL Type 4X	B1	B1	B1	B2	B2
<b>Output current</b>					
Continuous (3x380–439 V) [A]	24	32	37.5	44	61
Intermittent (3x380–439 V) [A]	26.4	35.2	41.3	48.4	67.1
Continuous (3x440–480 V) [A]	21	27	34	40	52
Intermittent (3x440–480 V) [A]	23.1	29.7	37.4	44	61.6
Continuous kVA (400 V AC) [kVA]	16.6	22.2	26	30.5	42.3
Continuous kVA (460 V AC) [kVA]	16.7	21.5	27.1	31.9	41.4
<b>Maximum input current</b>					
Continuous (3x380–439 V) [A]	22	29	34	40	55
Intermittent (3x380–439 V) [A]	24.2	31.9	37.4	44	60.5
Continuous (3x440–480 V) [A]	19	25	31	36	47
Intermittent (3x440–480 V) [A]	20.9	27.5	34.1	39.6	51.7

Table 29: Mains Supply 3x380–480 V AC and 3x220Y/380–277Y/480 V AC, Normal Overload 110% for 1 minute, P11K–P30K - (continued)

Type designation	P11K	P15K	P18K	P22K	P30K
<b>SCCR</b>					
With mains disconnect [ $kA_{rms}$ ]	65 kA	65 kA	65 kA	65 kA	10 kA
Without mains disconnect [ $kA_{rms}$ ]	100 kA				
<b>Power losses and efficiency</b>					
Estimated power loss at rated maximum load [W] <sup>(2)</sup>	278	392	465	525	698
Efficiency <sup>(3)</sup>	0.98	0.98	0.98	0.98	0.98

1) B3+4 and C3+4 may be converted to IP21 using a conversion kit.

2) The typical power loss is at normal load conditions and expected to be within  $\pm 15\%$  (tolerance relates to variety in voltage and cable conditions). Values are based on a typical motor efficiency. Lower efficiency motors also add to the power loss in the drive and vice versa. If the switching frequency is raised from nominal, the power losses may rise significantly. LCP and typical control card power consumptions are included. Further options and customer load may add up to 30 W to the losses. (Though typically only 4 W extra for a fully-loaded control card or options for slot A or slot B, each). Although measurements are made with state-of-the-art equipment, some measurement inaccuracy must be allowed for ( $\pm 5\%$ ).

3) Measured using 5 m (16.4 ft) shielded motor cables at rated load and rated frequency.

Table 30: Mains Supply 3x380–480 V AC and 3x220Y/380–277Y/480 V AC, Normal Overload 110% for 1 minute, P37K–P90K

Type designation	P37K	P45K	P55K	P75K	P90K
Typical shaft output [kW]	37	45	55	75	90
Typical shaft output at 460 V [hp]	50	60	75	100	125
IP20/UL Open Type <sup>(1)</sup>	B4	C3	C3	C4	C4
IP21/UL Type 1	C1	C1	C1	C2	C2
IP55/UL Type 12	C1	C1	C1	C2	C2
IP66/UL Type 4X	C1	C1	C1	C2	C2
<b>Output current</b>					
Continuous (3x380–439 V) [A]	73	90	106	147	177
Intermittent (3x380–439 V) [A]	80.3	99	117	162	195
Continuous (3x440–480 V) [A]	65	80	105	130	160
Intermittent (3x440–480 V) [A]	71.5	88	116	143	176
Continuous kVA (400 V AC) [kVA]	50.6	62.4	73.4	102	123
Continuous kVA (460 V AC) [kVA]	51.8	63.7	83.7	104	128
<b>Maximum input current</b>					
Continuous (3x380–439 V) [A]	66	82	96	133	161
Intermittent (3x380–439 V) [A]	72.6	90.2	106	146	177
Continuous (3x440–480 V) [A]	59	73	95	118	145
Intermittent (3x440–480 V) [A]	64.9	80.3	105	130	160
<b>SCCR</b>					
With mains disconnect [ $kA_{rms}$ ]	65 kA	65 kA	10 kA	65 kA	65 kA

Table 30: Mains Supply 3x380–480 V AC and 3x220Y/380–277Y/480 V AC, Normal Overload 110% for 1 minute, P37K–P90K - (continued)

Type designation	P37K	P45K	P55K	P75K	P90K
Without mains disconnect [kA <sub>rms</sub> ]	100 kA				
<b>Power losses and efficiency</b>					
Estimated power loss at rated maximum load [W] <sup>(2)</sup>	739	843	1083	1384	1474
Efficiency <sup>(3)</sup>	0.98	0.98	0.98	0.98	0.99

1) B3+4 and C3+4 may be converted to IP21 using a conversion kit.

2) The typical power loss is at normal load conditions and expected to be within ±15% (tolerance relates to variety in voltage and cable conditions). Values are based on a typical motor efficiency. Lower efficiency motors also add to the power loss in the drive and vice versa. If the switching frequency is raised from nominal, the power losses may rise significantly. LCP and typical control card power consumptions are included. Further options and customer load may add up to 30 W to the losses. (Though typically only 4 W extra for a fully-loaded control card or options for slot A or slot B, each). Although measurements are made with state-of-the-art equipment, some measurement inaccuracy must be allowed for (±5%).

3) Measured using 5 m (16.4 ft) shielded motor cables at rated load and rated frequency.

## 7.3 Electrical Data, 525–600 V

Table 31: Mains Supply 3x525–600 V AC - Normal Overload 110% for 1 Minute, P1K1–P7K5

Type designation	P1K1	P1K5	P2K2	P3K0	P3K7	P4K0	P5K5	P7K5
Typical shaft output [kW]	1.1	1.5	2.2	3.0	3.7	4.0	5.5	7.5
IP20/UL Open Type	A3	A3	A3	A3	A2	A3	A3	A3
IP21/UL Type 1	A3	A3	A3	A3	A2	A3	A3	A3
IP55/UL Type 12	A5							
IP66/UL Type 4X	A5							
<b>Output current</b>								
Continuous (3x525–550 V) [A]	2.6	2.9	4.1	5.2	–	6.4	9.5	11.5
Intermittent (3x525–550 V) [A]	2.9	3.2	4.5	5.7	–	7.0	10.5	12.7
Continuous (3x525–600 V) [A]	2.4	2.7	3.9	4.9	–	6.1	9.0	11
Intermittent (3x525–600 V) [A]	2.6	3.0	4.3	5.4	–	6.7	9.9	12.1
Continuous kVA (525 V AC) [kVA]	2.5	2.8	3.9	5.0	–	6.1	9.0	11
Continuous kVA (575 V AC) [kVA]	2.4	2.7	3.9	4.9	–	6.1	9.0	11
<b>Maximum input current</b>								
Continuous (3x525–600 V) [A]	2.4	2.7	4.1	5.2	–	5.8	8.6	10.4
Intermittent (3x525–600 V) [A]	2.7	3.0	4.5	5.7	–	6.4	9.5	11.5
<b>SCCR</b>								
A2/A3 with mains disconnect [kA <sub>rms</sub> ]	50 kA							
A4/A5 with mains disconnect [kA <sub>rms</sub> ]	65 kA							
Without mains disconnect [kA <sub>rms</sub> ]	100 kA							
<b>Power losses and efficiency</b>								

**Table 31: Mains Supply 3x525–600 V AC - Normal Overload 110% for 1 Minute, P1K1–P7K5 - (continued)**

Type designation	P1K1	P1K5	P2K2	P3K0	P3K7	P4K0	P5K5	P7K5
Estimated power loss at rated maximum load [W] <sup>(1)</sup>	50	65	92	122	–	145	195	261
Efficiency <sup>(2)</sup>	0.97	0.97	0.97	0.97	–	0.97	0.97	0.97

1) The typical power loss is at normal load conditions and expected to be within  $\pm 15\%$  (tolerance relates to variety in voltage and cable conditions). Values are based on a typical motor efficiency. Lower efficiency motors also add to the power loss in the drive and conversely. If the switching frequency is raised from nominal, the power losses may rise significantly. LCP and typical control card power consumptions are included. Further options and customer load may add up to 30 W to the losses. (Though typically only 4 W extra for a fully loaded control card or options for slot A or slot B, each). Although measurements are made with state-of-the-art equipment, some measurement inaccuracy must be allowed for ( $\pm 5\%$ ).

2) Measured using 5 m (16.4 ft) shielded motor cables at rated load and rated frequency

**Table 32: Mains Supply 3x525–600 V AC - Normal Overload 110% for 1 Minute, P11K–P30K**

Type designation	P11K	P15K	P18K	P22K	P30K
Typical shaft output [kW]	11	15	18.5	22	30
IP20/UL Open Type	B3	B3	B3	B4	B4
IP21/UL Type 1	B1	B1	B1	B2	B2
IP55/UL Type 12	B1	B1	B1	B2	B2
IP66/UL Type 4X	B1	B1	B1	B2	B2
<b>Output current</b>					
Continuous (3x525–550 V) [A]	19	23	28	36	43
Intermittent (3x525–550 V) [A]	21	25	31	40	47
Continuous (3x525–600 V) [A]	18	22	27	34	41
Intermittent (3x525–600 V) [A]	20	24	30	37	45
Continuous kVA (525 V AC) [kVA]	18.1	21.9	26.7	34.3	41
Continuous kVA (575 V AC) [kVA]	17.9	21.9	26.9	33.9	40.8
<b>Maximum input current</b>					
Continuous (3x525–600 V) [A]	17.2	20.9	25.4	32.7	39
Intermittent (3x525–600 V) [A]	19	23	28	36	43
<b>SCCR</b>					
With mains disconnect [kA <sub>rms</sub> ]	65 kA				
Without mains disconnect [kA <sub>rms</sub> ]	100 kA				
<b>Power losses and efficiency</b>					
Estimated power loss at rated maximum load [W] <sup>(1)</sup>	300	400	475	525	700
Efficiency <sup>(2)</sup>	0.97	0.97	0.97	0.97	0.97

1) The typical power loss is at normal load conditions and expected to be within  $\pm 15\%$  (tolerance relates to variety in voltage and cable conditions). Values are based on a typical motor efficiency. Lower efficiency motors also add to the power loss in the drive and conversely. If the switching frequency is raised from nominal, the power losses may rise significantly. LCP and typical control card power consumptions are included. Further options and customer load may add up to 30 W to the losses. (Though typically only 4 W extra for a fully loaded control card or options for slot A or slot B, each). Although measurements are made with state-of-the-art equipment, some measurement inaccuracy must be allowed for ( $\pm 5\%$ ).

2) Measured using 5 m (16.4 ft) shielded motor cables at rated load and rated frequency

Table 33: Mains Supply 3x525–600 V AC - Normal Overload 110% for 1 Minute, P37K–P90K

Type designation	P37K	P45K	P55K	P75K	P90K
Typical shaft output [kW]	37	45	55	75	90
IP20/UL Open Type	B4	C3	C3	C4	C4
IP21/UL Type 1	C1	C1	C1	C2	C2
IP55/UL Type 12	C1	C1	C1	C2	C2
IP66/UL Type 4X	C1	C1	C1	C2	C2
<b>Output current</b>					
Continuous (3x525–550 V) [A]	54	65	87	105	137
Intermittent (3x525–550 V) [A]	59	72	96	116	151
Continuous (3x525–600 V) [A]	52	62	83	100	131
Intermittent (3x525–600 V) [A]	57	68	91	110	144
Continuous kVA (525 V AC) [kVA]	51.4	61.9	82.9	100	130.5
Continuous kVA (575 V AC) [kVA]	51.8	61.7	82.7	99.6	130.5
<b>Maximum input current</b>					
Continuous (3x525–600 V) [A]	49	59	78.9	95.3	124.3
Intermittent (3x525–600 V) [A]	54	65	87	105	137
<b>SCCR</b>					
With mains disconnect [kA <sub>rms</sub> ]	65 kA				
Without mains disconnect [kA <sub>rms</sub> ]	100 kA				
<b>Power losses and efficiency</b>					
Estimated power loss at rated maximum load [W] <sup>(1)</sup>	750	850	1100	1400	1500
Efficiency <sup>(2)</sup>	0.98	0.98	0.98	0.98	0.98

1) The typical power loss is at normal load conditions and expected to be within  $\pm 15\%$  (tolerance relates to variety in voltage and cable conditions). Values are based on a typical motor efficiency. Lower efficiency motors also add to the power loss in the drive and conversely. If the switching frequency is raised from nominal, the power losses may rise significantly. LCP and typical control card power consumptions are included. Further options and customer load may add up to 30 W to the losses. (Though typically only 4 W extra for a fully loaded control card or options for slot A or slot B, each). Although measurements are made with state-of-the-art equipment, some measurement inaccuracy must be allowed for ( $\pm 5\%$ ).

2) Measured using 5m (16.4 ft) shielded motor cables at rated load and rated frequency

## 7.4 Electrical Data, 525–690 V

Table 34: Mains Supply 3x525–690 V AC, Normal Overload 110% for 1 Minute, P1K1–P7K5

Type designation	P1K1	P1K5	P2K2	P3K0	P4K0	P5K5	P7K5
Typical shaft output [kW]	1.1	1.5	2.2	3.0	4.0	5.5	7.5
Enclosure IP20/(UL Open Type)	A3						
<b>Output current</b>							
Continuous (3x525–550 V) [A]	2.1	2.7	3.9	4.9	6.1	9.0	11

Table 34: Mains Supply 3x525–690 V AC, Normal Overload 110% for 1 Minute, P1K1–P7K5 - (continued)

Type designation	P1K1	P1K5	P2K2	P3K0	P4K0	P5K5	P7K5
Intermittent (3x525–550 V) [A]	3.4	4.3	6.2	7.8	9.8	14.4	17.6
Continuous (3x551–690 V) [A]	1.6	2.2	3.2	4.5	5.5	7.5	10
Intermittent (3x551–690 V) [A]	2.6	3.5	5.1	7.2	8.8	12	16
Continuous kVA 525 V AC [kVA]	1.9	2.5	3.5	4.5	5.5	8.2	10
Continuous kVA 690 V AC [kVA]	1.9	2.6	3.8	5.4	6.6	9.0	12
<b>Maximum input current</b>							
Continuous (3x525–550 V) [A]	1.9	2.4	3.5	4.4	5.5	8.0	10
Intermittent (3x52–550 V) [A]	3.0	3.9	5.6	7.1	8.8	13	16
Continuous (3x551–690 V) [A]	1.4	2.0	2.9	4.0	4.9	6.7	9.0
Intermittent (3x551–690 V) [A]	2.3	3.2	4.6	6.5	7.9	10.8	14.4
<b>SCCR</b>							
A2/A3 with mains disconnect [kA <sub>rms</sub> ]	50 kA						
A4/A5 with mains disconnect [kA <sub>rms</sub> ]	65 kA						
Without mains disconnect [kA <sub>rms</sub> ]	100 kA						
<b>Power losses and efficiency</b>							
Estimated power loss at rated maximum load [W] <sup>(1)</sup>	44	60	88	120	160	220	300
Efficiency <sup>(2)</sup>	0.98	0.98	0.98	0.98	0.98	0.98	0.98

1) The typical power loss is at normal load conditions and expected to be within  $\pm 15\%$  (tolerance relates to variety in voltage and cable conditions). Values are based on a typical motor efficiency. Lower efficiency motors also add to the power loss in the drive and conversely. If the switching frequency is raised from nominal, the power losses may rise significantly. LCP and typical control card power consumptions are included. Further options and customer load may add up to 30 W to the losses. (Though typically only 4 W extra for a fully loaded control card or options for slot A or slot B, each). Although measurements are made with state-of-the-art equipment, some measurement inaccuracy must be allowed for ( $\pm 5\%$ ).

2) Measured using 5 m (16.4 ft) shielded motor cables at rated load and rated frequency.

Table 35: Mains Supply 3x525–690 V AC, Normal Overload 110% for 1 Minute, P11K–P30K

Type designation	P11K	P15K	P18K	P22K	P30K
High/normal load	NO	NO	NO	NO	NO
Typical shaft output at 550 V [kW]	7.5	11	15	18.5	22
Typical shaft output at 690 V [kW]	11	15	18.5	22	30
IP20/UL Open Type	B4	B4	B4	B4	B4
IP21/UL Type 1	B2	B2	B2	B2	B2
IP55/UL Type 12	B2	B2	B2	B2	B2
<b>Output current</b>					
Continuous (3x525–550 V) [A]	14	19	23	28	36
Intermittent (60 s overload) (3x525–550 V) [A]	22.4	20.9	25.3	30.8	39.6
Continuous (3x551–690 V) [A]	13	18	22	27	34

Table 35: Mains Supply 3x525–690 V AC, Normal Overload 110% for 1 Minute, P11K–P30K - (continued)

Type designation	P11K	P15K	P18K	P22K	P30K
Intermittent (60 s overload) (3x551–690 V) [A]	20.8	19.8	24.2	29.7	37.4
Continuous kVA (550 V AC) [kVA]	13.3	18.1	21.9	26.7	34.3
Continuous kVA (690 V AC) [kVA]	15.5	21.5	26.3	32.3	40.6
<b>Maximum input current</b>					
Continuous (at 550 V) [A]	15	19.5	24	29	36
Intermittent (60 s overload) (at 550 V) [A]	23.2	21.5	26.4	31.9	39.6
Continuous (at 690 V) [A]	14.5	19.5	24	29	36
Intermittent (60 s overload) (at 690 V) [A]	23.2	21.5	26.4	31.9	39.6
Maximum pre-fuses <sup>(1)</sup> [A]					
<b>SCCR</b>					
With mains disconnect [kA <sub>rms</sub> ]	65 kA				
Without mains disconnect [kA <sub>rms</sub> ]	100 kA				
<b>Power losses and efficiency</b>					
Estimated power loss at rated maximum load [W] <sup>(2)</sup>	150	220	300	370	440
Efficiency <sup>(3)</sup>	0.98	0.98	0.98	0.98	0.98

1) For type of fuse see CE Compliance and the Fuses and Circuit Breakers section.

2) The typical power loss is at normal load conditions and expected to be within ±15% (tolerance relates to variety in voltage and cable conditions). Values are based on a typical motor efficiency. Lower efficiency motors also add to the power loss in the drive and conversely. If the switching frequency is raised from nominal, the power losses may rise significantly. LCP and typical control card power consumptions are included. Further options and customer load may add up to 30 W to the losses. (Though typically only 4 W extra for a fully loaded control card or options for slot A or slot B, each). Although measurements are made with state-of-the-art equipment, some measurement inaccuracy must be allowed for (±5%).

3) Measured using 5 m (16.4 ft) shielded motor cables at rated load and rated frequency.

Table 36: Mains Supply 3x525–690 V AC, Normal Overload 110% for 1 Minute, P37K–P90K

Type designation	P37K	P45K	P55K	P75K	P90K
High/normal load	NO	NO	NO	NO	NO
Typical shaft output at 550 V [kW]	30	37	45	55	75
Typical shaft output at 690 V [kW]	37	45	55	75	90
IP20/UL Open Type	B4	C3	C3	D3h	D3h
IP21/UL Type 1	C2	C2	C2	C2	C2
IP55/UL Type 12	C2	C2	C2	C2	C2
<b>Output current</b>					
Continuous (3x525–550 V) [A]	43	54	65	87	105
Intermittent (60 s overload) (3x525–550 V) [A]	47.3	59.4	71.5	95.7	115.5
Continuous (3x551–690 V) [A]	41	52	62	83	100
Intermittent (60 s overload) (3x551–690 V) [A]	45.1	57.2	68.2	91.3	110

Table 36: Mains Supply 3x525–690 V AC, Normal Overload 110% for 1 Minute, P37K–P90K - (continued)

Type designation	P37K	P45K	P55K	P75K	P90K
Continuous kVA (550 V AC) [kVA]	41	51.4	61.9	82.9	100
Continuous kVA (690 V AC) [kVA]	49	62.1	74.1	99.2	119.5
<b>Maximum input current</b>					
Continuous (at 550 V) [A]	49	59	71	87	99
Intermittent (60 s overload) (at 550 V) [A]	53.9	64.9	78.1	95.7	108.9
Continuous (at 690 V) [A]	48	58	70	86	94.3
Intermittent (60 s overload) (at 690 V) [A]	52.8	63.8	77	94.6	112.7
Maximum pre-fuses <sup>(1)</sup> [A]	125	160	160	–	
<b>SCCR</b>					
With mains disconnect [kA <sub>rms</sub> ]	65 kA				
Without mains disconnect [kA <sub>rms</sub> ]	100 kA				
<b>Power losses and efficiency</b>					
Estimated power loss at rated maximum load [W] <sup>(2)</sup>	740	900	1100	1500	1800
Efficiency <sup>(3)</sup>	0.98	0.98	0.98	0.98	0.98

1) For type of fuse see CE Compliance and the Fuses and Circuit Breakers section.

2) The typical power loss is at normal load conditions and expected to be within  $\pm 15\%$  (tolerance relates to variety in voltage and cable conditions). Values are based on a typical motor efficiency. Lower efficiency motors also add to the power loss in the drive and conversely. If the switching frequency is raised from nominal, the power losses may rise significantly. LCP and typical control card power consumptions are included. Further options and customer load may add up to 30 W to the losses. (Though typically only 4 W extra for a fully loaded control card or options for slot A or slot B, each). Although measurements are made with state-of-the-art equipment, some measurement inaccuracy must be allowed for ( $\pm 5\%$ ).

3) Measured using 5 m (16.4 ft) shielded motor cables at rated load and rated frequency.

## 7.5 Mains Supply

Supply terminals	L1, L2, L3
Supply voltage <sup>(1)(2)(3)(4)</sup>	200–240 V $\pm 10\%$
Supply voltage <sup>(1)(2)(3)(5)</sup>	380–480 V $\pm 10\%$
Supply voltage <sup>(1)(2)</sup>	525–600 V $\pm 10\%$
Supply frequency	47.5–63 Hz
Maximum imbalance temporary between mains phases	3.0% of rated supply voltage
True power factor ( $\lambda$ )	$\geq 0.9$ nominal at rated load
Displacement power factor ( $\cos \Phi$ )	Near unity ( $> 0.98$ )
Switching on the input supply L1, L2, L3 (power-ups) $\leq 7.5$ kW (10 hp)	Maximum 2 times per minute
Switching on input supply L1, L2, L3 (power-ups) 11–90 kW (1.5–125 hp)	Maximum 1 time per minute

Environment according to EN60664-1

Overvoltage category III/pollution degree 2

- 1) Mains voltage low/mains dropout: During low mains voltage or a mains dropout, the drive continues until the DC-link voltage drops below the minimum stop level, which corresponds typically to 15% below the drive's lowest rated supply voltage. Power-up and full torque cannot be expected at a mains voltage lower than 10% below the drive's lowest rated supply voltage.
- 2) The unit is suitable for use on a circuit capable of delivering not more than 100000 RMS symmetrical Amperes, 240/500/600/690 V maximum, depending on drive power and voltage rating.
- 3) UL 61800-5-1 is not valid for IT and delta grounded grids.
- 4) If the type code position 23 = 6: UL 61800-5-1, the supply voltage is 3x115Y/200–139Y/240 V.
- 5) If the type code position 23 = 6: UL 61800-5-1, the supply voltage is 3x220Y/380-277Y/480 V.

## 7.6 Motor Output and Motor Data

### 7.6.1 Motor Output (U, V, W)

Output voltage	0–100% of supply voltage
Output frequency, 1.1–90 kW (1.5–125 hp)	0–590 Hz <sup>(1)</sup>
Switching on output	Unlimited
Ramp times	1–3600 s

1) From software version 3.92 the output frequency of the drive is limited to 590 Hz. Contact local Danfoss partner for further information.

### 7.6.2 Torque Characteristics

Starting torque (constant torque)	Maximum 110% for 60 s <sup>(1)</sup>
Starting torque	Maximum 135% up to 0.5 s <sup>(1)</sup>
Overload torque (constant torque)	Maximum 110% for 60 s <sup>(1)</sup>
Starting torque (variable torque)	Maximum 110% for 60 s <sup>(1)</sup>
Overload torque (variable torque)	Maximum 110% for 60 s
Torque rise time in VVC <sup>+</sup> (independent of $f_{sw}$ )	10 ms <sup>(2)</sup>

1) Percentage relates to the nominal torque.

2) The torque response time depends on application and load but as a rule, the torque step from 0 to reference is 4–5 x torque rise time.

## 7.7 Ambient Conditions

Enclosure	IP20/Chassis, IP20/Chassis, IP21/Type 1, IP54/Type 12, IP55/Type 12, IP66/Type 4X
Vibration test	1.0 g
Maximum relative humidity	5–93 (IEC 721-3-3); Class 3K3 (non-condensing) during operation
Aggressive environment (IEC 60068-2-43) H <sub>2</sub> S test	Class Kd
Ambient temperature	Maximum 50 °C (122 °F) (24-hour average maximum 45 °C (113 °F)) <sup>(1)</sup>
Minimum ambient temperature during full-scale operation	0 °C (32 °F)
Minimum ambient temperature at reduced speed performance	-10 °C (14 °F)

Temperature during storage/transport	-25 to +65/70 °C (-13 to +149/158 °F)
Maximum altitude above sea level without derating	1000 m (3280 ft)
EMC standards, Emission	EN 61800-3
EMC standards, Immunity	EN 61800-3
Energy efficiency class	IE2 <sup>(2)</sup>

1) See the Derating chapter for:

- Derating for high ambient temperature.
- Derating for high altitude.

2) Determined according to EN 50598-2 at:

- Rated load.
- 90% rated frequency.
- Switching frequency factory setting.
- Switching pattern factory setting.

## 7.8 Cable Specifications

### 7.8.1 Motor Cable Length

Maximum motor cable length, shielded	150 m (492 ft)
Maximum motor cable length, unshielded	300 m (984 ft)

### 7.8.2 Power Cable Cross-sections

Table 37: Maximum Cable Cross-section [mm<sup>2</sup> (AWG)]

Enclosure	Mains	Motor	Brake	Load share	Disconnect
A1	4(12)	4(12)	4(12)	4(12)	4(12)
A2	4(12)	4(12)	4(12)	4(12)	4(12)
A3	4(12)	4(12)	4(12)	4(12)	4(12)
A4	4(12)	4(12)	4(12)	4(12)	4(12)
A5	4(12)	4(12)	4(12)	4(12)	4(12)
B1	10(7)	10(6)	10(7)	10(7)	10(6)
B2	35(2)	35(2)	35(2)	35(2)	10(6)
B3	10(7)	10(7)	10(7)	10(7)	–
B4	35(2)	35(2)	35(2)	35(2)	–
C1	50(1/0)	50(1/0)	50(1/0)	50(1/0)	50(1/0)
C2	95(4/0)	95(4/0)	95(4/0)	95(4/0)	95(4/0)
C3	50(1/0)	50(1/0)	50(1/0)	50(1/0)	–
C4	95(4/0)	95(4/0)	95(4/0)	95(4/0)	–

### 7.8.3 Control Cable Cross-sections

Maximum cross-section to control terminals, flexible/rigid wire without cable end sleeves	1.5 mm <sup>2</sup> /16 AWG
Maximum cross-section to control terminals, flexible wire with cable end sleeves	1 mm <sup>2</sup> /18 AWG
Maximum cross-section to control terminals, flexible wire with cable end sleeves with collar	0.5 mm <sup>2</sup> /20 AWG
Minimum cross-section to control terminals	0.25 mm <sup>2</sup> /24 AWG

## 7.9 Control Input/Output and Control Data

### 7.9.1 Digital Inputs

Programmable digital inputs <sup>(1)</sup>	4 (6)
Terminal number	18, 19, 27, 29, 32, 33
Voltage level	0–24 V
Voltage level, logic 0 PNP	<5 V DC
Voltage level, logic 1 PNP	>10 V DC
Voltage level, logic 0 NPN	>19 V DC
Voltage level, logic 1 NPN	<14 V DC
Maximum voltage on input	28 V DC
Pulse frequency range	0–110 kHz
(Duty cycle) Minimum pulse width	4.5 ms
Input resistance, R <sub>i</sub>	Approximately 4 kΩ

1) The digital input is galvanically isolated from the supply voltage (PELV) and other high-voltage terminals.

### 7.9.2 STO Terminal 37 (Terminal 37 is Fixed PNP Logic)

Voltage level	0–24 V DC
Voltage level, logic 0 PNP	<4 V DC
Voltage level, logic 1 PNP	>20 V DC
Maximum voltage on input	28 V DC
Typical input current at 24 V	50 mA rms
Typical input current at 20 V	60 mA rms
Input capacitance	400 nF

All digital inputs are galvanically isolated from the supply voltage (PELV) and other high-voltage terminals.

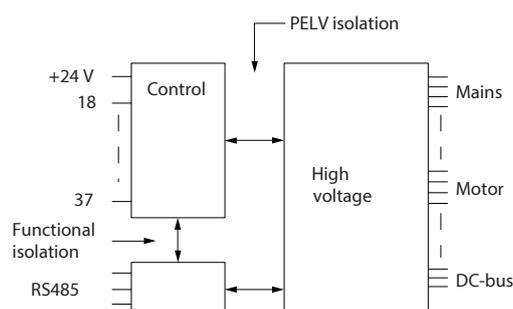
See the *Safe Torque Off Operating Guide* for further information about terminal 37 and Safe Torque Off.

When using a contactor with a DC coil inside in combination with STO, it is important to make a return way for the current from the coil when turning it off. This return path can be done by using a freewheel diode (or, alternatively, a 30 V or 50 V MOV for quicker response time) across the coil. Typical contactors can be bought with this diode.

### 7.9.3 Analog Inputs

Number of analog inputs	2
Terminal number	53, 54
Modes	Voltage or current
Mode select	Switch S201 and switch S202
Voltage mode	Switch S201/switch S202 = OFF (U)
Voltage level	-10 V to +10 V (scaleable)
Input resistance, $R_i$	Approximately 10 k $\Omega$
Maximum voltage	$\pm 20$ V
Current mode	Switch S201/S202 = ON (I)
Current level	0/4 mA to 20 mA (scaleable)
Input resistance, $R_i$	Approximately 200 $\Omega$
Maximum current	30 mA
Resolution for analog inputs	10 bit (+ sign)
Accuracy of analog inputs	Maximum error 0.5% of full scale
Bandwidth	20 Hz/100 Hz

The analog inputs are galvanically isolated from the supply voltage (PELV) and other high-voltage terminals.



e30ba117.11

Figure 24: PELV Isolation

### 7.9.4 Pulse/Encoder Inputs

Programmable pulse	2/1
Terminal number pulse	29, 33/33 <sup>(1)</sup>
Maximum frequency at terminals 29, 33	110 kHz (Push-pull driven)
Maximum frequency at terminals 29, 33	5 kHz (Open collector)
Maximum frequency at terminals 29, 33	4 Hz

Voltage level	See <a href="#">7.9.1 Digital Inputs</a> .
Maximum voltage on input	28 V DC
Input resistance, $R_i$	Approximately 4 k $\Omega$
Pulse input accuracy (0.1–1 kHz)	Maximum error: 0.1% of full scale
Encoder input accuracy (1–11 kHz)	Maximum error: 0.05% of full scale

1) Pulse inputs are 29 and 33.

The pulse and encoder inputs (terminals 29 and 33) are galvanically isolated from the supply voltage (PELV) and other high-voltage terminals.

### 7.9.5 Digital Outputs

Programmable digital/pulse outputs	2
Terminal number	27, 29
Voltage level at digital/frequency output	0–24 V
Maximum output current (sink or source)	40 mA
Maximum load at frequency output	1 k $\Omega$
Maximum capacitive load at frequency output	10 nF
Minimum output frequency at frequency output	0 Hz
Maximum output frequency at frequency output	32 kHz
Accuracy of frequency output	Maximum error: 0.1% of full scale
Resolution of frequency outputs	12 bit

1) Terminals 27 and 29 can also be programmed as input.

The digital output is galvanically isolated from the supply voltage (PELV) and other high-voltage terminals.

### 7.9.6 Analog Output

Number of programmable outputs	1
Terminal number	42
Current range at analog output	0/4 mA to 20 mA
Maximum load GND - analog output less than	500 $\Omega$
Accuracy on analog output	Maximum error: 0.5% of full scale
Resolution of analog output	12 bit

The analog output is galvanically isolated from the supply voltage (PELV) and other high-voltage terminals.

### 7.9.7 Control Card, 24 V DC Output

Terminal number	12, 13
Output voltage	24 V +1, -3 V

Maximum load	200 mA
--------------	--------

The 24 V DC supply is galvanically isolated from the supply voltage (PELV), but has the same potential as the analog and digital inputs and outputs.

### 7.9.8 Control Card, +10 V DC Output

Terminal number	50
Output voltage	10.5 V $\pm$ 0.5 V
Maximum load	15 mA

The 10 V DC supply is galvanically isolated from the supply voltage (PELV) and other high-voltage terminals.

### 7.9.9 Control Card, RS485 Serial Communication

Terminal number	68 (P, TX+, RX+), 69 (N, TX-, RX-)
Terminal number 61	Common for terminals 68 and 69

The RS485 serial communication circuit is galvanically isolated from the supply voltage (PELV).

### 7.9.10 Control Card, USB Serial Communication

USB standard	1.1 (full speed)
USB plug	USB type B plug

Connection to the PC is carried out via a standard host/device USB cable.

The USB connection is galvanically isolated from the supply voltage (PELV) and other high-voltage terminals.

The USB ground connection is not galvanically isolated from protective earth. Use only an isolated laptop as PC connection to the USB connector on the drive.

### 7.9.11 Relay Outputs

Programmable relay outputs	2
Relay 01 terminal number	1–3 (break), 1–2 (make)
Maximum terminal load (AC-1) <sup>(1)</sup> on 1–3 (NC), 1–2 (NO) (resistive load)	240 V AC, 2 A
Maximum terminal load (AC-15) <sup>(1)</sup> (inductive load @ $\cos\phi$ 0.4)	240 V AC, 0.2 A
Maximum terminal load (DC-1) <sup>(1)</sup> on 1–2 (NO), 1–3 (NC) (resistive load)	60 V DC, 1 A
Maximum terminal load (DC-13) <sup>(1)</sup> (inductive load)	24 V DC, 0.1 A
Relay 02 terminal number	4–6 (break), 4–5 (make)
Maximum terminal load (AC-1) <sup>(1)</sup> on 4–5 (NO) (resistive load) <sup>(2), (3)</sup>	400 V AC, 2 A
Maximum terminal load (AC-15) on 4–5 (NO) (inductive load @ $\cos\phi$ 0.4)	240 V AC, 0.2 A

Maximum terminal load (DC-1) <sup>(1)</sup> on 4–5 (NO) (resistive load)	80 V DC, 2 A
Maximum terminal load (DC-13) <sup>(1)</sup> on 4–5 (NO) (inductive load)	24 V DC, 0.1 A
Maximum terminal load (AC-1) <sup>(1)</sup> on 4–6 (NC) (resistive load)	240 V AC, 2 A
Maximum terminal load (AC-15) <sup>(1)</sup> on 4–6 (NC) (inductive load @ cosφ 0.4)	240 V AC, 0.2 A
Maximum terminal load (DC-1) <sup>(1)</sup> on 4–6 (NC) (resistive load)	50 V DC, 2 A
Maximum terminal load (DC-13) <sup>(1)</sup> on 4–6 (NC) (inductive load)	24 V DC, 0.1 A
Minimum terminal load on 1–3 (NC), 1–2 (NO), 4–6 (NC), 4–5 (NO)	24 V DC 1 mA, 24 V AC 20 mA
Environment according to EN 60664-1	Overvoltage category III/pollution degree 2

1) IEC 60947 parts 4 and 5. The relay contacts are galvanically isolated from the rest of the circuit by reinforced isolation (PELV)

2) Overvoltage Category II

3) UL applications 300 V AC 2 A.

### 7.9.12 Control Card Performance

Scan interval	1 ms
---------------	------

### 7.9.13 Control Characteristics

Resolution of output frequency at 0–590 Hz	±0.003 Hz
Repeat accuracy of precise start/stop (terminals 18, 19)	≤±0.1 ms
System response time (terminals 18, 19, 27, 29, 32, 33)	≤2 ms
Speed control range (open loop)	1:100 of synchronous speed
Speed control range (closed loop)	1:1000 of synchronous speed
Speed accuracy (open loop)	30–4000 RPM: Error ±8 RPM
Speed accuracy (closed loop), depending on resolution of feedback device	0–6000 RPM: Error ±0.15 RPM
Torque control accuracy (speed feedback)	Maximum error ±5% of rated torque

All control characteristics are based on a 4-pole asynchronous motor.

## 7.10 Connection Tightening Torques

Table 38: Tightening Torque for Cables

Enclosure size	200–240 V [kW (hp)]	380–480/500 V [kW (hp)]	525–600 V [kW (hp)]	525–690 V [kW (hp)]	Mains [Nm (in-lb)]	Motor [Nm (in-lb)]	DC connection [Nm (in-lb)]	Brake [Nm (in-lb)]	Ground [Nm (in-lb)]	Relay [Nm (in-lb)]
A2	1.1–2.2 (1.5–3.0)	1.1–4.0 (1.5–5.0)	–	–	0.6	0.6	0.6	1.8	3.0	0.6
A3	3.0–3.7 (4.0–5.0)	5.5–7.5 (7.5–10)	1.1–7.5 (1.5–10)	1.1–7.5 (1.5–10.0)	0.6	0.6	0.6	1.8	3.0	0.6

Table 38: Tightening Torque for Cables - (continued)

Enclosure size	200–240 V [kW (hp)]	380–480/500 V [kW (hp)]	525–600 V [kW (hp)]	525–690 V [kW (hp)]	Mains [Nm (in-lb)]	Motor [Nm (in-lb)]	DC connection [Nm (in-lb)]	Brake [Nm (in-lb)]	Ground [Nm (in-lb)]	Relay [Nm (in-lb)]
A4	1.1–2.2 (1.5–3.0)	1.1–4.0 (0.5–5.0)	–	–	0.6	0.6	0.6	1.8	3.0	0.6
A5	1.1–3.7 (1.5–5.0)	1.1–7.5 (1.5–10)	1.1–7.5 (1.5–10.0)	–	0.6	0.6	0.6	1.8	3.0	0.6
B1	5.5–11 (7.5–15)	11–18 (15–24)	11–18 (15–24)	–	1.8	1.8 (15.9)	1.5	1.5	3.0	0.6
B2	15 (20)	22–30 (30–40)	22–30 (30–40)	11–30 (15–40)	4.5 (39.8)	4.5 (39.8)	3.7	3.7	3.0	0.6
B3	5.5–11 (7.5–15)	11–18 (15–24)	11–18 (15–24)	–	1.8 (15.9)	1.8 (15.9)	1.8 (15.9)	1.8 (15.9)	3.0	0.6
B4	15–18 (20–24)	22–37 (30–50)	22–37 (30–50)	11–37 (15–50)	4.5 (39.8)	4.5 (39.8)	4.5 (39.8)	4.5 (39.8)	3.0	0.6
C1	18–30 (24–40)	37–55 (50–75)	37–55 (50–75)	–	10 (89)	10 (89)	10 (89)	10 (89)	3.0	0.6
C2	37–45 (50–60)	75–90 (100–125)	75–90 (100–125)	37–90 (50–125)	14/24 (124/212) <sup>1)</sup>	14/24 (124/212) <sup>1)</sup>	14 (124)	14 (124)	3.0	0.6
C3	22–30 (30–40)	45–55 (60–75)	45–55 (60–75)	45–55 (60–75)	10 (89)	10 (89)	10 (89)	10 (89)	3.0	0.6
C4	37–45 (50–60)	75–90 (100–125)	75–90 (100–125)	–	14/24 (124/212) <sup>1)</sup>	14/24 (124/212) <sup>1)</sup>	14	14	3.0	0.6

1) For different cable dimensions x/y, where x ≤ 95 mm<sup>2</sup> (3 AWG) and y ≥ 95 mm<sup>2</sup> (3 AWG).

## 7.11 Power Ratings, Weight, and Dimensions

Table 39: Power Ratings, Weight, and Dimensions, Enclosure Size A

Enclosure size		A2	A3	A4	A5
Rated power [kW (hp)]	200–240 V	1.1–2.2 (1.5–3.0)	3.0–3.7 (4.0–5.0)	1.1–2.2 (1.5–3.0)	1.1–3.7 (1.5–5.0)
	380–480/500 V	1.1–4.0 (1.5–5.0)	5.5–7.5 (7.5–10)	1.1–4.0 (1.5–5.0)	1.1–7.5 (1.5–10)
	525–600 V	–	1.1–7.5 (1.5–10)	–	1.1–7.5 (1.5–10)
	525–690 V	–	1.1–7.5 (1.5–10)	–	–

Table 39: Power Ratings, Weight, and Dimensions, Enclosure Size A - (continued)

Enclosure size		A2		A3		A4	A5
Protection rating	–	IP20 (UL Open Type)	IP21 (UL Type 1)	IP20 (UL Open Type)	IP21 (UL Type 1)	IP55/66 (UL Type 12/4X)	IP55/66 (UL Type 12/4X)
<b>Height [mm (in)]</b>							
Height of mounting plate	A <sup>(1)</sup>	268 (10.6)	375 (14.8)	268 (10.6)	375 (14.8)	390 (15.4)	420 (16.5)
Height with ground termination plate for fieldbus cables	A	374 (14.7)	–	374 (14.7)	–	–	–
Distance between mounting holes	a	257 (10.1)	350 (13.8)	257 (10.1)	350 (13.8)	401 (15.8)	402 (15.8)
<b>Width [mm (in)]</b>							
Width of mounting plate	B	90 (3.5)	90 (3.5)	130 (5.1)	130 (5.1)	200 (7.9)	242 (9.5)
Width of mounting plate with 1 C option	B	130 (5.1)	130 (5.1)	170 (6.7)	170 (6.7)	–	242 (9.5)
Width of mounting plate with 2 C options	B	150 (5.9)	150 (5.9)	190 (7.5)	190 (7.5)	–	242 (9.5)
Distance between mounting holes	b	70 (2.8)	70 (2.8)	110 (4.3)	110 (4.3)	171 (6.7)	215 (8.5)
<b>Depth [mm (in)]</b>							
Depth without option A/B	C	205 (8.1)	207 (8.1)	205 (8.1)	207 (8.1)	175 (6.9)	200 (7.9)
With option A/B	C	220 (8.7)	222 (8.7)	220 (8.7)	222 (8.7)	175 (6.9)	200 (7.9)
<b>Screw holes [mm (in)]</b>							
	c	8.0 (0.31)	8.0 (0.31)	8.0 (0.31)	8.0 (0.31)	8.25 (0.32)	8.25 (0.32)
	d	ø11 (ø0.43)	ø11 (ø0.43)	ø11 (ø0.43)	ø11 (ø0.43)	ø12 (ø0.47)	ø12 (ø0.47)
	e	ø5.5 (ø0.22)	ø5.5 (ø0.22)	ø5.5 (ø0.22)	ø5.5 (ø0.22)	ø6.5 (ø0.26)	ø6.5 (ø0.26)
	f	9 (0.35)	9 (0.35)	6.5 (0.26)	6.5 (0.26)	6 (0.24)	9 (0.35)
<b>Maximum weight [kg (lb)]</b>		4.9 (10.8)	5.3 (11.7)	6.6 (14.6)	7 (15.4)	9.7 (21.4)	13.5/14.2 (30/31)
<b>Front cover tightening torque [Nm (in-lb)]</b>							
Plastic cover (low IP)		Click		Click		–	–
Metal cover (IP55/66)		–		–		1.5 (13.3)	1.5 (13.3)

 1) See [Figure 25](#) and [Figure 26](#).

Table 40: Power Ratings, Weight, and Dimensions, Enclosure Size B

Enclosure size		B1	B2	B3	B4
Rated power [kW (hp)]	200–240 V	5.5–11 (7.5–15)	15 (20)	5.5–11 (7.5–15)	15–18 (20–24)
	380–480/500 V	11–18 (15–24)	22–30 (30–40)	11–18 (15–24)	22–37 (30–50)
	525–600 V	11–18 (15–24)	22–30 (30–40)	11–18 (15–24)	22–37 (30–50)
	525–690 V	–	11–30 (15–40)	–	11–37 (15–50)
Protection rating	–	IP21/55/66 (UL Type 1/12/4X)	IP21/55/66 (UL Type 1/12/4X)	IP20 (UL Open Type)	IP20 (UL Open Type)
<b>Height [mm (in)]</b>					
Height of mounting plate	A <sup>(1)</sup>	480 (18.9)	650 (25.6)	399 (15.7)	520 (20.5)
Height with ground termination plate for fieldbus cables	A	–	–	420 (16.5)	595 (23.4)
Distance between mounting holes	a	454 (17.9)	624 (24.6)	380 (15)	495 (19.5)
<b>Width [mm (in)]</b>					
Width of mounting plate	B	242 (9.5)	242 (9.5)	165 (6.5)	230 (9.1)
Width of mounting plate with 1 C option	B	242 (9.5)	242 (9.5)	205 (8.1)	230 (9.1)
Width of mounting plate with 2 C options	B	242 (9.5)	242 (9.5)	225 (8.9)	230 (9.1)
Distance between mounting holes	b	210 (8.3)	210 (8.3)	140 (5.5)	200 (7.9)
<b>Depth [mm (in)]</b>					
Depth without option A/B	C	260 (10.2)	260 (10.2)	249 (9.8)	242 (9.5)
With option A/B	C	260 (10.2)	260 (10.2)	262 (10.3)	242 (9.5)
<b>Screw holes [mm (in)]</b>					
	c	12 (0.47)	12 (0.47)	8 (0.31)	–
	d	∅19 (∅0.75)	∅19 (∅0.75)	12 (0.47)	–
	e	∅9 (∅0.35)	∅9 (∅0.35)	6.8 (0.27)	8.5 (0.33)
	f	9 (0.35)	9 (0.35)	7.9 (0.31)	15 (0.59)
<b>Maximum weight [kg (lb)]</b>		23 (51)	27 (60)	12 (26.5)	23.5 (52)
<b>Front cover tightening torque [Nm (in-lb)]</b>					
Plastic cover (low IP)		Click	Click	Click	Click
Metal cover (IP55/66)		2.2 (19.5)	2.2 (19.5)	–	–

 1) See [Figure 25](#) and [Figure 26](#).

Table 41: Power Ratings, Weight, and Dimensions, Enclosure Size C

Enclosure size		C1	C2	C3	C4
Rated power [kW (hp)]	200–240 V	18–30 (24–40)	37–45 (50–60)	22–30 (30–40)	37–45 (50–60)
	380–480/500 V	37–55 (50–75)	75–90 (100–125)	45–55 (60–75)	75–90 (100–125)
	525–600 V	37–55 (50–75)	75–90 (100–125)	45–55 (60–75)	75–90 (100–125)
	525–690 V	–	37–90 (50–125)	45–55 (60–75)	–
Protection rating	–	IP21/55/66 (UL Type 1/12/4X)	IP21/55/66 (UL Type 1/12/4X)	IP20 (UL Open Type)	IP20 (UL Open Type)
<b>Height [mm (in)]</b>					
Height of mounting plate	A <sup>(1)</sup>	680 (26.8)	770 (30.3)	550 (21.7)	660 (26)
Height with ground termination plate for fieldbus cables	A	–	–	630 (24.8)	800 (31.5)
Distance between mounting holes	a	648 (25.5)	739 (29.1)	521 (20.5)	631 (24.8)
<b>Width [mm (in)]</b>					
Width of mounting plate	B	308 (12.1)	370 (14.6)	308 (12.1)	370 (14.6)
Width of mounting plate with 1 C option	B	308 (12.1)	370 (14.6)	308 (12.1)	370 (14.6)
Width of mounting plate with 2 C options	B	308 (12.1)	370 (14.6)	308 (12.1)	370 (14.6)
Distance between mounting holes	b	272 (10.7)	334 (13.1)	270 (10.6)	330 (13)
<b>Depth [mm (in)]</b>					
Depth without option A/B	C	310 (12.2)	335 (13.2)	333 (13.1)	333 (13.1)
With option A/B	C	310 (12.2)	335 (13.2)	333 (13.1)	333 (13.1)
<b>Screw holes [mm (in)]</b>					
	c	12.5 (0.49)	12.5 (0.49)	–	–
	d	∅19 (∅0.75)	∅19 (∅0.75)	–	–
	e	∅9 (∅0.35)	∅9 (∅0.35)	8.5 (0.33)	8.5 (0.33)
	f	9.8 (0.39)	9.8 (0.39)	17 (0.67)	17 (0.67)
<b>Maximum weight [kg (lb)]</b>		45 (99)	65 (143)	35 (77)	50 (110)
<b>Front cover tightening torque [Nm (in-lb)]</b>					
Plastic cover (low IP)		Click	Click	2 (17.7)	2 (17.7)
Metal cover (IP55/66)		2.2 (19.5)	2.2 (19.5)	2 (17.7)	2 (17.7)

 1) See [Figure 25](#) and [Figure 26](#).

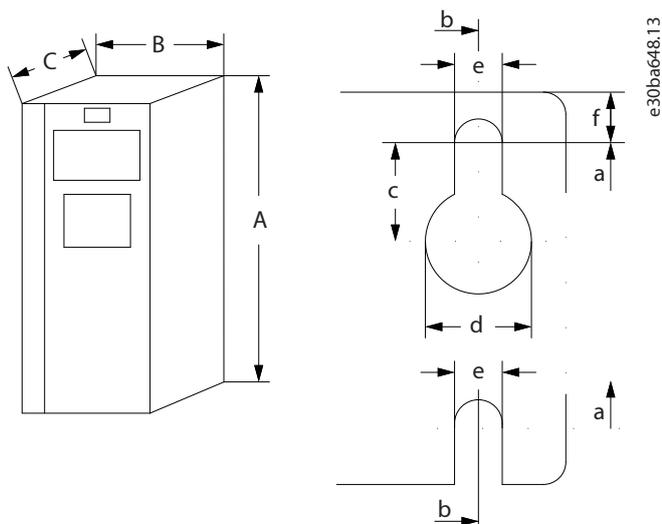


Figure 25: Top and Bottom Mounting Holes

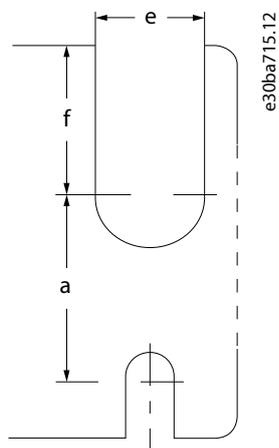


Figure 26: Top and Bottom Mounting Holes, Enclosure Sizes B4, C3, and C4

## 8 Mechanical Installation Considerations

### 8.1 Storage

Store the drive in a dry location and keep the equipment sealed in its packaging until installation. Periodic forming (capacitor charging) is not necessary during storage unless storage exceeds 12 months.

If shelf life is longer than 4 years, a simple method, under no load conditions, can be used to check the condition of the capacitors.

If the stable DC-link voltage is approximately equal to  $1.41 \times U_{\text{mains}}$ , the capacitors are OK. To check the DC-link voltage in the drive, either measure it or check the corresponding parameters in the display.

If the DC-link voltage is smaller than  $1.41 \times U_{\text{mains}}$ , it takes time for the capacitors to recover. If the DC-link voltage stays at a low level and does not reach approximately  $1.41 \times U_{\text{mains}}$ , contact the local service agent.

### 8.2 Operating Environment

In environments with airborne liquids, particles, or corrosive gases, ensure that the IP/Type rating of the equipment matches the installation environment. For environment specifications, see the *Ambient Conditions* section.

#### NOTICE

##### CONDENSATION

Moisture can condense on the electronic components and cause short circuits. Operating in standby mode reduces the risk of condensation as long as the power dissipation keeps the circuitry free of moisture.

- Avoid installation in areas subject to frost. Install an optional space heater when the drive is colder than the ambient air.

#### NOTICE

##### EXTREME AMBIENT CONDITIONS

Hot or cold temperatures compromise unit performance and longevity.

- Do not operate in environments where the ambient temperature exceeds 55 °C (131 °F).
- The drive can operate at temperatures down to -10 °C (14 °F). However, proper operation at rated load is only guaranteed at 0 °C (32 °F) or higher.
- If the temperature exceeds ambient temperature limits, extra air conditioning is required for the cabinet or installation site.

#### 8.2.1 Gases

Aggressive gases, such as hydrogen sulfide, chlorine, or ammonia can damage electrical and mechanical components of a drive. Contamination of the cooling air can also cause the gradual decomposition of PCB tracks and door seals. Aggressive contaminants are often present in sewage treatment plants or swimming pools. A clear sign of an aggressive atmosphere is corroded copper.

In aggressive atmospheres, restricted IP enclosures are recommended along with conformal-coated circuit boards.

#### NOTICE

The drive comes standard with class 3C2 coating. On request, class 3C3 coating is available.

Table 42: Conformal Coating Class Ratings

Gas type	Unit	Class				
		3C1	3C2		3C3	
		–	Average value	Maximum value <sup>(1)</sup>	Average value	Maximum value <sup>(1)</sup>
Sea salt	n/a	None	Salt mist		Salt mist	
Sulfur oxide	mg/m <sup>3</sup>	0.1	0.3	1.0	5.0	10
Hydrogen sulfide	mg/m <sup>3</sup>	0.01	0.1	0.5	3.0	10
Chlorine	mg/m <sup>3</sup>	0.0.1	0.1	0.03	0.3	1.0
Hydrogen chloride	mg/m <sup>3</sup>	0.01	0.1	0.5	1.0	5.0
Hydrogen fluoride	mg/m <sup>3</sup>	0.003	0.001	0.03	0.1	3.0
Ammonia	mg/m <sup>3</sup>	0.3	1.0	3.0	10	35
Ozone	mg/m <sup>3</sup>	0.01	0.05	0.1	0.1	0.3
Nitrogen	mg/m <sup>3</sup>	0.1	0.5	1.0	3.0	9.0

1) Maximum values are transient peak values and are not to exceed 30 minutes per day.

## 8.2.2 Dust

Installation of drives in environments with high dust exposure is often unavoidable. Dust affects wall or frame-mounted units with IP55/UL Type 12 or IP66/UL Type 4X protection rating and cabinet-mounted units with IP21/UL Type 1 or IP20/UL Open Type protection rating. Consider the following when installing drives in such environments:

- Reduced cooling.
- Cooling fans.
- Filters.
- Periodic maintenance.

### Reduced cooling

Dust forms deposits on the surface of the device and inside on the circuit boards and the electronic components. These deposits act as insulation layers and hamper heat transfer to the ambient air, reducing the cooling capacity. The components become warmer, which causes accelerated aging of the electronic components and the service life of the unit decreases. Dust deposits on the heat sink in the back of the unit also decrease the service life of the unit.

### Cooling fans

The airflow for cooling the unit is produced by cooling fans, usually on the back of the unit. The fan rotors have small bearings into which dust can penetrate and act as an abrasive, leading to bearing damage and fan failure.

### Filters

High-power drives are equipped with cooling fans that expel hot air from the interior of the unit. Above a certain size, these fans are fitted with filter mats. These filters can quickly become clogged when used in dusty environments. Preventive measures are necessary under these conditions.

## Periodic maintenance

Under the conditions described above, it is recommended to clean the drive during periodic maintenance. Remove dust from the heat sink and fans, and clean the filter mats.

### 8.2.3 Outdoor Installation in freezing Temperature Environments

#### NOTICE

##### LIMITATIONS

If the drive is used daily at low temperatures, lifetime of the mains disconnect switch can be reduced. If the advice in this section is not followed, the lifetime of the drive can be reduced.

- For cold starts at temperatures between -10 °C (14 °F) through -25 °C (-13 °F), it is recommended to let the drive run in idle for 30 minutes before loading it.
- LCP @-20 °C (-4 °F): After cold start, reasonable readability is typically reached after 5–10 s. Change of readout also takes 5–10 s.
- LCP @-25 °C (-13 °F): The LCP may have a weak readout at start-up. Normal readout is normally reached within 5 minutes. Change of readout takes 5–10 s
- ATEX: Approved down to -20 °C (-4 °F).
- Usage of option VLT® 24 V DC Supply Option MCB 107: Instability issues can be expected outside normal operating range for the drive (-10 °C (14 °F) to +45 °C/50 °C (113 °F/122 °F).
- For harsh environments such as salt mist, Danfoss recommends using IP66/UL Type 4X drive configuration.

Under certain circumstances, drives in IP55/66 and UL Type 3R/4X configuration can be used for outdoor installation down to -25 °C (77 °F).

To facilitate outdoor installation, it is critical to avoid condensing liquid inside the drive. This section outlines the conditions under which outdoor usage of the drive is allowed:

- Ensure the drive temperature by:
  - Keeping the drive powered on for temperatures below 0 °C (32 °F).
  - Keeping the drive running at maximum 50% load for minimum 10 minutes before increasing to full load for temperatures below -10 °C (14 °F).
- Shield the drive against direct sunlight, preferably by using the weather shield provided by Danfoss. The weather shield is designed to provide more protection of outdoor rated drives, when there is a risk of snow collecting on the top of the drive or excessive rain, which could subcool the drive, leading to internal condensation. The weather shield is made of corrosion resistant stainless steel AISI316 and is also suitable for installation in coastal areas and marine environments.
- Using DC hold keeps the temperature at a level where condensation does not form. This function can be activated in parameter **1–80 Function at Stop**. This selection makes sure that no condensation takes place in the drive as long as the drive is powered on. Furthermore, it keeps condensation out of the motor.
- **For temperatures from 0 °C (32 °F) to -10 °C (14 °F):** Set the fan control to a low-temperature environment setting in parameter **14–52 Fan Control** to switch off the heat sink fan and therefore the external fan. This selection adjusts the fan control to the cold environment, preventing the negative effect from further cooling and triggering a false alarm.
- **For temperatures below -20 °C:** Set the fan control to a low-temperature environment setting in parameter **14–52 Fan Control** to switch off the heat sink fan and therefore the external fan. This selection adjusts the fan control to the cold environment, avoiding

the negative effect from further cooling and triggering a false alarm. Disable parameter **14-53 Fan Monitor**. This selection also avoids warnings triggered falsely due to cold temperatures.

## 8.2.4 Potentially Explosive Atmospheres

### WARNING

#### EXPLOSIVE ATMOSPHERE

Installing the drive in a potentially explosive atmosphere can lead to death, personal injury, or property damage.

- Install the unit in a cabinet outside of the potentially explosive area.
- Use a motor with an appropriate ATEX protection class.
- Install a PTC temperature sensor to monitor the motor temperature.
- Install short motor cables.
- Use sine-wave output filters when shielded motor cables are not used.

As required by the EU Directive 2014/34/EU, any electrical or electronic device intended for use in an environment with a potentially explosive mixture of air, flammable gas, or dust must be ATEX-certified. Systems operated in this environment must fulfill the following special conditions to comply with the ATEX protection class:

- Class d specifies that if a spark occurs, it is contained in a protected area.
- Class e prohibits any occurrence of a spark.

#### Motors with class d protection

Does not require approval. Special wiring and containment are required.

#### Motors with class e or class n protection

When combined with an ATEX-approved PTC monitoring device like the VLT® PTC Thermistor Card MCB 112, installation does not need an individual approval from an approbated organization.

#### Motors with class d/e protection

The motor itself has an e ignition protection class, while the motor cabling and connection environment are in compliance with the d classification. To attenuate the high peak voltage, use a sine-wave filter at the drive output.

### NOTICE

#### MOTOR THERMISTOR SENSOR MONITORING

Units with the VLT® PTC Thermistor Card MCB 112 option are PTB-certified for potentially explosive atmospheres.

## 8.2.5 Vibration and Shock

The drive has been tested according to the procedure based on the following standards:

- EN/IEC 60068-2-6.
- EN/IEC 60068-2-34.
- EN/IEC 60068-2-35.
- EN/IEC 60068-2-36.

These tests subject the unit to 0.7 g forces over the range of 18–1000 Hz random in 3 directions for 2 hours. All Danfoss VLT® drives comply with requirements that correspond to these conditions when the unit is wall or floor mounted and when the unit is mounted within panels bolted to walls or to floors.

## 8.3 Maintenance Considerations

### 8.3.1 DrivePro® Preventive Maintenance

Generally, all technical equipment, including AC drives, need a minimum level of preventive maintenance. To ensure trouble-free operation and long life of the drive, regular maintenance is recommended. Under specific conditions, the combination of stressful operation and environmental conditions work together to reduce the lifetime of the components significantly. These conditions can include, for example, extreme temperature, dust, high humidity, hours of use, corrosive environment, and loading.

For operation in stressful conditions, offers the DrivePro® Preventive Maintenance service. DrivePro® services extend the lifetime and increase the performance of the product with scheduled maintenance including customized part replacements. DrivePro® services are tailored to the specific application and operating conditions. For more information, see [DrivePro Services \(danfoss.com\)](https://danfoss.com/DrivePro)

To maintain optimal performance and longevity of a drive, refer to the *Maintenance* chapter in the operating guide for a comprehensive maintenance/inspection schedule.

### 8.3.2 Service Access

When planning the installation, proper access for service and maintenance needs must be considered. In general, it is recommended to ensure:

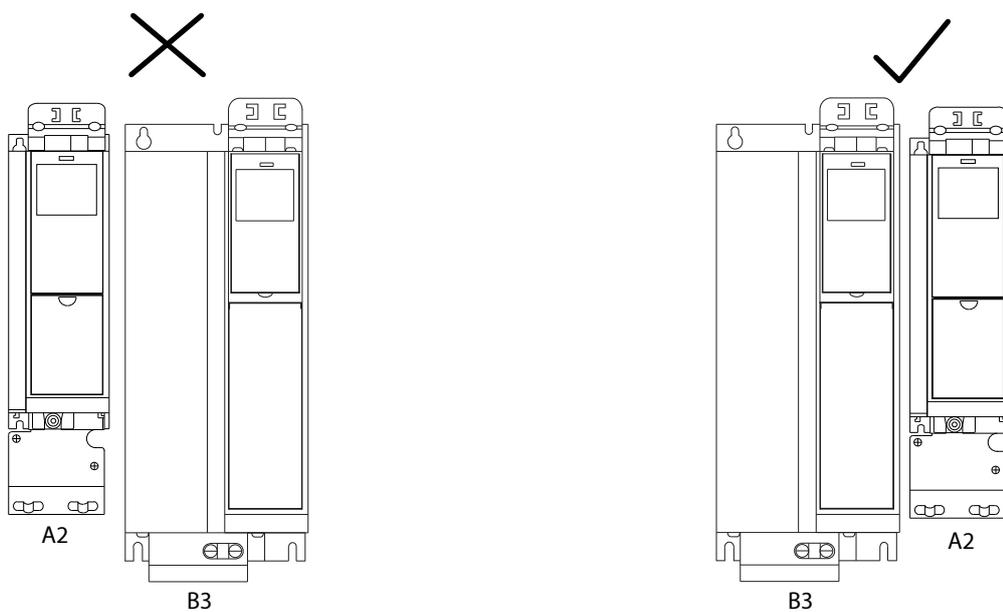
- Access to power cabling and connectors.
- Access to control wiring.
- Access to clean the cooling channel and fan filters (if applicable).
- Access to the port to connect the drive to a PC.

## 8.4 Drive Placement

### 8.4.1 Side-by-side Mounting


All enclosure sizes allow side-by-side installation except when an IP21, UL Type 1, or UL Type 4X enclosure is used.

IP21/UL Type 1 A and B enclosures can be arranged side by side with no clearance required between them. However, the mounting order is important.



e30bd389.11

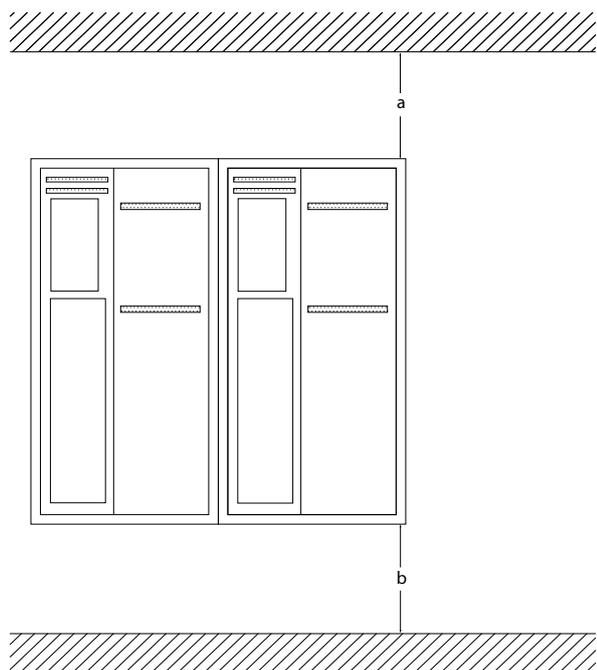Figure 27: Correct Side-by-side Mounting



e30ba419.10

Figure 28: Clearance

Table 43: Air Passage for Different Enclosure Sizes

Enclosure size	A2, A3, A4, A5, B1	B2, B3, B4, C1, C3	C2, C4
a [mm (in)]	100 (3.9)	200 (7.9)	225 (8.9)
b [mm (in)]	100 (3.9)	200 (7.9)	225 (8.9)

## 8.4.2 Wall Mounting

If the drive is to be mounted on a non-solid back wall, provide the drive with a mounting plate due to insufficient cooling air over the heat sink.

### NOTICE

The mounting plate is only relevant for enclosure sizes A4, A5, B1, B2, C1, and C2.

## 8.5 Derating

### 8.5.1 Derating for Running at Low Speed

When a motor is connected to a drive, it is necessary to ensure that the cooling of the motor is adequate.

The level of heating depends on the load on the motor, the operating speed, and time.

#### Constant torque applications (CT mode)

A problem may occur at low RPM values in constant torque applications. In a constant torque application, a motor may overheat at low speeds due to less cooling air from the motor integral fan.

Therefore, if the motor is to be run continuously at an RPM value lower than half of the rated value, the motor must be supplied with extra air cooling (or a motor designed for this type of operation may be used).

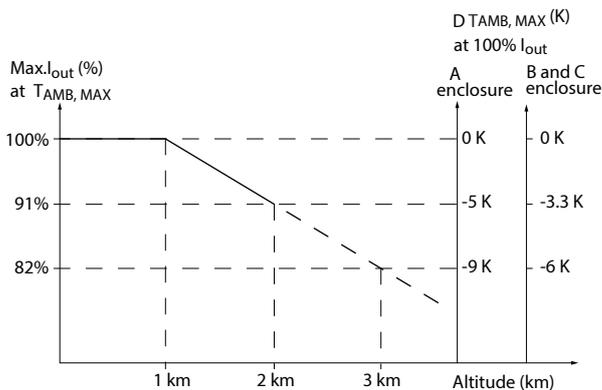
Alternatively, reduce the load level of the motor by selecting a larger motor. However, the design of the drive limits the motor size.

#### Variable (quadratic) torque applications (VT)

In VT applications such as centrifugal pumps and fans, where the torque is proportional to the square of the speed and the power is proportional to the cube of the speed, there is no need for extra cooling or derating of the motor.

### 8.5.2 Derating for Low Air Pressure


The cooling capability of air is decreased at lower air pressure.



e30ba418.11

Figure 29: Derating of Output Current Versus Altitude at  $T_{AMB, MAX}$  for Enclosure Sizes A, B, and C

Below 1000 m (3280 ft) altitude, no derating is necessary. Above 1000 m (3280 ft), the ambient temperature ( $T_{AMB}$ ) or maximum output current ( $I_{out}$ ) should be derated in accordance with the diagram.

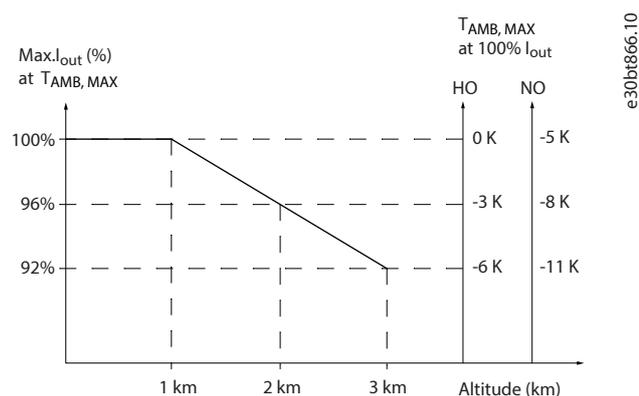
 Figure 30: Derating of Output Current Based on Altitude at  $T_{AMB,MAX}$ 


At altitudes above 2000 m (6561 ft), contact Danfoss regarding PELV.

Alternatively, lower the ambient temperature at high altitudes and thereby ensure 100% output current at high altitudes. As an example of how to read the graph, the situation at 2000 m (6561 ft) is elaborated for an enclosure size B with  $T_{AMB,MAX} = 50\text{ °C}$  (122 °F). Either the output current has to be reduced to 91% at  $T_{AMB,MAX}$ , or the maximum temperature has to be reduced by 3.3 K at 100%  $I_{out}$ . This means that 100% of the rated output current is available at 41.7 °C (107 °F) continuous and 46.7 °C (116 °F) intermittent.


### 8.5.3 Derating for Ambient Temperature and Switching Frequency

#### 8.5.3.1 Derating for Ambient Temperature, Enclosure Size A

##### 60° AVM - Pulse width modulation

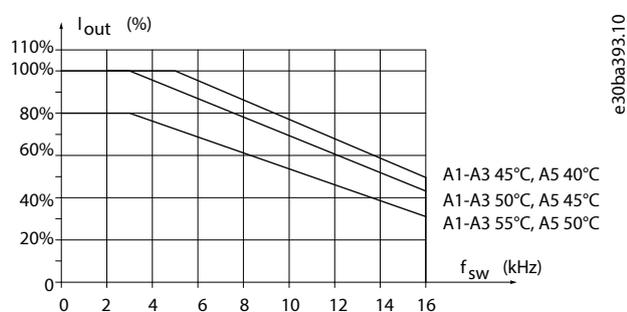
 Figure 31: Derating of  $I_{out}$  for Different  $T_{AMB,MAX}$  for Enclosure Size A, using 60° AVM

##### SFAVM - Stator frequency asynchronous vector modulation

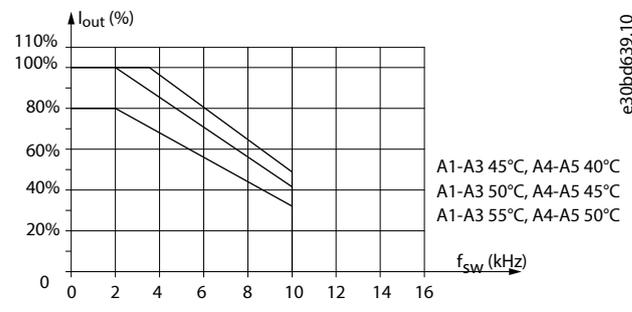
 Figure 32: Derating of  $I_{out}$  for Different  $T_{AMB,MAX}$  for Enclosure Size A, using SFAVM

When using only 10 m (32.8 ft) motor cable or less in enclosure size A, less derating is necessary. The length of the motor cable has a relatively high impact on the recommended derating.

60° AVM - Pulse width modulation

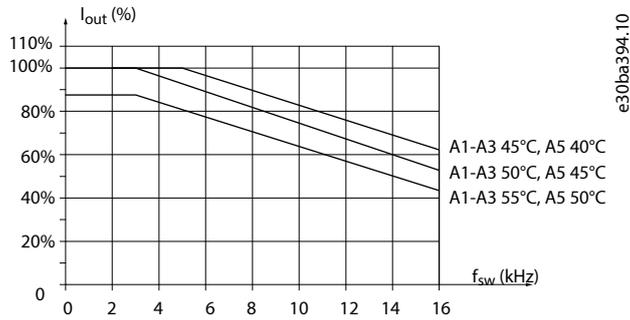


Figure 33: Derating of  $I_{out}$  for Different  $T_{AMB,MAX}$  for Enclosure Size A, using 60° AVM and maximum 10 m (32.8 ft) motor cable

SFAVM - Stator frequency asynchronous vector modulation

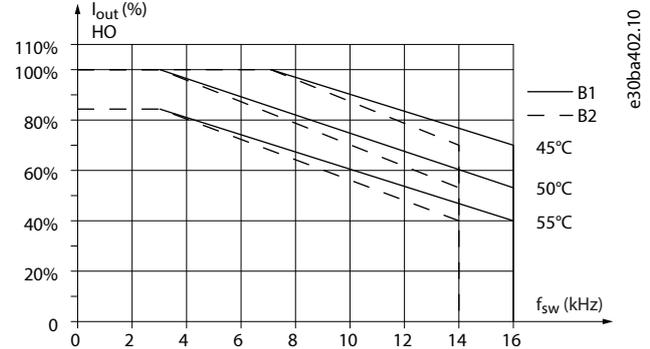


Figure 34: Derating of  $I_{out}$  for Different T for Enclosure Size A, using SFAVM and maximum 10 m (32.8 ft) motor cable

8.5.3.2 Derating for Ambient Temperature, Enclosure Size B

Enclosure Size B - T2, T4, and T5

For enclosure sizes B and C, the derating also depends on the overload mode selected in *parameter 1-04 Overload Mode*.

60° AVM - Pulse width modulation, high overload (160%)

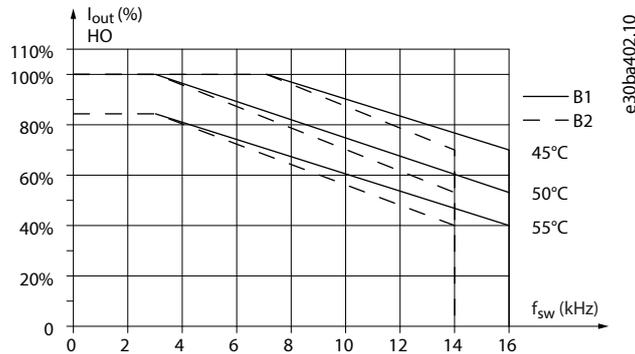


Figure 35: Derating of  $I_{out}$  for Different  $T_{AMB,MAX}$  for Enclosure Sizes B1 and B2, using 60° AVM

60° AVM - Pulse width modulation, normal overload (110%)

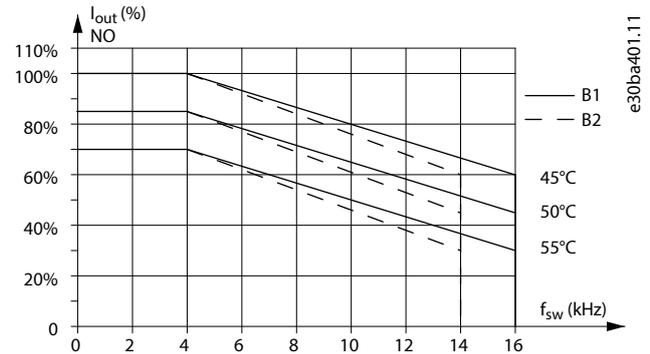


Figure 36: Derating of  $I_{out}$  for Different  $T_{AMB,MAX}$  for Enclosure Sizes B1 and B2, using 60° AVM

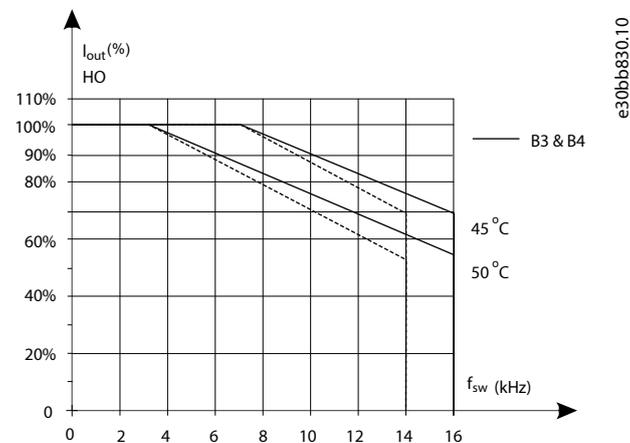


Figure 37: Derating of  $I_{out}$  for Different  $T_{AMB,MAX}$  for Enclosure Sizes B3 and B4, using 60° AVM

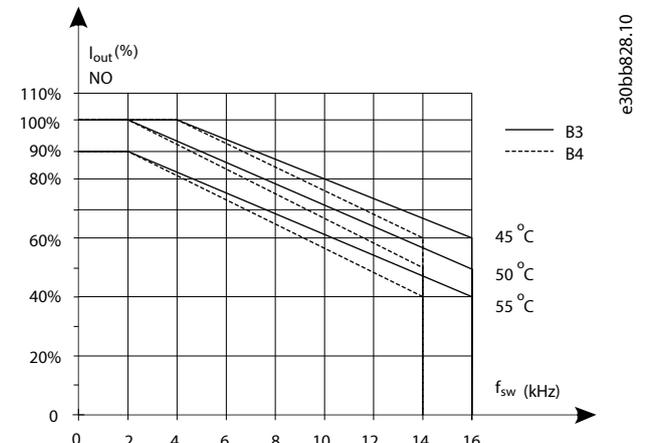
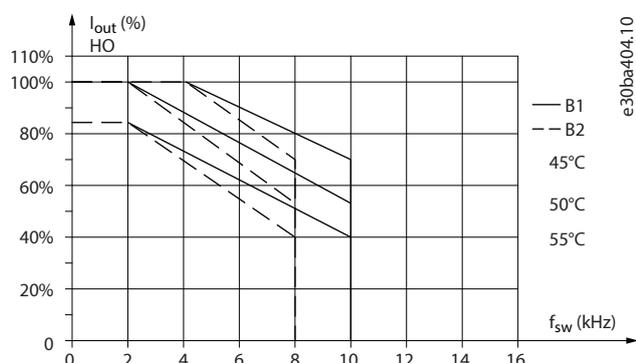
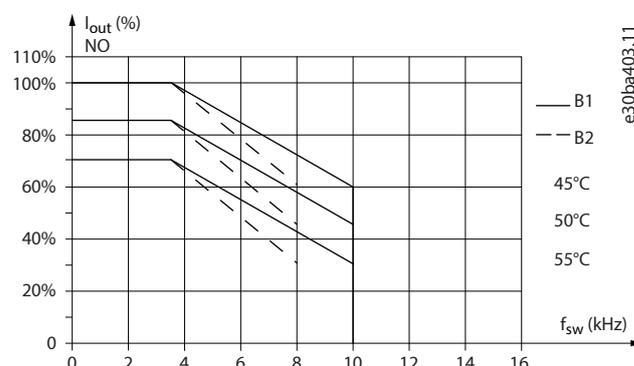
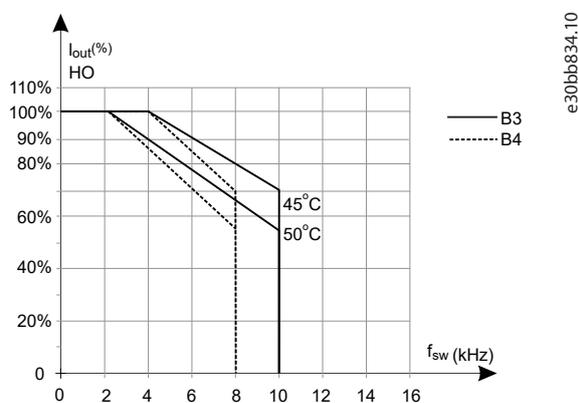
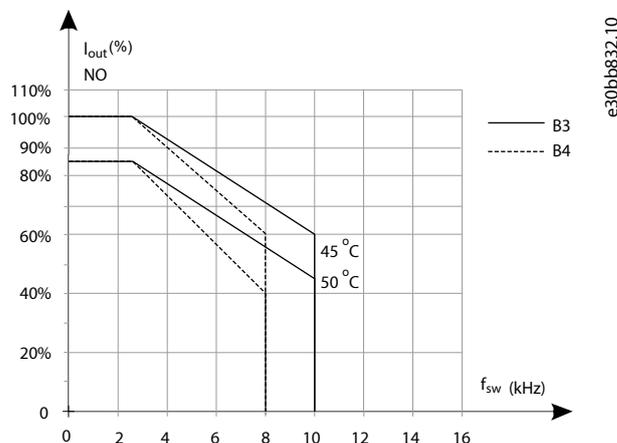
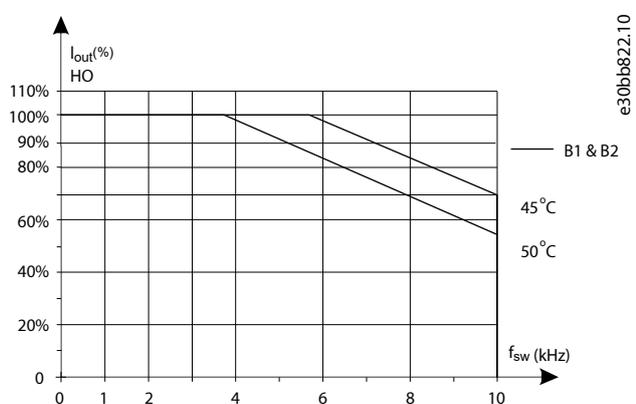
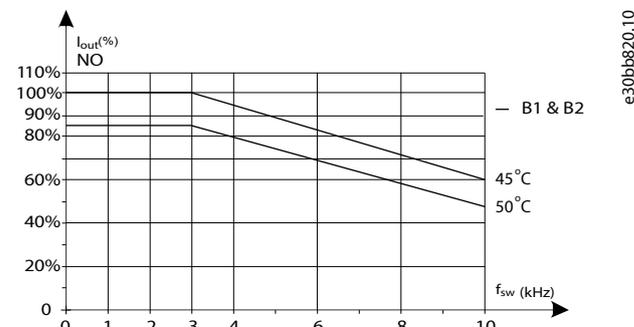
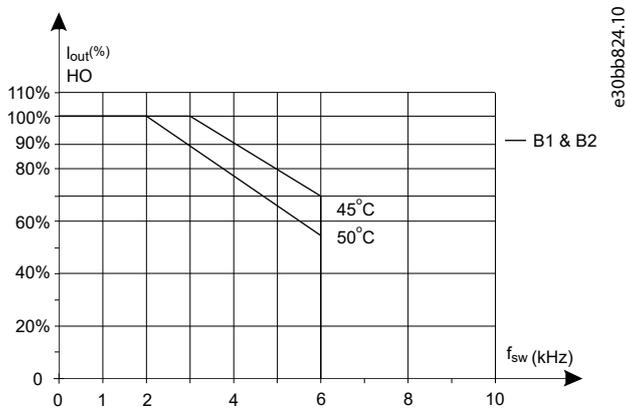


Figure 38: Derating of  $I_{out}$  for Different  $T_{AMB,MAX}$  for Enclosure Sizes B3 and B4, using 60° AVM

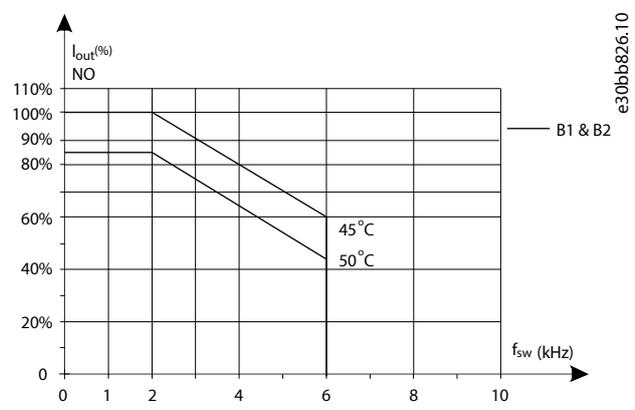
**SFAVM - Stator frequency asynchronous vector modulation, high overload (160%)**

**Figure 39: Derating of  $I_{out}$  for Different  $T_{AMB,MAX}$  for Enclosure Sizes B1 and B2, using SFAVM**
**SFAVM - Stator frequency asynchronous vector modulation, normal overload (110%)**

**Figure 40: Derating of  $I_{out}$  for Different  $T_{AMB,MAX}$  for Enclosure Sizes B1 and B2, using SFAVM**

**Figure 41: Derating of  $I_{out}$  for Different  $T_{AMB,MAX}$  for Enclosure Sizes B3 and B4, using SFAVM**

**Figure 42: Derating of  $I_{out}$  for Different  $T_{AMB,MAX}$  for Enclosure Sizes B3 and B4, using SFAVM**
**Enclosure Size B - T6**
**60° AVM - Pulse width modulation, high overload (160%)**

**Figure 43: Output Current Derating with Switching Frequency and Ambient Temperature for 600 V drives, for Enclosure Size B, using 60° AVM**
**60° AVM - Pulse width modulation, normal overload (110%)**

**Figure 44: Output Current Derating with Switching Frequency and Ambient Temperature for 600 V drives, for Enclosure Size B, using 60° AVM**

**SFAVM - Stator frequency asynchronous vector modulation, high overload (160%)**

**SFAVM - Stator frequency asynchronous vector modulation, normal overload (110%)**



**Figure 45: Output Current Derating with Switching Frequency and Ambient Temperature for 600 V Drives, Enclosure Size B; SFAVM**



**Figure 46: Output Current Derating with Switching Frequency and Ambient Temperature for 600 V Drives, Enclosure Size B; SFAVM**


**Enclosure Sizes B2 and B4, 525–690 V - T7**

**NOTICE**


The curves are drawn with the current as absolute value and are valid for both high and normal overload.

**60° AVM - Pulse width modulation**

**SFAVM - Stator frequency asynchronous vector modulation**

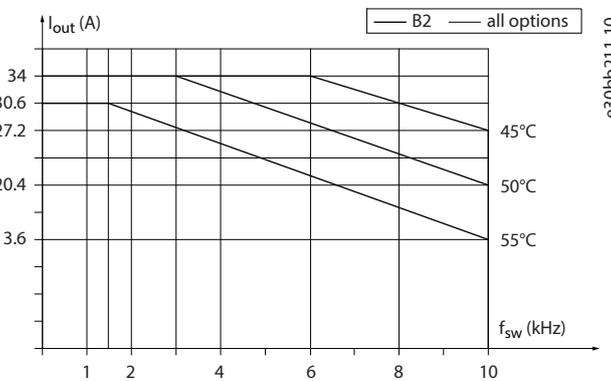

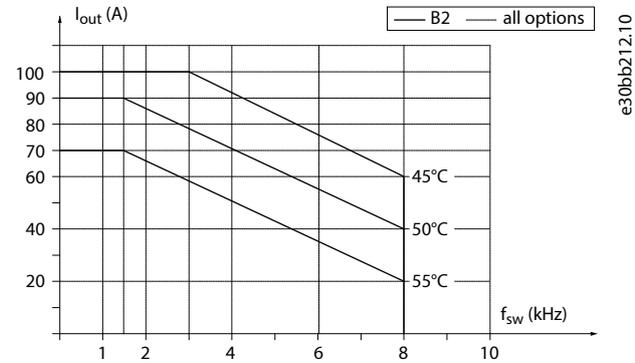**Figure 47: Output Current Derating with Switching Frequency and Ambient Temperature for Enclosure Sizes B2 and B4, using 60° AVM**

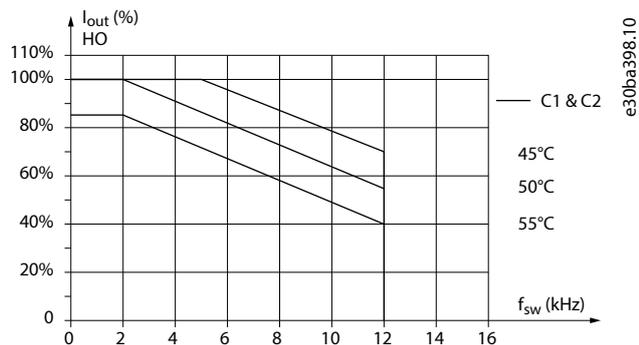


**Figure 48: Output Current Derating with Switching Frequency and Ambient Temperature for Enclosure Sizes B2 and B4, using SFAVM**

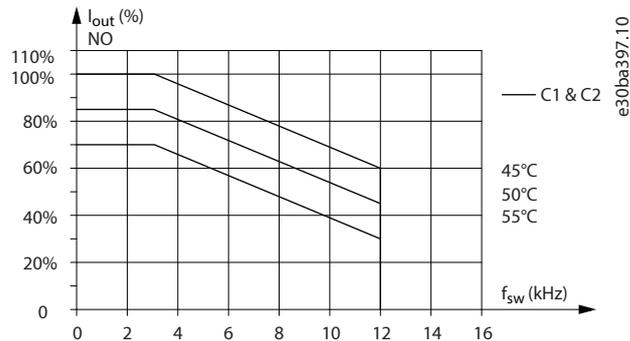
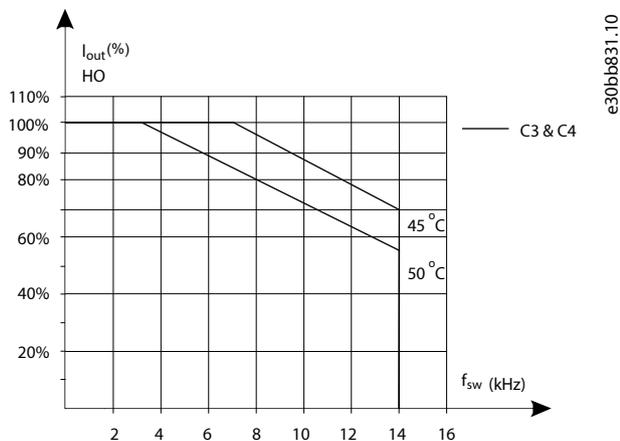
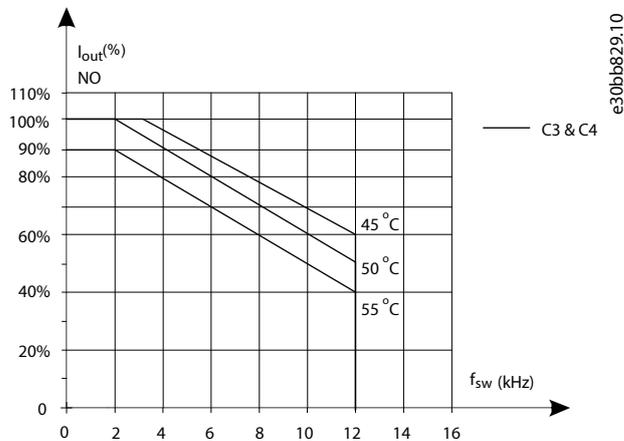
**8.5.3.3 Derating for Ambient Temperature, Enclosure Size C**

**Enclosure Size C - T2, T4, and T5**

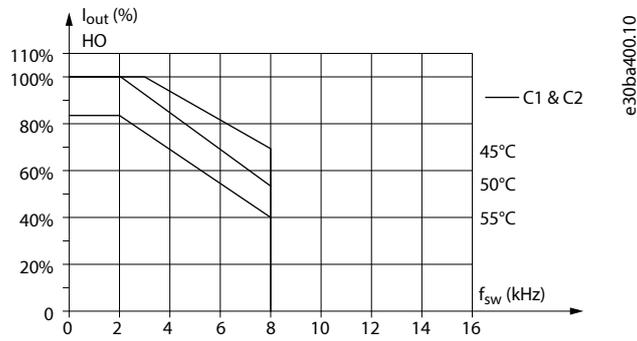
60° AVM - Pulse width modulation, high overload (160%)


 Figure 49: Derating of  $I_{out}$  for Different  $T_{AMB,MAX}$  for Enclosure Sizes C1 and C2, using 60° AVM

60° AVM - Pulse width modulation, normal overload (110%)

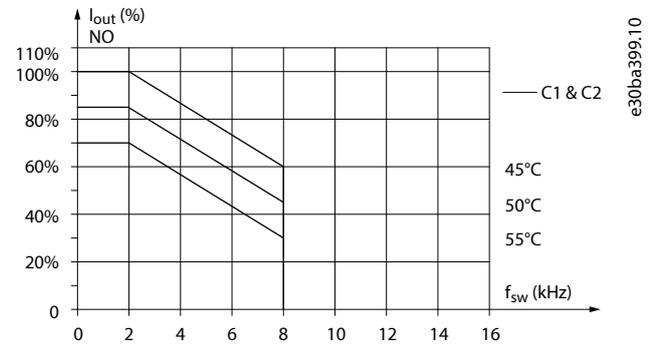

 Figure 50: Derating of  $I_{out}$  for Different  $T_{AMB,MAX}$  for Enclosure Sizes C1 and C2, using 60° AVM

 Figure 51: Derating of  $I_{out}$  for Different  $T_{AMB,MAX}$  for Enclosure Sizes C3 and C4, using 60° AVM

 Figure 52: Derating of  $I_{out}$  for Different  $T_{AMB,MAX}$  for Enclosure Sizes C3 and C4, using 60° AVM

**SFAVM - Stator frequency asynchronous vector modulation, high overload (160%)**

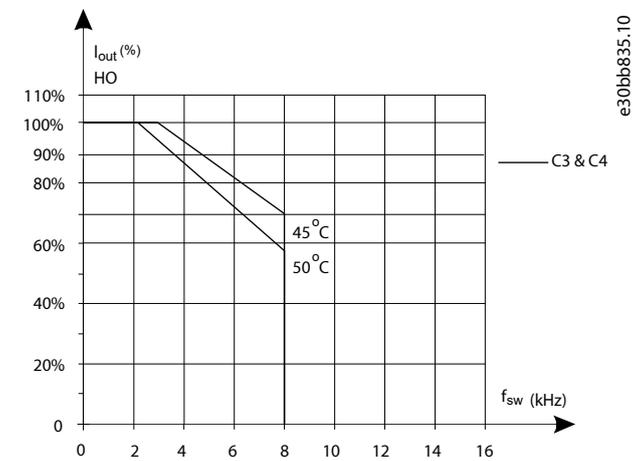


**Figure 53: Derating of  $I_{out}$  for Different  $T_{AMB,MAX}$  for Enclosure Sizes C1 and C2, using SFAVM**


**SFAVM - Stator frequency asynchronous vector modulation, normal overload (110%)**



**Figure 54: Derating of  $I_{out}$  for Different  $T_{AMB,MAX}$  for Enclosure Sizes C1 and C2, using SFAVM**




**Figure 55: Derating of  $I_{out}$  for Different  $T_{AMB,MAX}$  for Enclosure Sizes C3 and C4, using SFAVM**

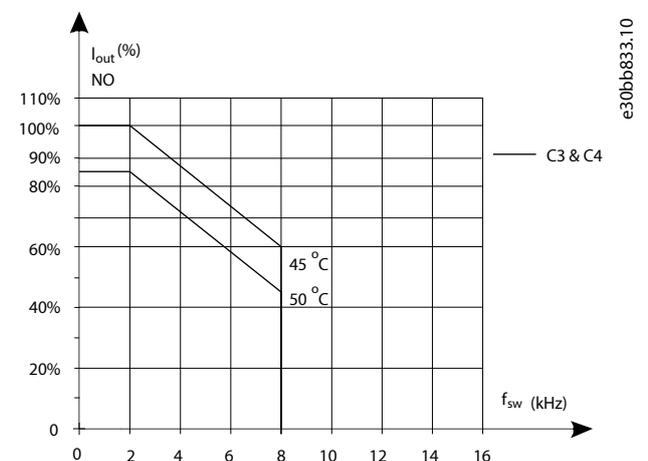

**Figure 56: Derating of  $I_{out}$  for Different  $T_{AMB,MAX}$  for Enclosure Sizes C3 and C4, using SFAVM**

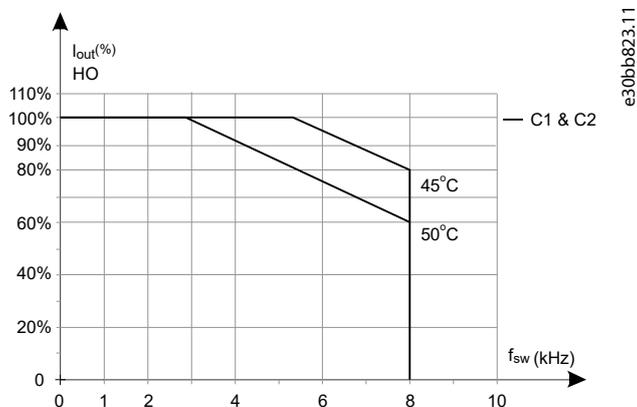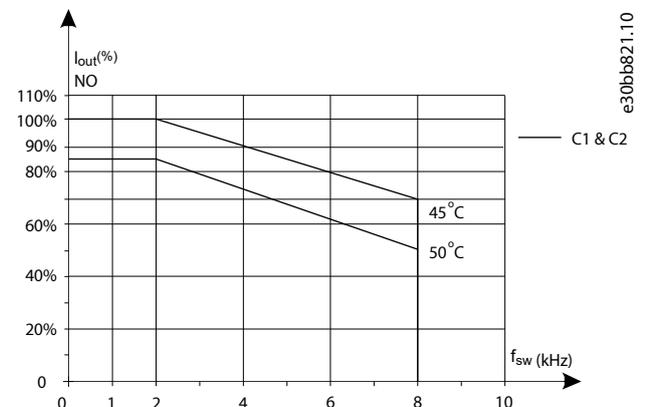
**Enclosure Size C - T6**

**60° AVM - Pulse width modulation, high overload (160%)**

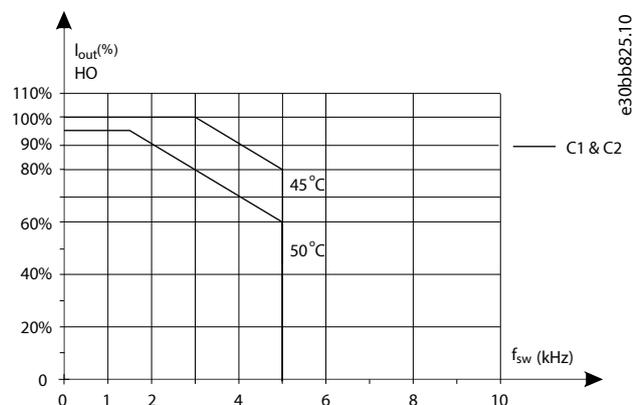
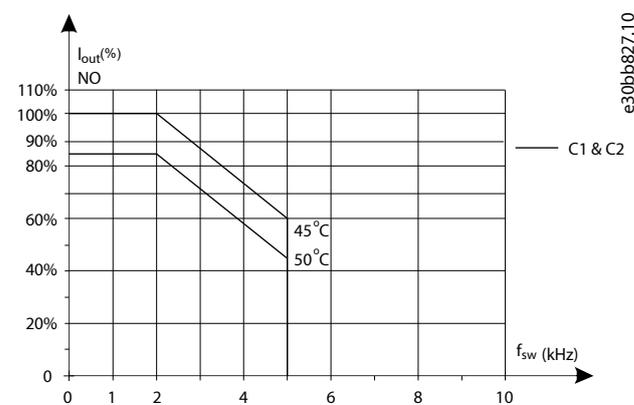


**Figure 57: Output Current Derating with Switching Frequency and Ambient Temperature for 600 V Drives, for Enclosure Size C, using 60° AVM**

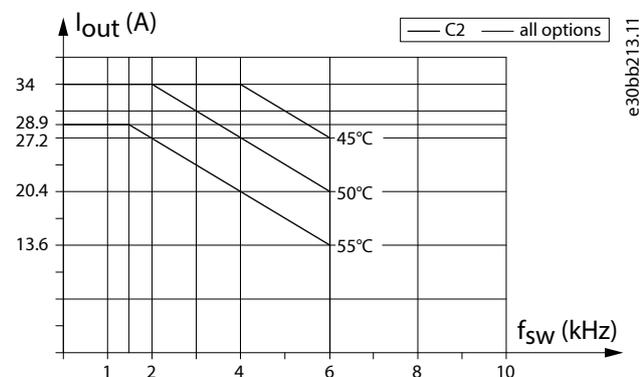
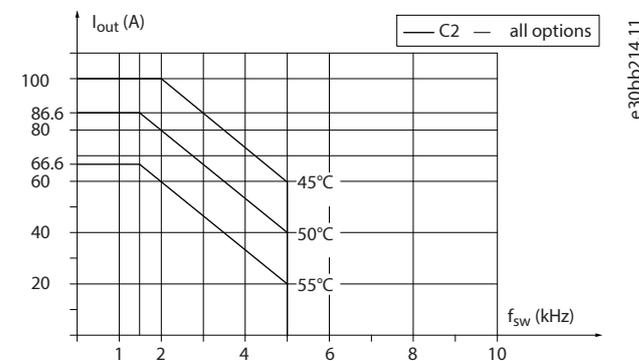
**60° AVM - Pulse width modulation, normal overload (110%)**



**Figure 58: Output Current Derating with Switching Frequency and Ambient Temperature for 600 V Drives, for Enclosure Size C, using 60° AVM**

**SFAVM - Stator frequency asynchronous vector modulation, high overload (160%)**

**Figure 59: Output Current Derating with Switching Frequency and Ambient Temperature for 600 V Drives, Enclosure Size C; SFAVM**
**SFAVM - Stator frequency asynchronous vector modulation, normal overload (110%)**

**Figure 60: Output Current Derating with Switching Frequency and Ambient Temperature for 600 V Drives, Enclosure Size C; SFAVM**
**Enclosure Size C2 and C3 - T7**
**NOTICE**

The curves are drawn with the current as absolute value and are valid for both high and normal overload.

**60° AVM - Pulse width modulation**

**Figure 61: Output Current Derating with Switching Frequency and Ambient Temperature for Enclosure Size C2, using 60° AVM**
**SFAVM - Stator frequency asynchronous vector modulation**

**Figure 62: Output Current Derating with Switching Frequency and Ambient Temperature for Enclosure Size C2, using SFAVM**

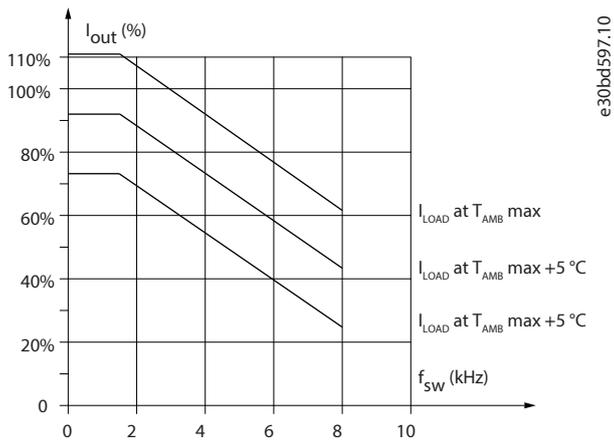


Figure 63: Output Current Derating with Switching Frequency and Ambient Temperature for Enclosure Size C3

## 9 Electrical Installation Considerations

### 9.1 Safety Instructions

#### WARNING



##### INDUCED VOLTAGE

Induced voltage from output motor cables that run together can charge equipment capacitors, even with the equipment turned off and locked out. Failure to run output motor cables separately or to use shielded cables could result in death or serious injury.

- Run output motor cables separately or use shielded cables.
- Simultaneously lock out all the drives.

#### WARNING



##### SHOCK HAZARD

The unit can cause a DC current in the PE conductor. Failure to use a Type B residual current-operated protective device (RCD) may lead to the RCD not providing the intended protection and therefore may result in death or serious injury.

- When an RCD is used for protection against electric shock, only a Type B device is allowed on the supply side.

#### WARNING



##### LEAKAGE CURRENT HAZARD

Leakage currents exceed 3.5 mA. Failure to ground the drive properly can result in death or serious injury.

- Ensure the correct grounding of the equipment by a certified electrical installer.

#### For electrical safety

According to the standard EN 61800-5-1, 1 or more of these conditions for the protective circuit must be true. The connection must be fixed.

- The protective earthing conductor must have a cross-sectional area of minimum 10 mm<sup>2</sup> (8 AWG) Cu or 16 mm<sup>2</sup> (6 AWG), OR
- There must be an automatic disconnection of the mains if the protective earthing conductor breaks, OR
- There must be a terminal for a 2nd protective earthing conductor in the same cross-sectional area as the 1st protective earthing conductor.

Cross-sectional area of the phase conductors (S) [mm <sup>2</sup> (AWG)]	The minimum cross-sectional area of the protective earthing conductor in question [mm <sup>2</sup> (AWG)]
S ≤ 16 (6)	S
16 (6) < S ≤ 35 (2)	16 (6)
35 (2) < S	S/2

The values of the table are only valid if the protective earthing conductor is made of the same metal as the phase conductors. If not, the cross-sectional area of the protective earthing conductor must be determined in a manner that produces a conductance equivalent to that which results from the calculations in the table.

The cross-sectional area of each protective earthing conductor that is not a part of the mains cable or the cable enclosure must be a minimum of:

- 25 mm<sup>2</sup> (14 AWG) if there is mechanical protection, AND
- 4 mm<sup>2</sup> (12 AWG) if there is no mechanical protection. With cord-connected equipment, ensure that the protective earthing conductor in the cord is the last conductor to be interrupted if the strain relief mechanism breaks.

Adhere to the local regulations on the minimum size of the protective earthing conductor.

Further instructions for electrical safety:

- Ground the drive in accordance with applicable standards and directives.
- Use a dedicated ground wire for input power, motor power, and control wiring.
- Do not ground 1 drive to another in a daisy-chain fashion.
- Keep the ground wire connections as short as possible.
- Follow the wiring requirements from the motor manufacturer.

#### For EMC-compliant installation

- Establish electrical contact between cable shield and drive enclosure by using metal grommets or by using the clamps provided on the equipment.
- Use high-strand wire to reduce burst transient.
- Do not use pigtails.

### NOTICE

#### POTENTIAL EQUALIZATION

Risk of burst transient when the ground potential between the drive and the control system is different.

- Install equalizing cables between the system components. Recommended cable cross-section: 16 mm<sup>2</sup> (6 AWG).

Overcurrent protection:

- Extra protection equipment such as short circuit protection or motor thermal protection between drive and motor are required for applications with multiple motors.
- Input fusing is required to provide short-circuit and overcurrent protection. If fuses are not factory-supplied, the installer must provide them. See maximum fuse ratings in [9.5.1 Fuse Recommendations](#).

Wire type and ratings:

- All wiring must comply with local and national regulations regarding cross-section and ambient temperature requirements.
- Power connection wire recommendation: Minimum 75 °C (167 °F) rated copper wire.

## 9.2 Wiring Diagram

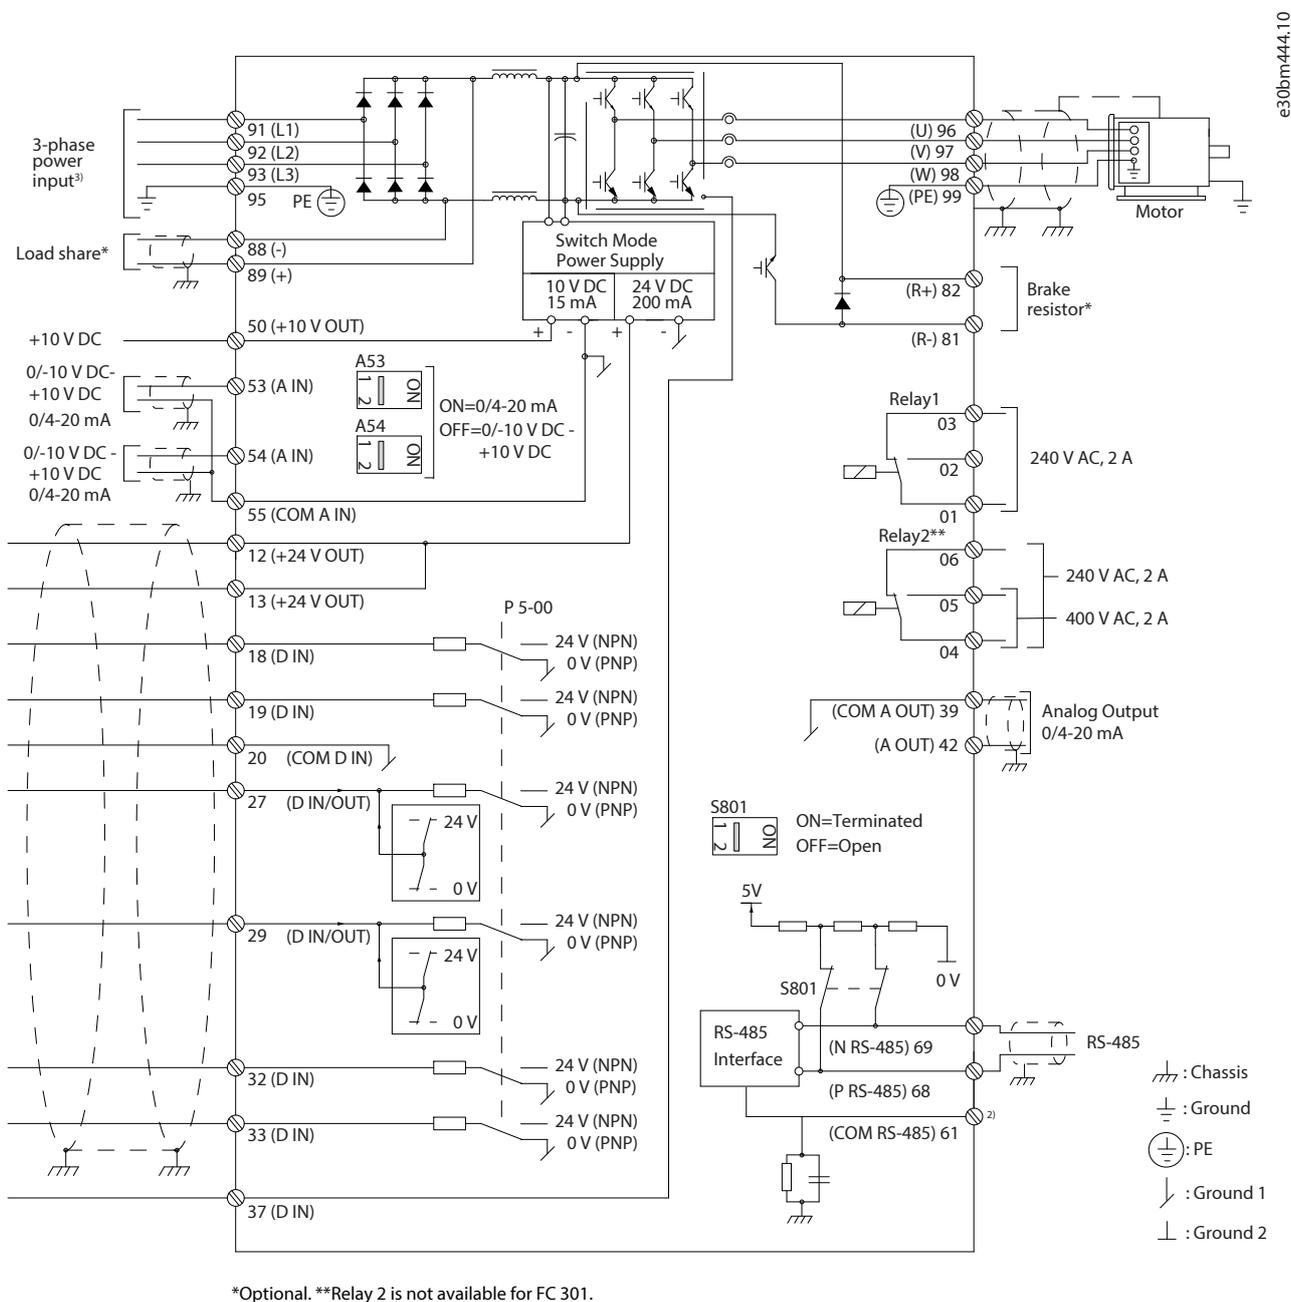


Figure 64: Basic Wiring Schematic

- 1 Terminal 37 (optional) is used for Safe Torque Off. For Safe Torque Off installation instructions, refer to the *Safe Torque Off Operating Guide*.

## 9.3 Cables

### 9.3.1 EMC-correct Cables

To optimize EMC immunity of the control cables and emission from the motor cables, use braided shielded/armored cables.

The ability of a cable to reduce the in- and outgoing radiation of electric noise depends on the transfer impedance ( $Z_T$ ). The shield of a cable is normally designed to reduce the transfer of electric noise. However, a shield with a lower transfer impedance ( $Z_T$ ) value is more effective than a shield with a higher transfer impedance ( $Z_T$ ).

Cable manufacturers rarely state the transfer impedance ( $Z_T$ ), but it is often possible to estimate transfer impedance ( $Z_T$ ) by assessing the physical design of the cable.

Transfer impedance ( $Z_T$ ) can be assessed based on the following factors:

- The conductivity of the shield material.
- The contact resistance between the individual shield conductors.
- The shield coverage, that is, the physical area of the cable covered by the shield is often stated as a percentage value.
- Shield type (braided or twisted).

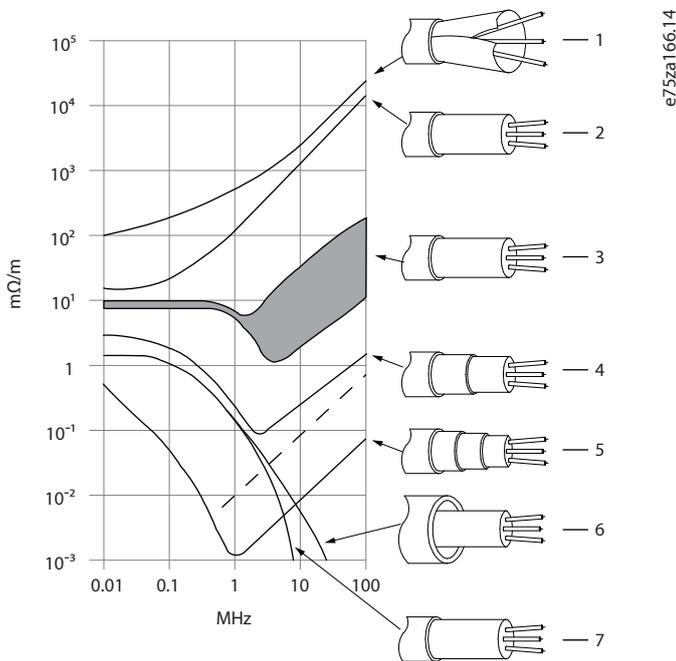


Figure 65: Transfer Impedance ( $Z_T$ )

1	Aluminum-clad with copper wire.	2	Twisted copper wire or armored steel wire cable.
3	Single-layer braided copper wire with varying percentage shield coverage. This is the typical reference cable.	4	Double-layer braided copper wire.
5	Twin layer of braided copper wire with a magnetic, shielded/armored intermediate layer.	6	Cable that runs in a copper tube or steel tube.
7	Lead cable with 1.1 mm (0.04 in) wall thickness.		

### 9.3.2 Preparing Cable Entry Holes

#### Procedure


1. Remove the cable entry from the drive. Avoid that foreign parts fall into the drive when removing the knockouts.
2. Support the cable entry where the knockout is to be removed.
3. Remove the knockout with a strong mandrel and a hammer.
4. Remove burrs from the hole.

- Mount the cable entry on the drive.

### 9.3.3 Specifications of Entry Holes

The suggested uses of the holes are recommendations, but other solutions are possible. Unused cable entry holes can be sealed with rubber grommets (for IP21/UL Type 1).

#### 9.3.3.1 Entry Holes, Enclosure Size A2, IP21/UL Type 1




e30bb656.10

Table 44: Dimensions of Entry Holes for Enclosure Size A2, IP21/UL Type 1

Hole number and recommended use	Dimensions <sup>(1)</sup>		Nearest metric
	UL [in]	[mm]	
1) Mains	3/4	28.4	M25
2) Motor	3/4	28.4	M25
3) Brake/loadsharing	3/4	28.4	M25
4) Control cable	1/2	22.5	M20
5) Control cable	1/2	22.5	M20

1) Tolerance  $\pm 0.2$  mm.

#### 9.3.3.2 Entry Holes, Enclosure Size A3, IP21/UL Type 1

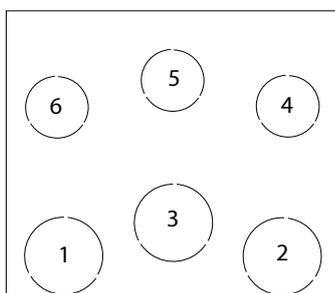

e30bb657.10

Table 45: Dimensions of Entry Holes for Enclosure Size A3, IP21/UL Type 1


Hole number and recommended use	Dimensions <sup>(1)</sup>		Nearest metric
	UL [in]	[mm]	
1) Mains	3/4	28.4	M25
2) Motor	3/4	28.4	M25

Table 45: Dimensions of Entry Holes for Enclosure Size A3, IP21/UL Type 1 - (continued)

Hole number and recommended use	Dimensions <sup>(1)</sup>		Nearest metric
	UL [in]	[mm]	
3) Brake/loadsharing	3/4	28.4	M25
4) Control cable	1/2	22.5	M20
5) Control cable	1/2	22.5	M20
6) Control cable	1/2	22.5	M20

1) Tolerance ±0.2 mm.

### 9.3.3.3 Entry Holes, Enclosure Size A4, IP55/UL Type 12

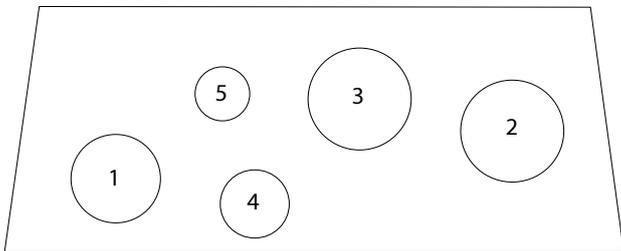


e30bb663.10

Table 46: Dimensions of Entry Holes for Enclosure Size A4, IP55/UL Type 12

Hole number and recommended use	Dimensions <sup>(1)</sup>		Nearest metric
	UL [in]	[mm]	
1) Mains	3/4	28.4	M25
2) Motor	3/4	28.4	M25
3) Brake/loadsharing	3/4	28.4	M25
4) Control cable	1/2	22.5	M20
5) Removed	-	-	-

1) Tolerance ±0.2 mm.

### 9.3.3.4 Entry Holes, Enclosure Size A4, IP55/UL Type 12 Threaded Gland Holes

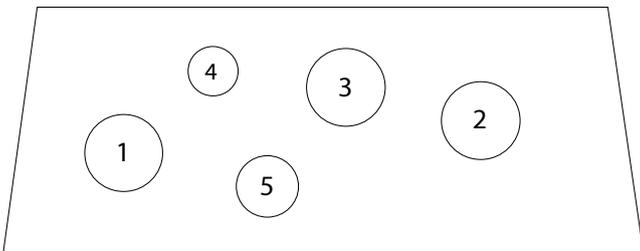


e30bb665.10

**Table 47: Dimensions of Entry Holes for Enclosure Size A4, IP55/UL Type 12 Threaded Gland Holes**

Hole number and recommended use	Nearest metric
1) Mains	M25
2) Motor	M25
3) Brake/loadsharing	M25
4) Control cable	M16
5) Control cable	M20
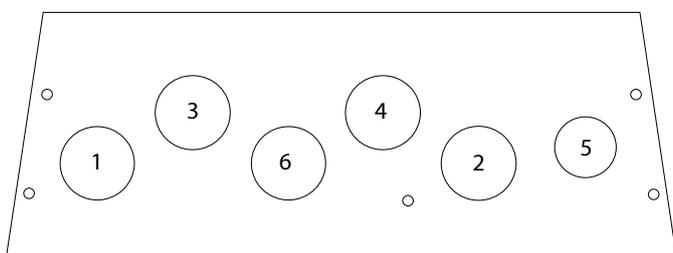
### 9.3.3.5 Entry Holes, Enclosure Size A5, IP55/UL Type 12



e:30bb664.10


**Table 48: Dimensions of Entry Holes for Enclosure Size A5, IP55/UL Type 12**

Hole number and recommended use	Dimensions <sup>(1)</sup>		Nearest metric
	UL [in]	[mm]	
1) Mains	3/4	28.4	M25
2) Motor	3/4	28.4	M25
3) Brake/loadsharing	3/4	28.4	M25
4) Control cable	3/4	28.4	M25
5) Control cable <sup>(2)</sup>	3/4	28.4	M25
6) Control cable <sup>(2)</sup>	3/4	28.4	M25

 1) Tolerance  $\pm 0.2$  mm.

2) Knockout hole.
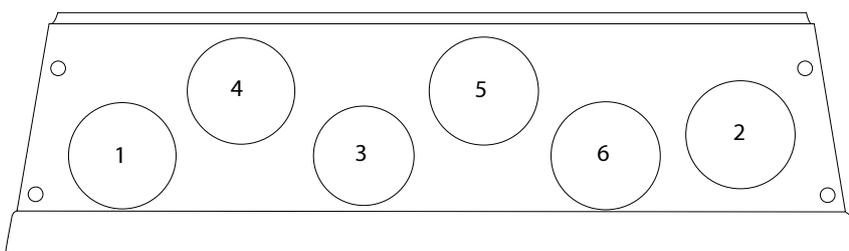
### 9.3.3.6 Entry Holes, Enclosure Size A5, IP55/UL Type 12 Threaded Gland Holes




e:30bb666.10

Table 49: Dimensions of Entry Holes for Enclosure Size A5, IP55/UL Type 12 Threaded Gland Holes

Hole number and recommended use	Dimensions <sup>(1)</sup>		Nearest metric
	UL [in]	[mm]	
1) Mains	3/4	28.4	M25
2) Motor	3/4	28.4	M25
3) Brake/loadsharing	3/4	28.4	M25
4) Control cable	3/4	28.4	M25
5) Control cable	3/4	28.4	M25
6) Control cable	3/4	28.4	M25

 1) Tolerance  $\pm 0.2$  mm.

### 9.3.3.7 Entry Holes, Enclosure Size B1, IP21/UL Type 1

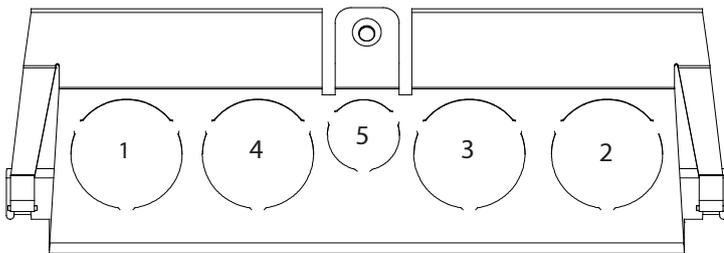


e30bb659.11

Table 50: Dimensions of Entry Holes for Enclosure Size B1, IP21/UL Type 1

Hole number and recommended use	Dimensions <sup>(1)</sup>		Nearest metric
	UL [in]	[mm]	
1) Mains	1	34.7	M32
2) Motor	1	34.7	M32
3) Brake/loadsharing	1	34.7	M32
4) Control cable	1	34.7	M32
5) Control cable	1/2	22.5	M20

 1) Tolerance  $\pm 0.2$  mm.

### 9.3.3.8 Entry Holes, Enclosure Size B1, IP55/UL Type 12

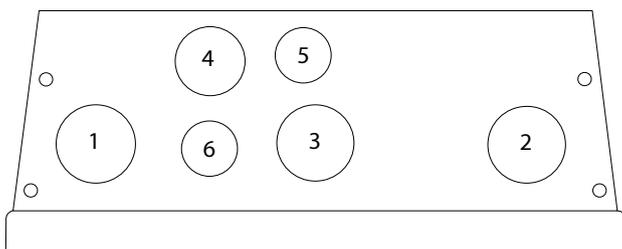

e30bb667.10


**Table 51: Dimensions of Entry Holes for Enclosure Size B1, IP55/UL Type 12**

Hole number and recommended use	Dimensions <sup>(1)</sup>		Nearest metric
	UL [in]	[mm]	
1) Mains	1	34.7	M32
2) Motor	1	34.7	M32
3) Brake/loadsharing	1	34.7	M32
4) Control cable	3/4	28.4	M25
5) Control cable	1/2	22.5	M20
6) Control cable <sup>(2)</sup>	1/2	22.5	M20

1) Tolerance  $\pm 0.2$  mm.

2) Knockout hole.
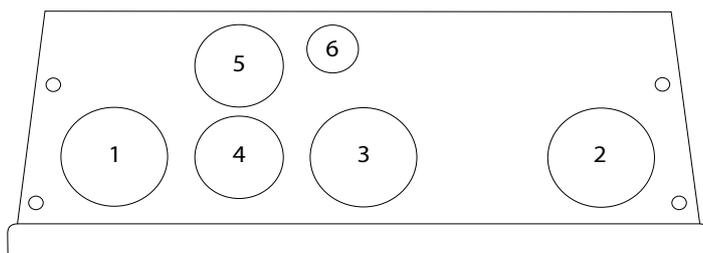
### 9.3.3.9 Entry Holes, Enclosure Size B1, IP55/UL Type 12 Threaded Gland Holes



e30bb669.10


**Table 52: Dimensions of Entry Holes for Enclosure Size B1, IP55/UL Type 12 Threaded Gland Holes**

Hole number and recommended use	Dimensions <sup>(1)</sup>		Nearest metric
	UL [in]	[mm]	
1) Mains	1	34.7	M32
2) Motor	1	34.7	M32
3) Brake/loadsharing	1	34.7	M32
4) Control cable	3/4	28.4	M25
5) Control cable	3/4	28.4	M25
6) Control cable <sup>(2)</sup>	1/2	22.5 mm	M20

1) Tolerance  $\pm 0.2$  mm.

2) Knockout hole
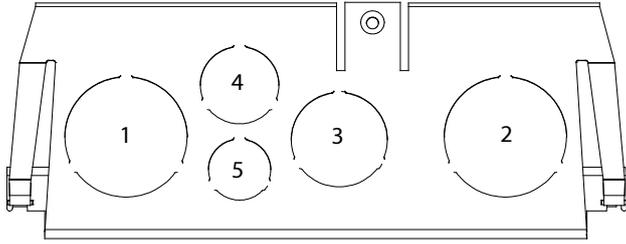
## 9.3.3.10 Entry Holes, Enclosure Size B2, IP21/UL Type 1




e30bb660.11

Table 53: Dimensions of Entry Holes for Enclosure Size B2, IP21/UL Type 1

Hole number and recommended use	Dimensions <sup>(1)</sup>		Nearest metric
	UL [in]	[mm]	
1) Mains	1 1/4	44.2	M40
2) Motor	1 1/4	44.2	M40
3) Brake/loadsharing	1	34.7	M32
4) Control cable	3/4	28.4	M25
5) Control cable	1/2	22.5	M20

 1) Tolerance  $\pm 0.2$  mm.

## 9.3.3.11 Entry Holes, Enclosure Size B2, IP55/UL Type 12

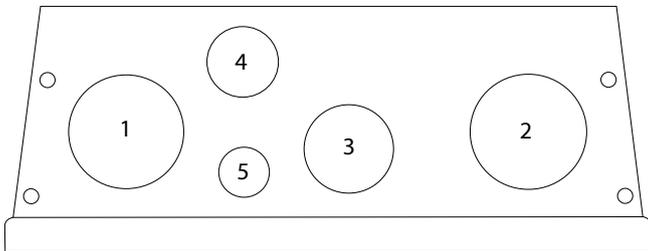

e30bb668.10


Table 54: Dimensions of Entry Holes for Enclosure Size B2, IP55/UL Type 12

Hole number and recommended use	Dimensions <sup>(1)</sup>		Nearest metric
	UL [in]	[mm]	
1) Mains	1 1/4	44.2	M40
2) Motor	1 1/4	44.2	M40
3) Brake/loadsharing	1	34.7	M32
4) Control cable	3/4	28.4	M25
5) Control cable <sup>(2)</sup>	1/2	22.5	M20

 1) Tolerance  $\pm 0.2$  mm.

2) Knockout hole.

### 9.3.3.12 Entry Holes, Enclosure Size B2, IP55/UL Type 12 Threaded Gland Holes

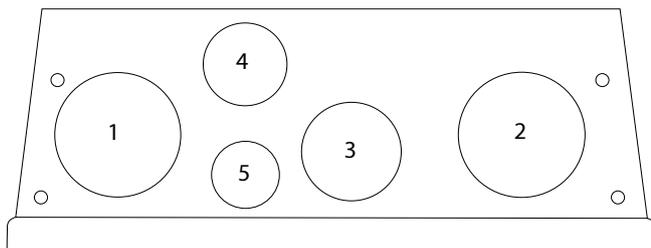


e30bb670.10

**Table 55: Dimensions of Entry Holes for Enclosure Size B2, IP55/UL Type 12 Threaded Gland Holes**

Hole number and recommended use	Dimensions <sup>(1)</sup>		Nearest metric
	UL [in]	[mm]	
1) Mains	1 1/4	44.2	M40
2) Motor	1 1/4	44.2	M40
3) Brake/loadsharing	1	34.7	M32
4) Control cable	3/4	28.4	M25
5) Control cable	1/2	22.5	M20

 1) Tolerance  $\pm 0.2$  mm.
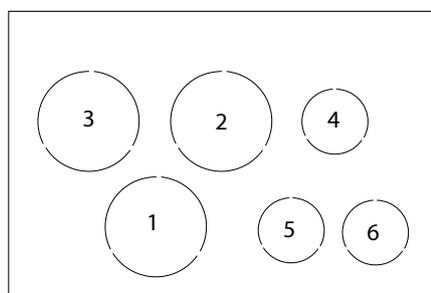
### 9.3.3.13 Entry Holes, Enclosure Size B3, IP21/UL Type 1




e30bb658.10

**Table 56: Dimensions of Entry Holes for Enclosure Size B3, IP21/UL Type 1**

Hole number and recommended use	Dimensions <sup>(1)</sup>		Nearest metric
	UL [in]	[mm]	
1) Mains	1	34.7	M32
2) Motor	1	34.7	M32
3) Brake/loadsharing	1	34.7	M32
4) Control cable	1/2	22.5	M20
5) Control cable	1/2	22.5	M20
6) Control cable	1/2	22.5	M20

 1) Tolerance  $\pm 0.2$  mm.
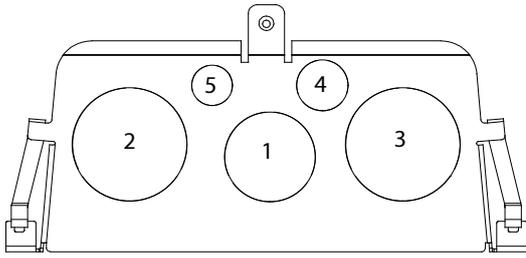
## 9.3.3.14 Entry Holes, Enclosure Size C1, IP21/UL Type 1




e30bb661.11

Table 57: Dimensions of Entry Holes for Enclosure Size C1, IP21/UL Type 1

Hole number and recommended use	Dimensions <sup>(1)</sup>		Nearest metric
	UL [in]	[mm]	
1) Mains	2	63.3	M63
2) Motor	2	63.3	M63
3) Brake/loadsharing	1 1/2	50.2	M50
4) Control cable	3/4	28.4	M25
5) Control cable	1/2	22.5	M20

 1) Tolerance  $\pm 0.2$  mm.

## 9.3.3.15 Entry Holes, Enclosure Size C2, IP21/UL Type 1

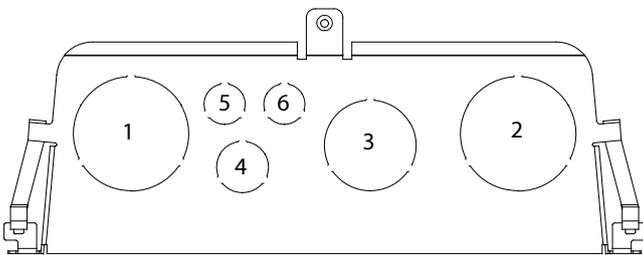

e30bb662.11

Table 58: Dimensions of Entry Holes for Enclosure Size C2, IP21/UL Type 1

Hole number and recommended use	Dimensions <sup>(1)</sup>		Nearest metric
	UL [in]	[mm]	
1) Mains	2	63.3	M63
2) Motor	2	63.3	M63
3) Brake/loadsharing	1 1/2	50.2	M50
4) Control cable	3/4	28.4	M25
5) Control cable	1/2	22.5	M20
6) Control cable	1/2	22.5	M20

 1) Tolerance  $\pm 0.2$  mm.

## 9.3.4 Tightening Torques for Cable Entry Plate

**Table 59: Tightening Torque Values [Nm (in-lb)]**

Enclosure size	IP20	IP21	IP55	IP66
A1	(1)	(2)	(2)	(2)
A2	(1)	(1)	(2)	(2)
A3	(1)	(1)	(2)	(2)
A4/A5	(2)	(2)	2 (17.7)	2 (17.7)
B1	(2)	(1)	2.2 (19.5)	2.2 (19.5)
B2	(1)	(2)	2.2 (19.5)	2.2 (19.5)
B3	(1)	(2)	(2)	(2)
B4	(1)	(2)	(2)	(2)
C1	(2)	(1)	2.2 (19.5)	2.2 (19.5)
C2	(2)	(1)	2.2 (19.5)	2.2 (19.5)
C3	2 (17.7)	(2)	(2)	(2)
C4	2 (17.7)	(2)	(2)	(2)

1) No screws to tighten.

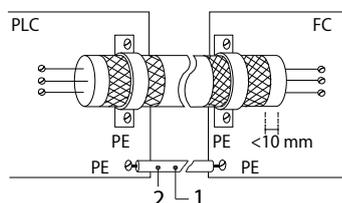
2) Does not exist.

## 9.4 Control Wiring and Terminals

### 9.4.1 Shielded Control Cables

Usually, the preferred method is to secure control and serial communication cables with shielding clamps provided at both ends to ensure the best possible high frequency cable contact.

If the ground potential between the drive and the PLC is different, electric noise could disturb the entire system. Solve this problem by fitting an equalizing cable as close as possible to the control cable. Minimum cable cross-section: 16 mm<sup>2</sup> (6 AWG).




e30bb922.12

**Figure 66: Shielding Clamps at Both Ends**

1	Minimum 16 mm <sup>2</sup> (6 AWG)	2	Equalizing cable
---	------------------------------------	---	------------------

#### 9.4.1.1 50/60 Hz Ground Loops

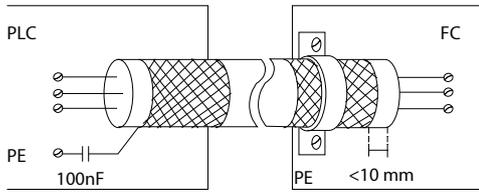With long control cables, ground loops may occur. To eliminate ground loops, connect 1 end of the shield to the ground with a 100 nF capacitor (keeping leads short).




e30bb609.12

Figure 67: Connection with a 100 nF Capacitor

### 9.4.1.2 Avoid EMC Noise on Serial Communication

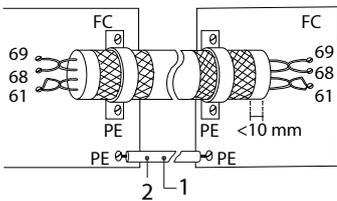This terminal is connected to ground via an internal RC link. Use twisted-pair cables to reduce interference between conductors. The recommended method is shown in the following illustration.




e30bb923.12

Figure 68: Twisted-pair Cables

1	Minimum 16 mm <sup>2</sup> (6 AWG)	2	Equalizing cable
---	------------------------------------	---	------------------

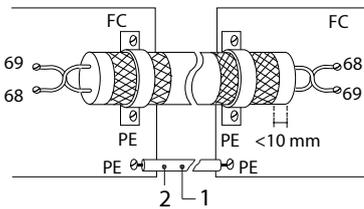Alternatively, the connection to terminal 61 can be omitted.




e30bb924.12

Figure 69: Twisted-pair Cables without Terminal 61

1	Minimum 16 mm <sup>2</sup> (6 AWG)	2	Equalizing cable
---	------------------------------------	---	------------------


### 9.4.2 Control Terminal Types

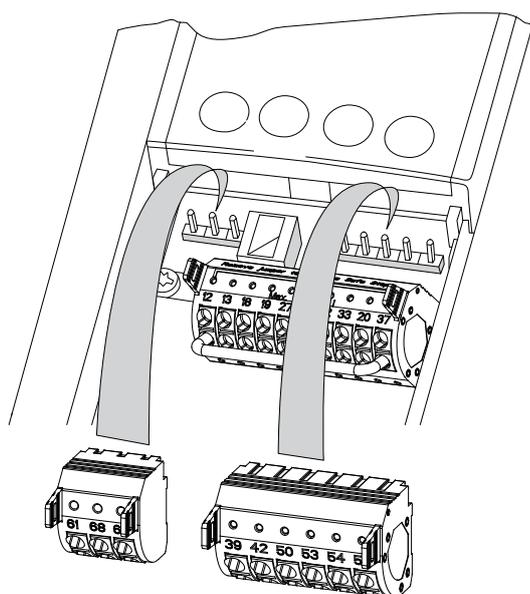The removable drive connectors/terminal blocks are located beneath the local control panel (LCP). Terminal functions and default settings are summarized in [9.4.3 Terminal Descriptions](#).



e30bf144.10

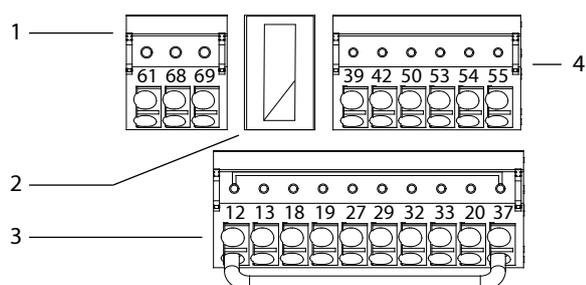Figure 70: Control Terminal Locations



e30bf145.11

Figure 71: Terminal Numbers on the Connectors

1	Serial communication connector	2	USB port
3	Digital input/output connector	4	Analog input/output connector

- Serial communication connector provides 2 terminals (+) 68 and (-) 69 for an RS485 serial communication.
- USB port available for use with the MCT 10 setup software.
- Digital input/output connector provides:
  - 4 programmable digital input terminals.
  - 2 extra digital terminals programmable as either input or output.
  - A 24 V DC terminal supply voltage.
  - A common for optional customer-supplied 24 V DC voltage.
- Analog input/output connector provides:
  - 2 analog inputs.
  - 1 analog output.
  - 10 V DC supply voltage.
  - Commons for the inputs and output.

### 9.4.3 Terminal Descriptions

Table 60: Digital Inputs/Outputs

Terminal	Parameter	Default setting	Description
12, 13	–	+24 V DC	+24 V DC supply voltage for digital inputs and external transducers. Maximum output current 200 mA for all 24 V loads.
18	Parameter 5-10 Terminal 18 Digital Inputs	[8] Start	Digital inputs
19	Parameter 5-11 Terminal 19 Digital Inputs	[0] No operation	
32	Parameter 5-14 Terminal 32 Digital Input	[0] No operation	
33	Parameter 5-15 Terminal 33 Digital Input	[0] No operation	
27	Parameter 5-12 Terminal 27 Digital Input	[2] Coast inverse	For digital input or output. Default setting is input.
29	Parameter 5-13 Terminal 29 Digital Input	[14] Jog	
20	–	–	Common for digital inputs and 0 V potential for 24 V supply.
37	–	Safe Torque Off (STO)	Safe input (optional). Used for STO.

Table 61: Analog Inputs/Outputs

Terminal	Parameter	Default setting	Description
39	–	–	Common for analog output.
42	Parameter 6-50 Terminal 42 Output	Speed 0–high limit	Programmable analog output. 0–20 mA or 4–20 mA at a maximum of 500 Ω.
50	–	+10 V DC	10 V DC analog supply voltage potentiometer or thermistor. 15 mA maximum.
53	Parameter group 6-1* Analog Input 1	Reference	Analog input. For voltage or current. Switches A53 and A54 select mA or V.
54	Parameter group 6-1* Analog Input 2	Feedback	
55	–	–	Common for analog input.

Table 62: Serial Communication

Terminal	Parameter	Default setting	Description
61	–	–	Integrated RC-filter for cable shield. ONLY for connecting the shield if EMC problems occur.
68 (+)	Parameter group <b>8-3* FC Port Settings</b>	–	RS485 interface. A control card switch is provided for termination resistance.
69 (-)	Parameter group <b>8-3* FC Port Settings</b>	–	

Table 63: Relays

Terminal	Parameter	Default setting	Description
01, 02, 03	Parameter <b>5-40 Function Relay [0]</b>	<b>[9] Alarm</b>	Form C relay output. For AC or DC voltage and resistive or inductive loads.
04, 05, 06	Parameter <b>5-40 Function Relay [1]</b>	<b>[5] Running</b>	

Table 64: Extra Terminals

Terminal	Location
1 form C relay outputs	The location of the outputs depend on the drive configuration.
Terminals on built-in optional equipment	See the guide provided with the equipment option.

## 9.5 Fuses and Circuit Breakers

### 9.5.1 Fuse Recommendations

#### NOTICE

Use of fuses on the supply side is mandatory for IEC 60364 (CE) and NEC 2009 (UL) compliant installations.

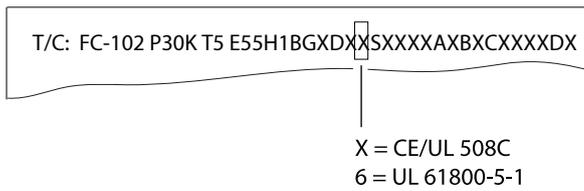
Fuses ensure that possible damage to the drive is limited to damage inside the unit. Danfoss recommends the following fuse types and/or circuit breakers on the supply side as protection.

- gG type fuses.
- Moeller type circuit breakers. For other circuit breaker types, ensure that the energy into the drive is equal to or lower than the energy provided by Moeller types.

For further information, see *Application Note Fuses and Circuit Breakers*.

The recommended fuses in this section are suitable for use on a circuit capable of 100000 A<sub>rms</sub> (symmetrical), depending on the drive power and voltage rating. See the *Electrical Data* section for the short-circuit current rating (SCCR) based on the specific power and voltage rating of the drive.

To achieve the SCCR rating and the specific safety standards for which the drive has been certified, use the type code to identify the specific fuse standard to use, based on application requirements (CE, UL 61800-5-1, or UL 508C). See [Figure 72](#).



e30bm467.10

Figure 72: Identifying the Fuse Certification Standard

## 9.5.2 CE Compliance

Table 65: 200–240 V, Enclosure Sizes A, B, and C

Enclosure	Power [kW (hp)]	Recommended fuse size	Recommended maximum fuse	Recommended circuit breaker Moeller	Maximum trip level [A]
A2	1.1–1.5 (1.5–2.0)	gG-10	gG-25	PKZM0-25	25
	2.2 (3.0)	gG-16			
A3	3.0 (4.0)	gG-16	gG-32	PKZM0-25	25
	3.7 (5.0)	gG-20			
A4	1.1–1.5 (1.5–2.0)	gG-10	gG-32	PKZM0-25	25
	2.2 (3.0)	gG-16			
A5	1.1–1.5 (1.5–2.0)	gG-10	gG-32	PKZM0-25	25
	2.2–3.0 (3.0–4.0)	gG-16			
	3.7 (5.0)	gG-20			
B1	5.5 (7.5)	gG-25	gG-80	PKZM4-63	63
	7.5–11 (10–15)	gG-32			
B2	15 (20)	gG-50	gG-100	NZMB1-A100	100
B3	5.5–7.5 (7.5–10)	gG-25	gG-63	PKZM4-50	50
	11 (15)	gG-32			
B4	15 (20)	gG-50	gG-125	NZMB1-A100	100
	18 (24)	gG-63			
C1	18 (24)	gG-63	gG-160	NZMB2-A200	160
	22 (30)	gG-80			
	30 (40)	gG-100	aR-160		
C2	37 (50)	aR-160	aR-200	NZMB2-A250	250
	45 (60)	aR-200	aR-250		
C3	22 (30)	gG-80	gG-150	NZMB2-A200	150
	30 (40)	aR-125	aR-160		

Table 65: 200–240 V, Enclosure Sizes A, B, and C - (continued)

Enclosure	Power [kW (hp)]	Recommended fuse size	Recommended maximum fuse	Recommended circuit breaker Moeller	Maximum trip level [A]
C4	37 (50)	aR-160	aR-200	NZMB2-A250	250
	45 (60)	aR-200	aR-250		

Table 66: 380–480 V, Enclosure Sizes A, B, and C

Enclosure	Power [kW (hp)]	Recommended fuse size	Recommended maximum fuse	Recommended circuit breaker Moeller	Maximum trip level [A]
A2	1.1–3.0 (1.5–4.0)	gG-10	gG-25	PKZM0-25	25
	4.0 (5.0)	gG-16			
A3	5.5–7.5 (7.5–10.0)	gG-16	gG-32	PKZM0-25	25
A4	1.1–3.0 (1.5–4.0)	gG-10	gG-32	PKZM0-25	25
	4.0 (5.0)	gG-16			
A5	1.1–3.0 (1.5–4.0)	gG-10	gG-32	PKZM0-25	25
	4.0–7.5 (5.0–10.0)	gG-16			
B1	11–18 (15–24)	gG-40	gG-80	PKZM4-63	63
B2	22 (30)	gG-50	gG-100	NZMB1-A100	100
	30 (40)	gG-63			
B3	11–18 (15–24)	gG-40	gG-63	PKZM4-50	50
B4	22 (30)	gG-50	gG-125	NZMB1-A100	100
	30 (40)	gG-63			
	37 (50)	gG-80			
C1	37 (50)	gG-80	gG-160	NZMB2-A200	160
	45 (60)	gG-100			
	55 (75)	gG-160			
C2	75 (100)	aR-200	aR-250	NZMB2-A250	250
	90 (125)	aR-250			
C3	45 (60)	gG-100	gG-150	NZMB2-A200	150
	55 (75)	gG-160	gG-160		
C4	75 (100)	aR-200	aR-250	NZMB2-A250	250
	90 (125)	aR-250			

Table 67: 525–600 V, Enclosure Sizes A, B, and C

Enclosure	Power [kW (hp)]	Recommended fuse size	Recommended maximum fuse	Recommended circuit breaker Moeller	Maximum trip level [A]
A2	1.1–3.0 (1.5–4.0)	gG-10	gG-25	PKZM0-25	25
	4.0 (5.0)	gG-16			
A3	5.5 (7.5)	gG-10	gG-32	PKZM0-25	25
	7.5 (10)	gG-16			
A5	1.1 (1.5)	gG-10	gG-32	PKZM0-25	25
	7.5 (10)	gG-16			
B1	11 (15)	gG-25	gG-80	PKZM4-63	63
	15 (20)	gG-32			
	18.5 (25)	gG-40			
B2	22 (30)	gG-50	gG-100	NZMB1-A100	100
	30 (40)	gG-63			
B3	11 (15)	gG-25	gG-63	PKZM4-50	50
	15–18.5 (20–25)	gG-32			
B4	22 (30)	gG-40	gG-125	NZMB1-A100	100
	30 (40)	gG-50			
	37 (50)	gG-63			
C1	37 (50)	gG-63	gG-160	NZMB2-A200	160
	45 (60)	gG-100			
	55 (60)	aR-160	aR-250		
C2	75–90 (100–125)	aR-200	aR-250	NZMB2-A250	250
C3	45 (60)	gG-63	gG-150	NZMB2-A200	150
	55 (75)	gG-100			
C4	75 (100)	aR-160	aR-250	NZMB2-A250	250
	90 (125)	aR-200			

Table 68: 525–690 V, Enclosure Sizes A, B, and C

Enclosure	Power [kW (hp)]	Recommended fuse size	Recommended maximum fuse	Recommended circuit breaker Moeller	Maximum trip level [A]
A3	1.1 (1.5)	gG-6	gG-25	PKZM0-16	16
	1.5 (2.0)	gG-6	gG-25		
	2.2 (3.0)	gG-6	gG-25		
	3.0 (4.0)	gG-10	gG-25		
	4.0 (5.0)	gG-10	gG-25		
	5.5 (7.5)	gG-16	gG-25		
	7.5 (10)	gG-16	gG-25		
B2/B4	11 (15)	gG-25	gG-63	–	–
	15 (20)	gG-32			
	18 (24)	gG-32			
	22 (30)	gG-40			
	30 (40)	gG-63	gG-80		
B4/C2	37 (50)	gG-63	gG-100	–	–
C2/C3	45 (60)	gG-80	gG-125	–	–
	55 (75)	gG-100	gG-160		
C2	75 (100)	gG-125	gG-160	–	–
	90 (125)				

### 9.5.3 UL Compliance (61800-5-1)

Table 69: Recommended Fuse, 200–240 V and 115Y/200–139Y/240, Enclosure Sizes A, B, C1, and C2

Power [kW (hp)]	Class	Recommended	Verified with
1.1 (1.5)	J/T/CC	10 A	A2: class J, 20 A A5: class J, 30 A
1.5 (2.0)	J/T/CC	15 A	A2: class J, 20 A A5: class J, 30 A
2.2 (3.0)	J/T/CC	20 A	A2: class J, 20 A A5: class J, 30 A
3.0 (4.0)	J/T/CC	25 A	A3: class J, 30 A A5: class J, 30 A
3.7 (5.0)	J/T/CC	30 A	A3: class J, 30 A A5: class J, 30 A
5.5–7.5 (7.5–10)	J/T/CC	50 A	B1: class J, 60 A

Table 69: Recommended Fuse, 200–240 V and 115Y/200–139Y/240, Enclosure Sizes A, B, C1, and C2 - (continued)

Power [kW (hp)]	Class	Recommended	Verified with
11 (15)	J/T/CC	60 A	B1: class J, 60 A
15 (20)	J/T	80 A	B2: class J, 80 A
18.5–22 (25–30)	J/T	125 A	C1: class J, 150 A
30 (40)	J/T	150 A	C1: class J, 150 A

Table 70: Recommended Fuse, 380–480 V and 220Y/380–277Y/480, Enclosure Sizes A, B, C1, and C2

Power [kW (hp)]	Class	Recommended	Verified with
1.1 (1.5)	J/T/CC	6 A	A2: class J, 10 A A5: class J, 30 A
1.5–2.2 (2.0–3.0)	J/T/CC	10 A	A2: class J, 20 A A5: class J, 30 A
3.0 (4.0)	J/T/CC	15 A	A2: class J, 20 A A5: class J, 30 A
4.0 (5.0)	J/T/CC	20 A	A2: class J, 20 A A5: class J, 30 A
5.5 (7.5)	J/T/CC	25 A	A3: class J, 30 A A5: class J, 30 A
7.5 (10)	J/T/CC	30 A	A3: class J, 30 A A5: class J, 30 A
11–15 (15–20)	J/T/CC	40 A	B2: class J, 50 A
18.5 (25)	J/T/CC	50 A	B1: class J, 50 A
22 (30)	J/T/CC	60 A	B2: class J, 80 A
30 (40)	J/T	80 A	B2: class J, 80 A
37 (50)	J/T	100 A	C1: class J, 150 A
45 (60)	J/T	125 A	C1: class J, 150 A
55 (75)	J/T	150 A	C1: class J, 150 A
75 (100)	J/T	200 A	250 A
90 (125)	J/T	250 A	250 A

**Table 71: Recommended Fuse, 200–240 V and 115Y/200–139Y/240, Enclosure Sizes C3, and C4**

Power [kW (hp)]	Class	Recommended	Verified with	Tested enclosure (HxWxD) <sup>(1)</sup> [mm(in)]
22 (10)	T/J	125 A	150 A	800 (31.5) X 600 (23.6) X 400 (15.7)
30 (40)	T/J	150 A	150 A	800 (31.5) X 600 (23.6) X 400 (15.7)
37 (50)	T/J	200 A	250 A	1200 (47.2) X 600 (23.6) X 500 (19.7)
45 (60)	T/J	250 A	250 A	1200 (47.2) X 600 (23.6) X 500 (19.7)

1) C3 and C4 drives meet UL 61800-5-1 certification based on the drive being mounted within a larger enclosure (approximately 1.5x the drive) and being centered on the back panel of the larger enclosure. See [Allowed Ventilation Openings for C3 and C4 Enclosures](#) for dimensions and allowed vent openings and cable entry points for the tested units. To maintain UL 61800-5-1 certification and to provide the required shielding for vented enclosures, ensure that the spatial relationship between the drive and the vent openings in the larger enclosure is maintained, at a minimum. Larger enclosures can use greater distances to openings. For more information, contact Danfoss support.

**Table 72: Recommended Fuse, 380–480 V and 220Y/380–277Y/480, Enclosure Sizes C3 and C4**

Power [kW (hp)]	Class	Recommended	Verified with	Tested enclosure (HxWxD) <sup>(1)</sup> [mm(in)]
45 (60)	T/J	125 A	150 A	800 (31.5) X 600 (23.6) X 400 (15.7)
55 (75)	T/J	150 A	150 A	800 (31.5) X 600 (23.6) X 400 (15.7)
75 (100)	T/J	200 A	250 A	1200 (47.2) X 600 (23.6) X 500 (19.7)
90 (125)	T/J	250 A	250 A	1200 (47.2) X 600 (23.6) X 500 (19.7)

1) C3 and C4 drives meet UL 61800-5-1 certification based on the drive being mounted within a larger enclosure (approximately 1.5x the drive) and being centered on the back panel of the larger enclosure. See [Allowed Ventilation Openings for C3 and C4 Enclosures](#) for dimensions and allowed vent openings and cable entry points for the tested units. To maintain UL 61800-5-1 certification and to provide the required shielding for vented enclosures, ensure that the spatial relationship between the drive and the vent openings in the larger enclosure is maintained, at a minimum. Larger enclosures can use greater distances to openings. For more information, contact Danfoss support.

**Allowed Ventilation Openings for C3 and C4 Enclosures**

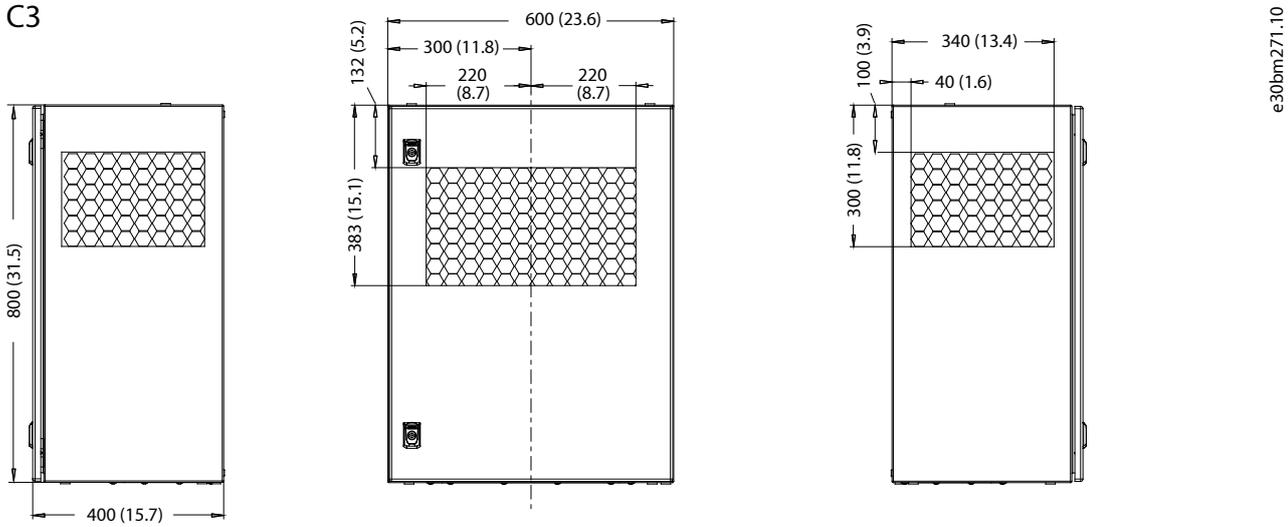


Figure 73: Allowed Ventilation Openings for C3 Enclosures as Tested for UL61800-5-1 Compliance

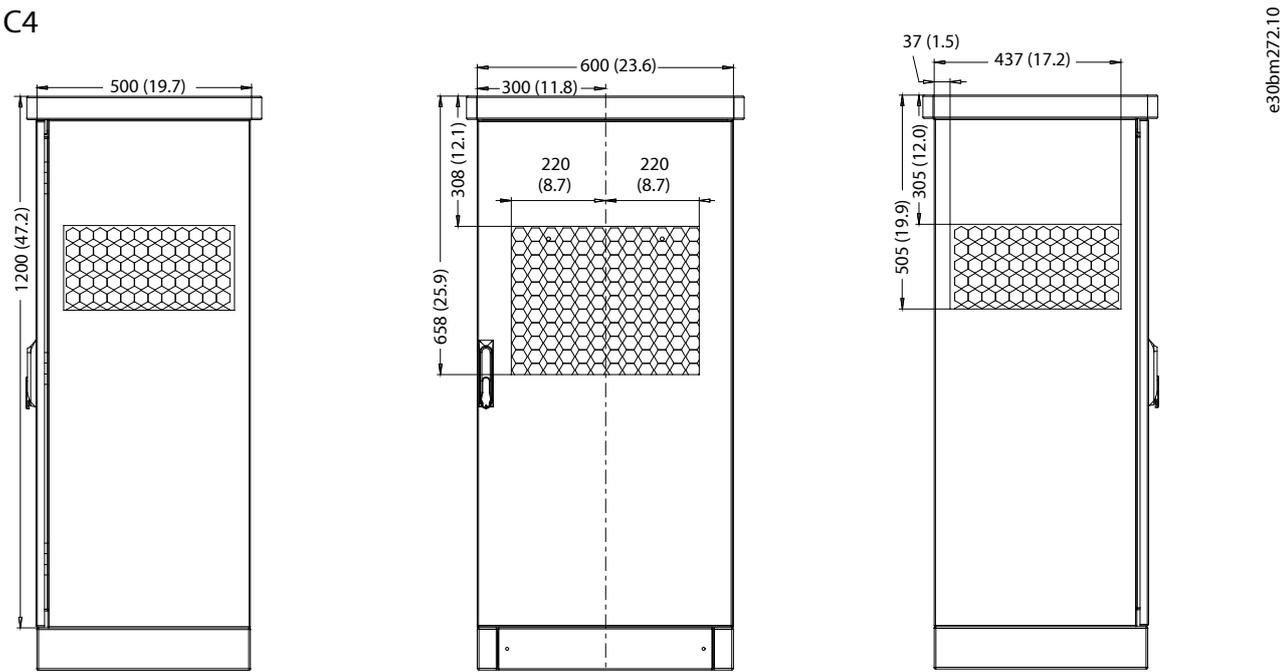


Figure 74: Allowed Ventilation Openings for C4 Enclosures as Tested for UL61800-5-1 Compliance

**9.5.4 UL Compliance (508C)**

Table 73: Recommended Maximum Fuse, 200–240 V, Enclosure Sizes A, B, and C

Power [kW (hp)]	Bussmann Type RK1 <sup>(1)</sup>	Bussmann Type J	Bussmann Type T	Bussmann Type CC	Bussmann Type CC	Bussmann Type CC
1.1 (1.5)	KTN-R-10	JKS-10	JJN-10	FNQ-R-10	KTK-R-10	LP-CC-10
1.5 (2.0)	KTN-R-15	JKS-15	JJN-15	FNQ-R-15	KTK-R-15	LP-CC-15
2.2 (3.0)	KTN-R-20	JKS-20	JJN-20	FNQ-R-20	KTK-R-20	LP-CC-20

Table 73: Recommended Maximum Fuse, 200–240 V, Enclosure Sizes A, B, and C - (continued)

Power [kW (hp)]	Bussmann Type RK1 <sup>(1)</sup>	Bussmann Type J	Bussmann Type T	Bussmann Type CC	Bussmann Type CC	Bussmann Type CC
3.0 (4.0)	KTN-R-25	JKS-25	JJN-25	FNQ-R-25	KTK-R-25	LP-CC-25
3.7 (5.0)	KTN-R-30	JKS-30	JJN-30	FNQ-R-30	KTK-R-30	LP-CC-30
5.5–7.5 (7.5–10)	KTN-R-50	KS-50	JJN-50	–	–	–
11 (15)	KTN-R-60	JKS-60	JJN-60	–	–	–
15 (20)	KTN-R-80	JKS-80	JJN-80	–	–	–
18.5–22 (25–30)	KTN-R-125	JKS-125	JJN-125	–	–	–
30 (40)	KTN-R-150	JKS-150	JJN-150	–	–	–
37 (50)	KTN-R-200	JKS-200	JJN-200	–	–	–
45 (60)	KTN-R-250	JKS-250	JJN-250	–	–	–

1) KTS-fuses from Bussmann may substitute KTN for 240 V drives.

Table 74: Recommended Maximum Fuse, 200–240 V, Enclosure Sizes A, B, and C

Power [kW (hp)]	SIBA Type RK1	Littelfuse Type RK1	Ferraz Shawmut Type CC	Ferraz Shawmut Type RK1 <sup>(1)</sup>	Bussmann Type JFHR2 <sup>(2)</sup>	Littelfuse JFHR2	Ferraz Shawmut JFHR2 <sup>(3)</sup>	Ferraz Shawmut J
1.1 (1.5)	5017906-010	KLN-R-10	ATM-R-10	A2K-10-R	FWX-10	–	–	HSJ-10
1.5 (2.0)	5017906-016	KLN-R-15	ATM-R-15	A2K-15-R	FWX-15	–	–	HSJ-15
2.2 (3.0)	5017906-020	KLN-R-20	ATM-R-20	A2K-20-R	FWX-20	–	–	HSJ-20
3.0 (4.0)	5017906-025	KLN-R-25	ATM-R-25	A2K-25-R	FWX-25	–	–	HSJ-25
3.7 (5.0)	5012406-032	KLN-R-30	ATM-R-30	A2K-30-R	FWX-30	–	–	HSJ-30
5.5–7.5 (7.5–10)	5014006-050	KLN-R-50	–	A2K-50-R	FWX-50	–	–	HSJ-50
11 (15)	5014006-063	KLN-R-60	–	A2K-60-R	FWX-60	–	–	HSJ-60
15 (20)	5014006-080	KLN-R-80	–	A2K-80-R	FWX-80	–	–	HSJ-80
18.5–22 (25–30)	2028220-125	KLN-R-125	–	A2K-125-R	FWX-125	–	–	HSJ-125
30 (40)	2028220-150	KLN-R-150	–	A2K-150-R	FWX-150	L25S-150	A25X-150	HSJ-150
37 (50)	2028220-200	KLN-R-200	–	A2K-200-R	FWX-200	L25S-200	A25X-200	HSJ-200
45 (60)	2028220-250	KLN-R-250	–	A2K-250-R	FWX-250	L25S-250	A25X-250	HSJ-250

1) A6KR-fuses from Ferraz Shawmut may substitute A2KR for 240 V drives.

2) FWH-fuses from Bussmann may substitute FWX for 240 V drives.

3) A50X-fuses from Ferraz Shawmut may substitute A25X for 240 V drives.

Table 75: Recommended Maximum Fuse, 380–480 V, Enclosure Sizes A, B, and C

Power [kW (hp)]	Bussmann Type RK1	Bussmann Type J	Bussmann Type T	Bussmann Type CC	Bussmann Type CC	Bussmann Type CC
1.1 (1.5)	KTS-R-6	JKS-6	JJS-6	FNQ-R-6	KTK-R-6	LP-CC-6
1.5–2.2 (2.0–3.0)	KTS-R-10	JKS-10	JJS-10	FNQ-R-10	KTK-R-10	LP-CC-10
3.0 (4.0)	KTS-R-15	JKS-15	JJS-15	FNQ-R-15	KTK-R-15	LP-CC-15
4.0 (5.0)	KTS-R-20	JKS-20	JJS-20	FNQ-R-20	KTK-R-20	LP-CC-20
5.5 (7.5)	KTS-R-25	JKS-25	JJS-25	FNQ-R-25	KTK-R-25	LP-CC-25
7.5 (10)	KTS-R-30	JKS-30	JJS-30	FNQ-R-30	KTK-R-30	LP-CC-30
11–15 (15–20)	KTS-R-40	JKS-40	JJS-40	–	–	–
18.5 (25)	KTS-R-50	JKS-50	JJS-50	–	–	–
22 (30)	KTS-R-60	JKS-60	JJS-60	–	–	–
30 (40)	KTS-R-80	JKS-80	JJS-80	–	–	–
37 (50)	KTS-R-100	JKS-100	JJS-100	–	–	–
45 (60)	KTS-R-125	JKS-125	JJS-125	–	–	–
55 (75)	KTS-R-150	JKS-150	JJS-150	–	–	–
75 (100)	KTS-R-200	JKS-200	JJS-200	–	–	–
90 (125)	KTS-R-250	JKS-250	JJS-250	–	–	–

Table 76: Recommended Maximum Fuse, 380–480 V, Enclosure Sizes A, B, and C

Power [kW (hp)]	SIBA Type RK1	Littelfuse Type RK1	Ferraz Shawmut Type CC	Ferraz Shawmut Type RK1	Bussmann JFHR2	Ferraz Shawmut J	Ferraz Shawmut JFHR2 <sup>(1)</sup>	Littelfuse JFHR2
1.1 (1.5)	5017906-006	KLS-R-6	ATM-R-6	A6K-6-R	FWH-6	HSJ-6	–	–
1.5–2.2 (2.0–3.0)	5017906-010	KLS-R-10	ATM-R-10	A6K-10-R	FWH-10	HSJ-10	–	–
3.0 (4.0)	5017906-016	KLS-R-15	ATM-R-15	A6K-15-R	FWH-15	HSJ-15	–	–
4.0 (5.0)	5017906-020	KLS-R-20	ATM-R-20	A6K-20-R	FWH-20	HSJ-20	–	–
5.5 (7.5)	5017906-025	KLS-R-25	ATM-R-25	A6K-25-R	FWH-25	HSJ-25	–	–
7.5 (10)	5012406-032	KLS-R-30	ATM-R-30	A6K-30-R	FWH-30	HSJ-30	–	–
11–15 (15–20)	5014006-040	KLS-R-40	–	A6K-40-R	FWH-40	HSJ-40	–	–
18.5 (25)	5014006-050	KLS-R-50	–	A6K-50-R	FWH-50	HSJ-50	–	–
22 (30)	5014006-063	KLS-R-60	–	A6K-60-R	FWH-60	HSJ-60	–	–
30 (40)	2028220-100	KLS-R-80	–	A6K-80-R	FWH-80	HSJ-80	–	–
37 (50)	2028220-125	KLS-R-100	–	A6K-100-R	FWH-100	HSJ-100	–	–

Table 76: Recommended Maximum Fuse, 380–480 V, Enclosure Sizes A, B, and C - (continued)

Power [kW (hp)]	SIBA Type RK1	Littelfuse Type RK1	Ferraz Shawmut Type CC	Ferraz Shawmut Type RK1	Bussmann JFHR2	Ferraz Shawmut J	Ferraz Shawmut JFHR2 <sup>(1)</sup>	Littelfuse JFHR2
45 (60)	2028220-125	KLS-R-125	–	A6K-125-R	FWH-125	HSJ-125	–	–
55 (75)	2028220-160	KLS-R-150	–	A6K-150-R	FWH-150	HSJ-150	–	–
75 (100)	2028220-200	KLS-R-200	–	A6K-200-R	FWH-200	HSJ-200	A50-P-225	L50-S-225
90 (125)	2028220-250	KLS-R-250	–	A6K-250-R	FWH-250	HSJ-250	A50-P-250	L50-S-250

1) Ferraz Shawmut A50QS fuses may substitute for A50P fuses.

Table 77: Recommended Maximum Fuse, 525–600 V, Enclosure Sizes A, B, and C


Power [kW (hp)]	Bussmann Type RK1	Bussmann Type J	Bussmann Type T	Bussmann Type CC	Bussmann Type CC	Bussmann Type CC	SIBA Type RK1	Littelfuse Type RK1	Ferraz Shawmut Type RK1	Ferraz Shawmut J
1.1 (1.5)	KTS-R-5	JKS-5	JJS-6	FNQ-R-5	KTK-R-5	LP-CC-5	501790 6-005	KLS-R-005	A6K-5-R	HSJ-6
1.5–2.2 (2.0–3.0)	KTS-R-10	JKS-10	JJS-10	FNQ-R-10	KTK-R-10	LP-CC-10	501790 6-010	KLS-R-010	A6K-10-R	HSJ-10
3.0 (4.0)	KTS-R15	JKS-15	JJS-15	FNQ-R-15	KTK-R-15	LP-CC-15	501790 6-016	KLS-R-015	A6K-15-R	HSJ-15
4.0 (5.0)	KTS-R20	JKS-20	JJS-20	FNQ-R-20	KTK-R-20	LP-CC-20	501790 6-020	KLS-R-020	A6K-20-R	HSJ-20
5.5 (7.5)	KTS-R-25	JKS-25	JJS-25	FNQ-R-25	KTK-R-25	LP-CC-25	501790 6-025	KLS-R-025	A6K-25-R	HSJ-25
7.5 (10.0)	KTS-R-30	JKS-30	JJS-30	FNQ-R-30	KTK-R-30	LP-CC-30	501790 6-030	KLS-R-030	A6K-30-R	HSJ-30
11–15 (15–20)	KTS-R-35	JKS-35	JJS-35	–	–	–	501400 6-040	KLS-R-035	A6K-35-R	HSJ-35
18.5 (25)	KTS-R-45	JKS-45	JJS-45	–	–	–	501400 6-050	KLS-R-045	A6K-45-R	HSJ-45
22 (30)	KTS-R-50	JKS-50	JJS-50	–	–	–	501400 6-050	KLS-R-050	A6K-50-R	HSJ-50
30 (40)	KTS-R-60	JKS-60	JJS-60	–	–	–	501400 6-063	KLS-R-060	A6K-60-R	HSJ-60
37 (50)	KTS-R-80	JKS-80	JJS-80	–	–	–	501400 6-080	KLS-R-075	A6K-80-R	HSJ-80
45 (60)	KTS-R-100	JKS-100	JJS-100	–	–	–	501400 6-100	KLS-R-100	A6K-100-R	HSJ-100
55 (75)	KTS-R-125	JKS-125	JJS-125	–	–	–	202822 0-125	KLS-R-125	A6K-125-R	HSJ-125

Table 77: Recommended Maximum Fuse, 525–600 V, Enclosure Sizes A, B, and C - (continued)

Power [kW (hp)]	Bussmann Type RK1	Bussmann Type J	Bussmann Type T	Bussmann Type CC	Bussmann Type CC	Bussmann Type CC	SIBA Type RK1	Littelfuse Type RK1	Ferraz Shawmut Type RK1	Ferraz Shawmut J
75 (100)	KTS-R-150	JKS-150	JJS-150	–	–	–	202822 0-150	KLS-R-150	A6K-150-R	HSJ-150
90 (125)	KTS-R-175	JKS-175	JJS-175	–	–	–	202822 0-200	KLS-R-175	A6K-175-R	HSJ-175

## 9.6 Disconnects and Contactors

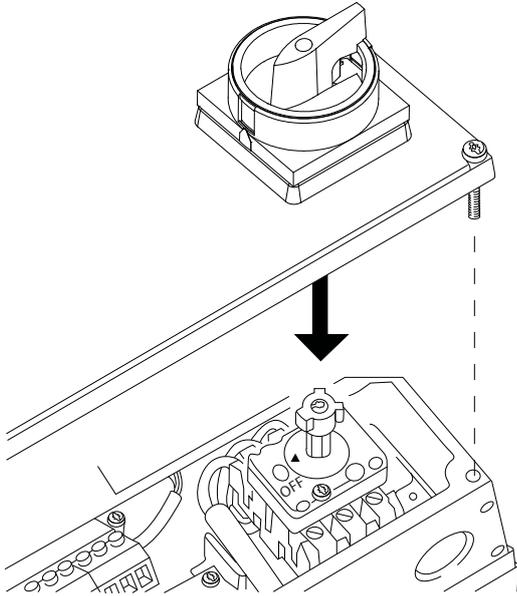The mains switch is on the left side of enclosure sizes B1, B2, C1, and C2. The mains switch on A5 enclosures is on the right side.



e30bd470.10

Figure 75: Location of Mains Switch (Enclosure Size A5)

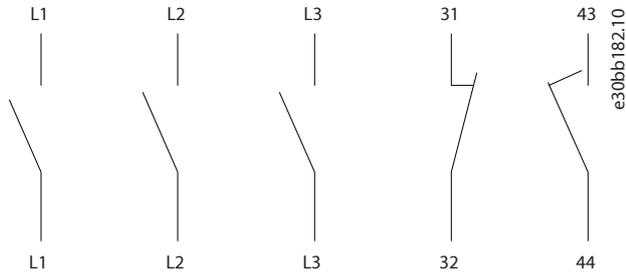


Figure 76: Terminal Connections for A5, B1, and B2

Enclosure size	Type
A5	Kraus&Naimer KG20A T303
B1/B2	Kraus&Naimer KG64 T303

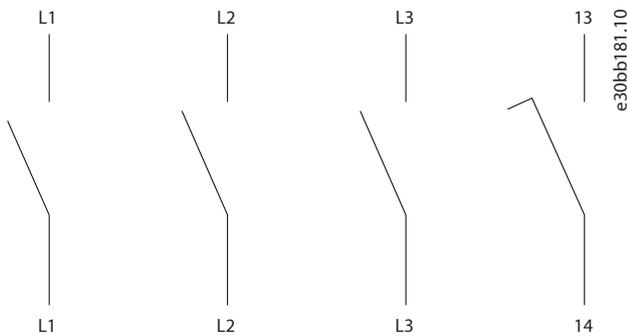


Figure 77: Terminal Connections for C1 and C2

Enclosure size	Type
C1, 37 kW (50 hp)	Kraus&Naimer KG100 T303
C1, 45–55 kW (60–75 hp)	Kraus&Naimer KG105 T303
C2, 75 kW (100 hp)	Kraus&Naimer KG160 T303
C2, 90 kW (125 hp)	Kraus&Naimer KG250 T303


## 9.7 Motor

### 9.7.1 Motor Thermal Protection

Motor thermal protection can be provided via:

- Direct temperature sensing using a
  - PTC- or KTY sensor in the motor windings and connected on a standard AI or DI.
  - PT100 or PT1000 in the motor windings and motor bearings, connected on VLT® Sensor Input Card MCB 114 and VLT® Programmable I/O MCB 115.
  - PTC thermistor input on VLT® PTC Thermistor Card MCB 112 (ATEX-approved).
- Mechanical thermal switch (Klixon type) on a DI.
- Built-in electronic relay (ETR).

ETR calculates motor temperature by measuring current, frequency, and operating time. The drive shows the thermal load on the motor in percentage and can issue a warning at a programmable overload setpoint. Programmable options at the overload allow the drive to stop the motor, reduce output, or ignore the condition. Even at low speeds, the drive meets I2t Class 20 electronic motor overload standards.

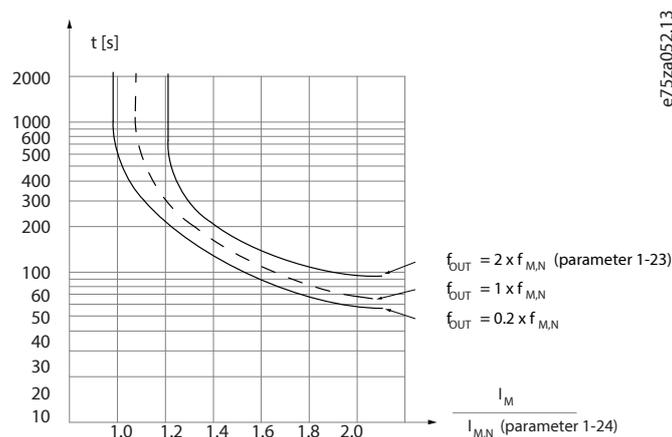

**Figure 78: ETR Characteristics**


The X-axis shows the ratio between  $I_{\text{motor}}$  and  $I_{\text{motor}}$  nominal. The Y-axis shows the time in seconds before the ETR cuts off and trips the drive. The curves show the characteristic nominal speed at twice the nominal speed and at 0.2 x the nominal speed. At lower speed, the ETR cuts off at lower heat due to less cooling of the motor. In that way, the motor is protected from being overheated even at low speed.

The ETR feature calculates the motor temperature based on actual current and speed. The calculated temperature is visible as a readout parameter in parameter **16-18 Motor Thermal**. A special version of the ETR is also available for EX-e or EX-n motors in ATEX areas. This function makes it possible to enter a specific curve to protect the Ex-e motor. See the programming guide for setup instructions.

### 9.7.2 Parallel Connection of Motors

The drive can control several parallel-connected motors. When using a parallel motor connection, observe the following:

- Recommend running applications with parallel motors in U/F mode parameter **1-01 Motor Control Principle [0]**. Set the U/F graph in parameter **1-55 U/f Characteristic - U** and parameter **1-56 U/f Characteristic - F**.
- VCC+ mode may be used in some applications.
- The total current consumption of the motors must not exceed the rated output current  $I_{INV}$  for the drive.
- If motor sizes are widely different in winding resistance, starting problems may occur due to too low motor voltage at low speed.
- The electronic thermal relay (ETR) of the drive cannot be used as motor overload protection for the individual motor. Provide further motor overload protection by including thermistors in each motor winding or individual thermal relays.

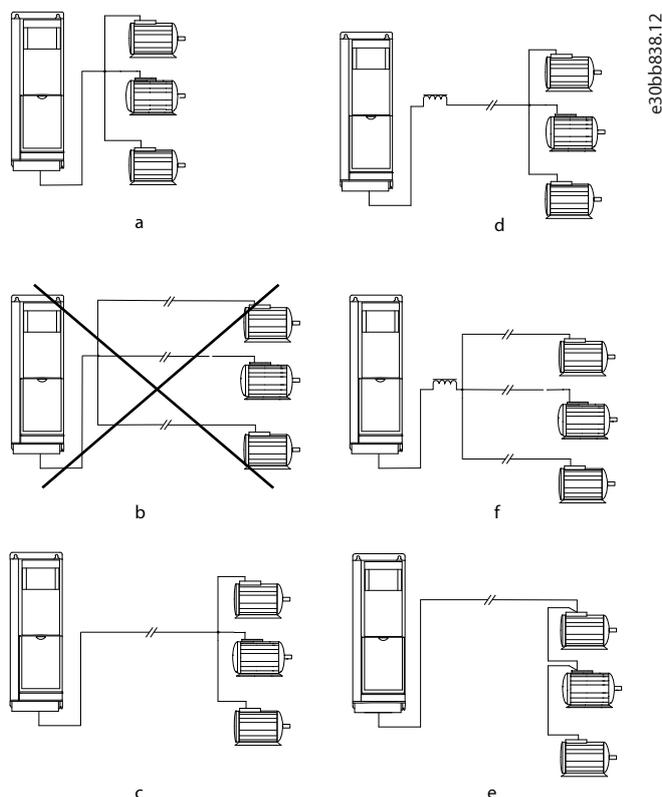

**Figure 79: Different Parallel Connections of Motors**

<b>a</b>	Installations with cables connected in a common joint as shown in A and B are only recommended for short cable lengths.	<b>b</b>	Be aware of the maximum motor cable length specified in the <i>Electrical Data section</i> .
<b>c</b>	The total motor cable length specified in the <i>Electrical Data section</i> is valid as long as the parallel cables are kept short, less than 10 m (32 ft) each.	<b>d</b>	Consider the voltage drop across the motor cables.
<b>e</b>	Consider the voltage drop across the motor cables.	<b>f</b>	The total motor cable length specified in the <i>Electrical Data section</i> is valid as long as the parallel cables are kept short, less than 10 m (32 ft) each.

Table 78: Maximum Cable Lengths

Enclosure sizes	Power rating [kW (hp)]	Voltage [V]	1 cable [m (ft)]	2 cables [m (ft)]	3 cables [m (ft)]	4 cables [m (ft)]
A1, A2, A4, A5	0.37–0.75 (0.5–1.0)	400	150 (492)	45 (147.6)	8.0 (26)	6.0 (19.7)
		500	150 (492)	7.0 (23)	4.0 (13)	3.0 (9.8)
A2, A4, A5	1.1–1.5 (1.5–2.0)	400	150 (492)	45 (147.6)	20 (65.6)	8.0 (26)
		500	150 (492)	45 (147.6)	5.0 (16.4)	4.0 (13)
A2, A4, A5	2.2–4.0 (3.0–5.0)	400	150 (492)	45 (147.6)	20 (65.6)	11 (36)
		500	150 (492)	45 (147.6)	20 (65.6)	6.0 (19.7)
A3, A4, A5	5.5–7.5 (7.5–10)	400	150 (492)	45 (147.6)	20 (65.6)	11 (36)
		500	150 (492)	45 (147.6)	20 (65.6)	11 (36)
B1, B2, B3, B4, C1, C2, C3, C4	11–90 (15–110)	400	150 (492)	75 (246)	50 (164)	37 (121.4)
		500	150 (492)	75 (246)	50 (164)	37 (121.4)
A3	1.1–7.5 (1.5–10)	525–690	100 (382)	50 (164)	33 (108)	25 (82)
B4	11–30 (15–40)	525–690	150 (492)	75 (246)	50 (164)	37 (121.4)
C3	37–45 (50–60)	525–690	150 (492)	75 (246)	50 (164)	37 (121.4)

### 9.7.3 Motor Insulation

Modern motors for use with drives have a high degree of insulation to account for new generation high-efficiency IGBTs with high dU/dt. For retrofit in old motors, confirm the motor insulation or mitigate with dU/dt filter or, if necessary, a sine-wave filter.

For motor cable lengths less than or equal to the maximum cable length listed in the *Electrical Data section*, the motor insulation ratings listed in [Table 79](#) are recommended. If a motor has a lower insulation rating, use a dU/dt or sine-wave filter.

Table 79: Motor Insulation Ratings

Nominal mains voltage [V]	Motor insulation [V]
$U_N \leq 420$	Standard $U_{LL}=1300$
$420\text{ V} < U_N \leq 500$	Reinforced $U_{LL}=1600$
$500\text{ V} < U_N \leq 600$	Reinforced $U_{LL}=1800$
$600\text{ V} < U_N \leq 690$	Reinforced $U_{LL}=2000$

### 9.7.4 Motor Bearing Currents

To minimize DE (Drive End) bearing and shaft currents, ground the drive, motor, driven machine, and motor to the driven machine properly. For more information, refer to the *Minimizing Bearing Failures in AC Drive Systems User Guide*.

#### Standard mitigation strategies

- Use an insulated bearing.
- Apply rigorous installation procedures:
  - Ensure that the motor and load motor are aligned.

- Strictly follow the EMC Installation guideline.
- Reinforce the PE so the high-frequency impedance is lower in the PE than the input power leads.
- Provide a good high-frequency connection between the motor and the drive. For example, use a shielded cable that has a 360° connection in the motor and the drive.
- Make sure that the impedance from the drive to the building ground is lower than the grounding impedance of the machine. This setup can be difficult for pumps.
- Make a direct ground connection between the motor and load motor.
- Lower the IGBT switching frequency.
- Modify the inverter waveform, 60° AVM vs. SFAVM.
- Install a shaft grounding system or use an isolating coupling.
- Apply conductive lubrication.
- Use minimum speed settings if possible.
- Try to ensure that the mains voltage is balanced to ground. This setup can be difficult for IT, TT, TN-CS, or Grounded leg systems.

## 9.8 Braking

### 9.8.1 Selection of Brake Resistor

To handle higher demands by regenerative braking, a brake resistor is necessary. Using a brake resistor ensures that the energy is absorbed in the brake resistor and not in the drive. For more information, see the *VLT® Brake Resistor MCE 101 Design Guide*.

If the amount of kinetic energy transferred to the resistor in each braking period is not known, the average power can be calculated based on the cycle time and braking time, also called intermittent duty cycle. The resistor intermittent duty cycle is an indication of the duty cycle at which the resistor is active. See [Figure 80](#) for a typical braking cycle.

#### NOTICE

Motor suppliers often use S5 when stating the allowed load, which is an expression of intermittent duty cycle.

The intermittent duty cycle for the resistor is calculated as follows:

$$\text{Duty cycle} = t_b / T$$

T = cycle time in s.

$t_b$  is the braking time in s (of the cycle time).

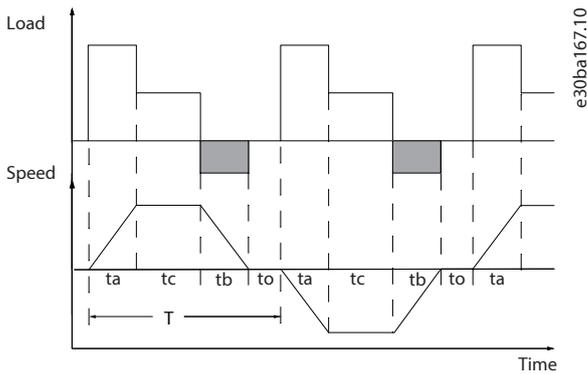


Figure 80: Dynamic brake Cycle Time

Brake resistors have a duty cycle of 5%, 10%, and 40%. If a 10% duty cycle is applied, the brake resistors are able to absorb brake power for 10% of the cycle time. The remaining 90% of the cycle time is spent on dissipating excess heat.

Table 80: Braking at High Overload Torque Level

	Cycle time (s)	Braking duty cycle at 100% torque	Braking duty cycle at overtorque (150/160%)
<b>200–240 V</b>			
PK25–P11K	120	Continuous	40%
P15K–P37K	300	10%	10%
<b>380–500 V</b>			
PK37–P75K	120	Continuous	40%
P90K–P160	600	Continuous	10%
P200–P800	600	40%	10%
<b>525–600 V</b>			
PK75–P75K	120	Continuous	40%
<b>525–690 V</b>			
P37K–400	600	40%	10%
P500–P560	600	40%	10%
P630–P1M0	600	40%	10%

1) 500 kW at 86% braking torque/560 kW at 76% brake power.

2) 500 kW at 130% braking torque/560 kW at 115% brake power.

**NOTICE**

Ensure that the resistor is designed to handle the required braking time.

The maximum allowed load on the brake resistor is stated as a peak power at a given intermittent duty cycle and can be calculated as:

$$R_{br}[\Omega] = \frac{U_{dc}^2}{P_{peak}}$$

Where

$$P_{\text{peak}} = P_{\text{motor}} \times M_{\text{br}} [\%] \times \eta_{\text{motor}} \times \eta_{\text{VLT}} [\text{W}]$$

Table 81: DC-link Voltage (UDC), FC 102

Size [V]	Brake active [V DC]	High-voltage warning [V DC]	Overvoltage alarm [V DC]
FC 102, 3x200–240 V	390	405	410
FC 102, 3x380–480 V	778	810	820
FC 102, 3x525–600 V	943	965	975
FC 102, 3x525–690 V	1099	1109	1130

### NOTICE

For use of 3rd party brake resistors, make sure to comply with the preceding table. The VLT® Brake Resistor MCE 101 series is optimized for Danfoss VLT® frequency converter series.

Danfoss recommends a brake resistor  $R_{\text{rec}}$  that can guarantee that the drive can brake at the highest brake power ( $M_{\text{br}(\%)}$ ) of 150%. The formula can be written as:

$$200\text{V} : R_{\text{rec}} = \frac{107780}{P_{\text{motor}}} [\Omega]$$

$$500\text{V} : R_{\text{rec}} = \frac{464923}{P_{\text{motor}}} [\Omega]$$

$$600\text{V} : R_{\text{rec}} = \frac{630137}{P_{\text{motor}}} [\Omega]$$

$$690\text{V} : R_{\text{rec}} = \frac{832664}{P_{\text{motor}}} [\Omega]$$

### NOTICE

The brake resistor circuit resistance selected should not be lower than what Danfoss recommends respecting the current limits.

### NOTICE

If a higher value is selected, the brake energy is reduced accordingly to a value below 150%.

### NOTICE

If a short circuit occurs in the brake transistor, power dissipation in the brake resistor is only avoided by using a mains switch or contactor to disconnect the mains from the drive. Alternatively, use a switch in the brake circuit. Uninterrupted power dissipation in the brake resistor can cause overheating, damage, or fire.

## WARNING

### RISK OF FIRE

The brake resistors become hot during braking. Failure to place the brake resistor in a secure area can result in property damage and/or serious injury.

- Ensure that the brake resistor is placed in a secure environment to avoid fire risk.
- Do not touch the brake resistor during or after braking to avoid serious burns.

## 9.8.2 Control with Brake Function

A relay/digital output can be used to protect the brake resistor against overloading or overheating by generating a fault in the drive. If the brake IGBT is overloaded or overheated, the relay/digital output signal from the drive to the brake turns off the brake IGBT. The relay/digital output signal does not protect against a short circuit in the brake IGBT or a ground fault in the brake module or wiring. If a short circuit occurs in the brake IGBT, Danfoss recommends a means to disconnect the brake.

Furthermore, the brake enables reading out the momentary power and the average power of the latest 120 s. The brake can monitor the power energizing and make sure that it does not exceed the limit selected in the brake monitor function. Consult the operating guide for more details.

### NOTICE

Monitoring the brake power is not a safety function. A thermal switch connected to an external contactor is required for that purpose. The brake resistor circuit is not ground leakage protected.

Overvoltage control (OVC) can be selected as an alternative brake function in parameters for overvoltage control. This function is active for all units and ensures that if the DC-link voltage increases, the output frequency also increases to limit the voltage from the DC link, which avoids a trip.

### NOTICE

OVC cannot be activated when running a permanent magnet motor, while parameters for motor construction is set to PM non-salient SPM.

### NOTICE

#### MORE REQUIREMENTS FOR BRAKING APPLICATIONS

When the motor brakes the machinery, the DC-link voltage of the drive increases. The effect of the increase equals an increase of the motor supply voltage of up to 20%. Consider this voltage increase when specifying the motor insulation requirements if the motor will be braking a large part of its operational time. **Example:** Motor insulation requirement for a 400 V AC mains voltage application must be selected as if the drive were supplied with 480 V.

## 9.9 Residual Current Device

Use RCD relays, multiple protective earthing, or grounding as extra protection to comply with local safety regulations. If a ground fault appears, a DC content may develop in the faulty current. If RCD relays are used, local regulations must be observed. Relays must be suitable for protection of 3-phase equipment with a bridge rectifier and for a brief discharge on power-up using RCDs.

## 9.10 Leakage Current

Follow national and local codes regarding protective earthing of equipment where leakage current exceeds 3.5 mA.

Drive technology implies high frequency switching at high power, which generates a leakage current in the ground connection. The ground leakage current is made up of several contributions and depends on various system configurations, including:

- RFI filtering.
- Motor cable length.
- Motor cable shielding.
- Drive power.

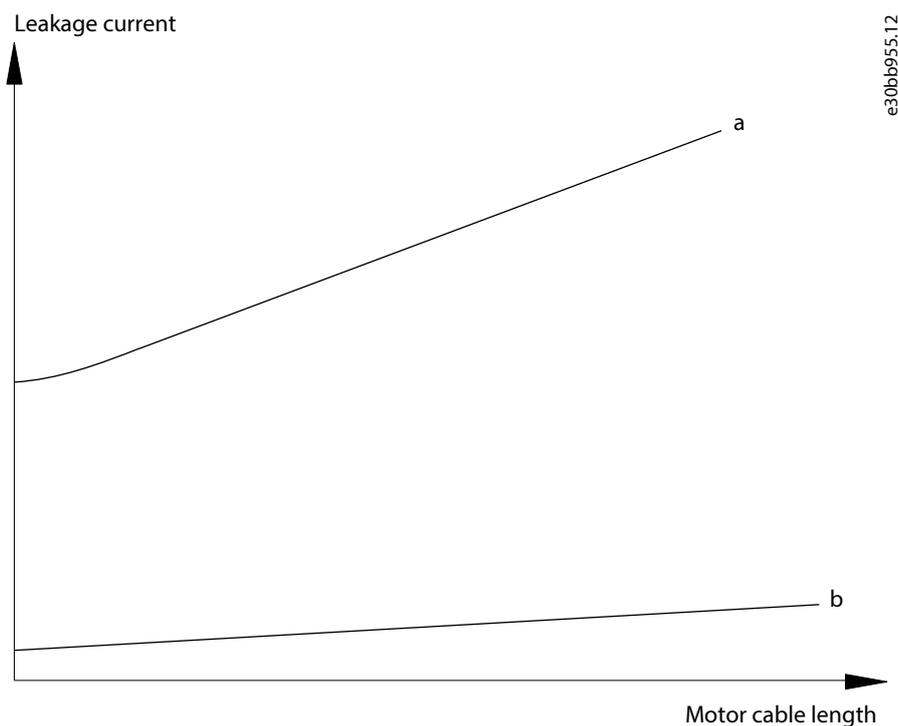


Figure 81: Influence of the Cable Length and Power Size on Leakage Current, Power Size a > Power Size B

The leakage current also depends on the line distortion.

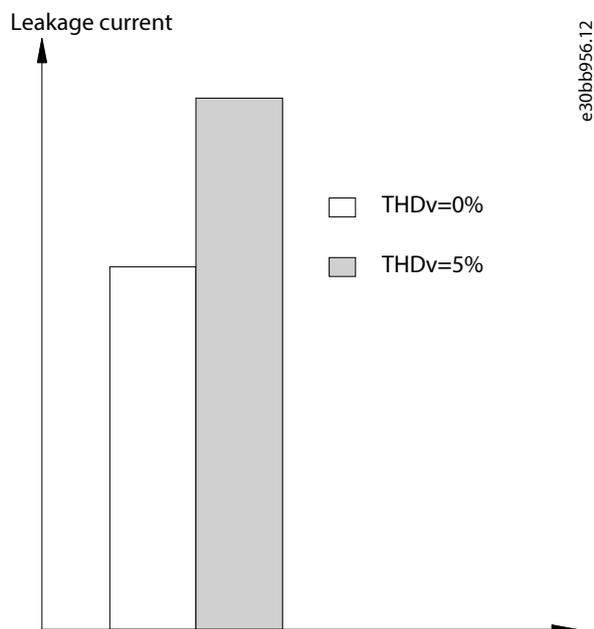


Figure 82: Influence of Line Distortion on Leakage Current

If the leakage current exceeds 3.5 mA, compliance with EN/IEC 61800-5-1 (power drive system product standard) requires special care.

Reinforce grounding with the following protective ground connection requirements:

- Ground wire (terminal 95) of at least 10 mm<sup>2</sup> (8 AWG) cross-section.
- 2 separate ground wires both complying with the dimensioning rules.

See EN/IEC 61800-5-1 and IEC EN 62477-1 for further information.

### 9.10.1 Using a Residual Current Device (RCD)

Where residual current devices (RCDs), also known as ground leakage circuit breakers, are used, comply with the following:

- Use RCDs of type B only, which can detect AC and DC currents.
- Use RCDs with an inrush delay to avoid faults caused by transient ground currents.
- Dimension RCDs according to the system configuration and environmental considerations.

The leakage current includes several frequencies originating from both the mains frequency and the switching frequency. Whether the switching frequency is detected depends on the type of RCD used.

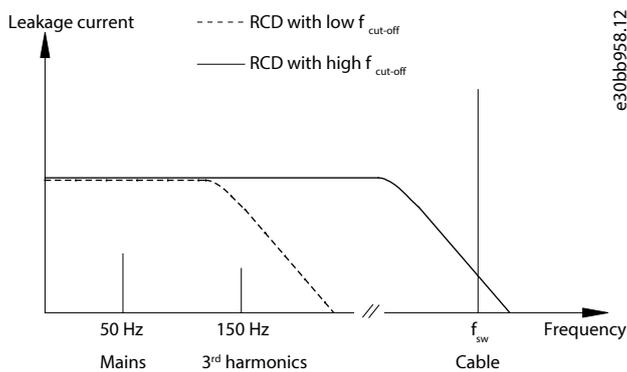


Figure 83: Mains Contributions to Leakage Current

The amount of leakage current detected by the RCD depends on the cut-off frequency of the RCD.

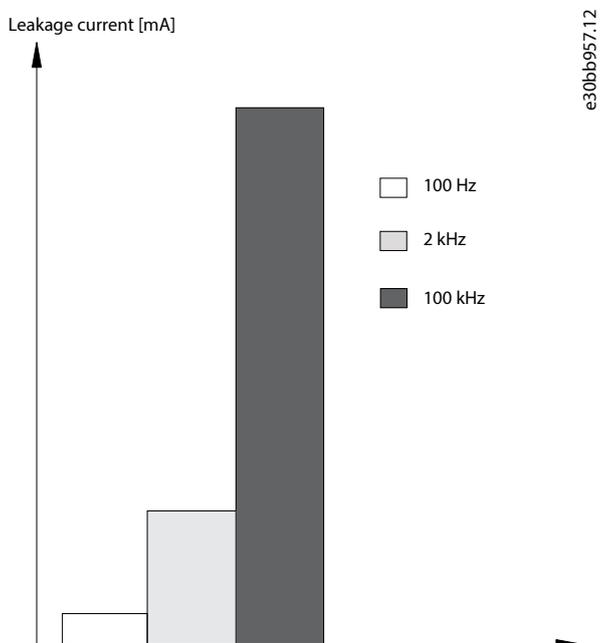


Figure 84: Influence of Cut-off Frequency of the RCD on what is Responded to/Measured

For more details, refer to the *RCD Application Note*.

## 9.11 Efficiency

### Efficiency of the drive ( $\eta_{VLT}$ )

The load on the drive has little effect on its efficiency. In general, the efficiency is the same at the rated motor frequency  $f_{M,N}$ , even if the motor supplies 100% of the rated shaft torque or only 75%, for example, if there are part loads. The efficiency of the drive does not change even if other U/f characteristics are selected. However, the U/f characteristics influence the efficiency of the motor. The efficiency declines a little when the switching frequency is set to a value of above 5 kHz. The efficiency is also slightly reduced if the mains voltage is 480 V, or if the motor cable is longer than 30 m (98 ft).

### Drive efficiency calculation

Calculate the efficiency of the drive at different speeds and loads based on the graph in [Figure 85](#). Multiply the factor in this graph by the specific efficiency factor listed in the specification tables in [7.5 Mains Supply](#):

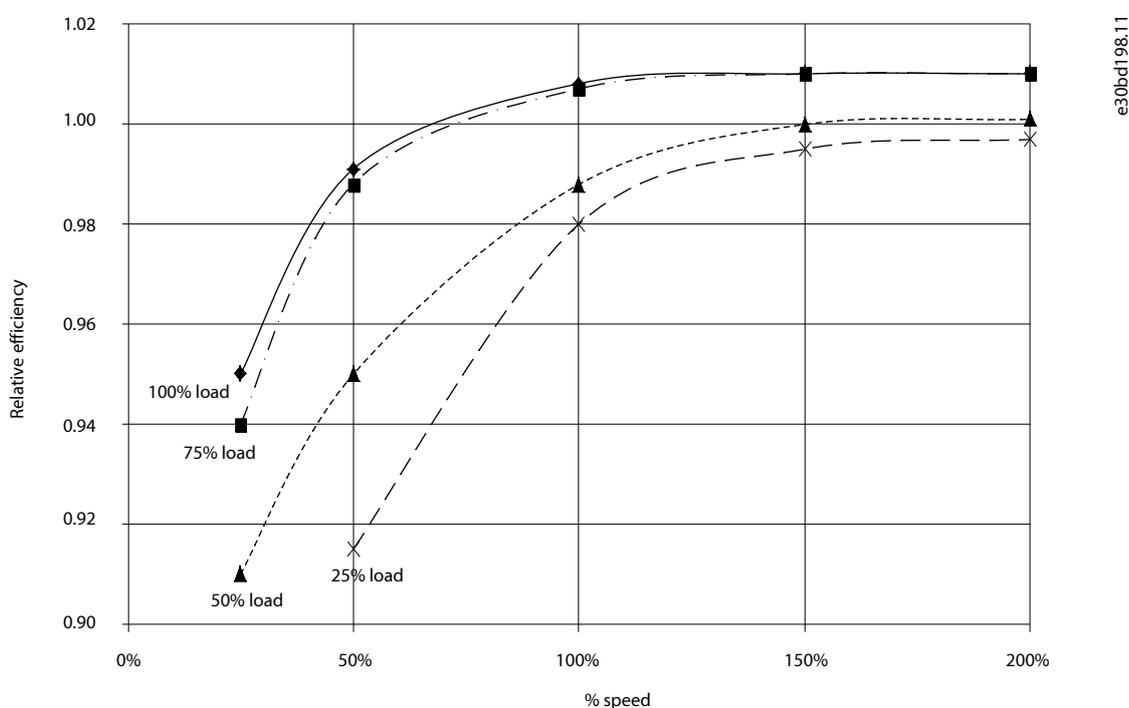


Figure 85: Typical Efficiency Curves

Example: Assume a 160 kW, 380–480/500 V AC drive at 25% load at 50% speed. The graph shows 0.97 - the rated efficiency for a 160 kW drive is 0.98. The actual efficiency is then:  $0.97 \times 0.98 = 0.95$ .

The MyDrive® ecoSmart™ tool helps to calculate the efficiency, refer to <https://ecosmart.mydrive.danfoss.com>.

### Efficiency of the motor ( $\eta_{MOTOR}$ )

The efficiency of a motor connected to the drive depends on the magnetizing level. In general, the efficiency is as good as with mains operation. The efficiency of the motor depends on the type of motor. In the range of 75–100% of the rated torque, the efficiency of the motor is practically constant, both when the drive runs the motor and when it runs directly on mains. In small motors, the influence from the U/f characteristic on efficiency is marginal. However, in motors from 11 kW (15 hp) and up, the advantages are significant. Typically, the switching frequency does not affect the efficiency of small motors. Motors from 11 kW (15 hp) and up have their efficiency improved (1–2%) because the shape of the motor current sine-wave is almost perfect at high switching frequency.

## Efficiency of the system ( $\eta_{\text{SYSTEM}}$ )

To calculate the system efficiency, the efficiency of the drive ( $\eta_{\text{VLT}}$ ) is multiplied by the efficiency of the motor ( $\eta_{\text{MOTOR}}$ ):

$$\eta_{\text{SYSTEM}} = \eta_{\text{VLT}} \times \eta_{\text{MOTOR}}$$

## 9.12 dU/dt

### 9.12.1 dU/dt Conditions

To avoid damage to motors without phase insulation paper or other insulation reinforcement designed for operation of the drive, install a VLT® dU/dt filter MCC 102 or a VLT® Sine-wave Filter MCC 101 on the output of the drive.

When a transistor in the inverter bridge switches, the voltage across the motor increases by a dU/dt ratio depending on:

- Motor inductance.
- Motor cable (type, cross-section, length, shielded, unshielded).

The natural induction causes an overshoot voltage peak in the motor voltage before it stabilizes. The level depends on the voltage in the DC link. Switching on the IGBTs causes peak voltage on the motor terminals. The rise time and the peak voltage affect the service life of the motor. If the peak voltage is too high, motors without phase coil insulation can be adversely affected over time.

With short motor cables (a few meters), the rise time and peak voltage are lower. The rise time and peak voltage increase with cable length.

The drive complies with IEC 60034-25 and IEC 60034-17 for motor design.

### NOTICE

The measurements in the following tables are carried out with a single power size and motor, but with several motor cable lengths, and are for information only. Depending on the combination of drive, motor cable type, motor cable length, and motor, the values for  $U_{\text{peak}}$  and dU/dt can be higher at the motor terminal. Sometimes, the values exceed the limits given by the motor manufacturer.

- To avoid problems with too high dU/dt, use motor cables longer than 30–40 m (98–131 ft).
- If in doubt, use a dU/dt filter between the drive and the motor, or do a measurement in the actual installation.

### 9.12.2 dU/dt Values, 200–240 V (T2)

Table 82: dU/dt Values for P5K5, 200–240 V

Cable length [m (ft)]	Mains voltage [V]	Rise time [ $\mu\text{s}$ ]	$U_{\text{peak}}$ [kV]	dU/dt [kV/ $\mu\text{s}$ ]
36 (118)	240	0.226	0.616	2.142
50 (164)	240	0.262	0.626	1.908
100 (328)	240	0.650	0.614	0.757
150(492)	240	0.745	0.612	0.655

Table 83: dU/dt Values for P7K5, 200–240 V

Cable length [m (ft)]	Mains voltage [V]	Rise time [ $\mu$ s]	$U_{\text{peak}}$ [kV]	dU/dt [kV/ $\mu$ s]
5 (16.4)	240	0.13	0.510	3.090
50 (164)	240	0.23	0.590	2.034
100 (328)	240	0.54	0.580	0.865
150 (492)	240	0.66	0.560	0.674

Table 84: dU/dt Values for P11K, 200–240 V

Cable length [m (ft)]	Mains voltage [V]	Rise time [ $\mu$ s]	$U_{\text{peak}}$ [kV]	dU/dt [kV/ $\mu$ s]
36 (118)	240	0.264	0.624	1.894
136 (446)	240	0.536	0.594	0.896
150 (492)	240	0.568	0.568	0.806

Table 85: dU/dt Values for P15K, 200–240 V

Cable length [m (ft)]	Mains voltage [V]	Rise time [ $\mu$ s]	$U_{\text{peak}}$ [kV]	dU/dt [kV/ $\mu$ s]
30 (98.4)	240	0.556	0.650	0.935
100 (328)	240	0.592	0.594	0.807
150 (492)	240	0.708	0.575	0.669

Table 86: dU/dt Values for P18K, 200–240 V

Cable length [m (ft)]	Mains voltage [V]	Rise time [ $\mu$ s]	$U_{\text{peak}}$ [kV]	dU/dt [kV/ $\mu$ s]
36 (118)	240	0.244	0.608	1.993
136 (446.2)	240	0.568	0.580	0.832
150 (492)	240	0.720	0.574	0.661

Table 87: dU/dt Values for P22K, 200–240 V

Cable length [m (ft)]	Mains voltage [V]	Rise time [ $\mu$ s]	$U_{\text{peak}}$ [kV]	dU/dt [kV/ $\mu$ s]
36 (118)	240	0.244	0.608	1.993
136 (446)	240	0.560	0.580	0.832
150 (492)	240	0.720	0.574	0.661

Table 88: dU/dt Values for P30K, 200–240 V

Cable length [m (ft)]	Mains voltage [V]	Rise time [ $\mu$ s]	$U_{\text{peak}}$ [kV]	dU/dt [kV/ $\mu$ s]
15 (49.2)	240	0.194	0.626	2.581
50 (328)	240	0.252	0.574	1.929
150 (492)	240	0.444	0.538	0.977

Table 89: dU/dt Values for P37K, 200–240 V

Cable length [m (ft)]	Mains voltage [V]	Rise time [ $\mu$ s]	$U_{\text{peak}}$ [kV]	dU/dt [kV/ $\mu$ s]
30 (98.4)	240	0.300	0.598	1.594
100 (328)	240	0.536	0.566	0.844
150 (492)	240	0.776	0.546	0.562

Table 90: dU/dt Values for P45K, 200–240 V

Cable length [m (ft)]	Mains voltage [V]	Rise time [ $\mu$ s]	$U_{\text{peak}}$ [kV]	dU/dt [kV/ $\mu$ s]
30 (98.4)	240	0.300	0.598	1.594
100 (328)	240	0.536	0.566	0.844
150 (492)	240	0.776	0.546	0.562

### 9.12.3 dU/dt Values, 380–480 V (T4)

Table 91: dU/dt Values for P1K5, 380–480 V

Cable length [m (ft)]	Mains voltage [V]	Rise time [ $\mu$ s]	$U_{\text{peak}}$ [kV]	dU/dt [kV/ $\mu$ s]
5 (16.4)	400	0.640	0.690	0.862
50 (164)	400	0.470	0.985	0.985
150 (492)	400	0.760	1.045	0.947

Table 92: dU/dt Values for P4K0, 380–480 V

Cable length [m (ft)]	Mains voltage [V]	Rise time [ $\mu$ s]	$U_{\text{peak}}$ [kV]	dU/dt [kV/ $\mu$ s]
5 (16.4)	400	0.172	0.890	4.156
50 (164)	400	0.310	0.993	2.564
150 (492)	400	0.370	1.190	1.170

Table 93: dU/dt Values for P7K5, 380–480 V

Cable length [m (ft)]	Mains voltage [V]	Rise time [ $\mu$ s]	$U_{\text{peak}}$ [kV]	dU/dt [kV/ $\mu$ s]
5 (16.4)	400	0.04755	0.739	8.035
50 (164)	400	0.207	1.040	4.548
150 (492)	400	0.6742	1.030	2.828

Table 94: dU/dt Values for P11K, 380–480 V

Cable length [m (ft)]	Mains voltage [V]	Rise time [ $\mu$ s]	$U_{\text{peak}}$ [kV]	dU/dt [kV/ $\mu$ s]
15 (49.2)	400	0.408	0.718	1.402
100 (328)	400	0.364	1.050	2.376
150 (492)	400	0.400	0.980	2.000

Table 95: dU/dt Values for P15K, 380–480 V

Cable length [m (ft)]	Mains voltage [V]	Rise time [ $\mu$ s]	$U_{\text{peak}}$ [kV]	dU/dt [kV/ $\mu$ s]
36 (118)	400	0.422	1.060	2.014
100 (328)	400	0.464	0.900	1.616
150 (492)	400	0.896	1.000	0.915

Table 96: dU/dt Values for P18K, 380–480 V

Cable length [m (ft)]	Mains voltage [V]	Rise time [ $\mu$ s]	$U_{\text{peak}}$ [kV]	dU/dt [kV/ $\mu$ s]
36 (118)	400	0.344	1.040	2.442
100 (328)	400	1.000	1.190	0.950
150 (492)	400	1.400	1.040	0.596

Table 97: dU/dt Values for P22K, 380–480 V

Cable length [m (ft)]	Mains voltage [V]	Rise time [ $\mu$ s]	$U_{\text{peak}}$ [kV]	dU/dt [kV/ $\mu$ s]
36 (118)	400	0.232	0.950	3.534
100 (328)	400	0.410	0.980	1.927
150 (492)	400	0.430	0.970	1.860

Table 98: dU/dt Values for P30K, 380–480 V

Cable length [m (ft)]	Mains voltage [V]	Rise time [ $\mu$ s]	$U_{\text{peak}}$ [kV]	dU/dt [kV/ $\mu$ s]
15 (49.2)	400	0.271	1.000	3.100
100 (328)	400	0.440	1.000	1.818
150 (492)	400	0.520	1.990	1.510

Table 99: dU/dt Values for P37K, 380–480 V

Cable length [m (ft)]	Mains voltage [V]	Rise time [ $\mu$ s]	$U_{\text{peak}}$ [kV]	dU/dt [kV/ $\mu$ s]
5 (16.4)	480	0.270	1.276	3.781
50 (164)	480	0.435	1.184	2.177
100 (328)	480	0.840	1.188	1.131
150 (492)	480	0.940	1.212	1.031

Table 100: dU/dt Values for P45K, 380–480 V

Cable length [m (ft)]	Mains voltage [V]	Rise time [ $\mu$ s]	$U_{\text{peak}}$ [kV]	dU/dt [kV/ $\mu$ s]
36 (118)	400	0.254	1.056	3.326
50 (164)	400	0.465	1.048	1.803
100 (328)	400	0.815	1.032	1.013
150 (492)	400	0.890	1.016	0.913

Table 101: dU/dt Values for P55K, 380–480 V

Cable length [m (ft)]	Mains voltage [V]	Rise time [ $\mu$ s]	$U_{\text{peak}}$ [kV]	dU/dt [kV/ $\mu$ s]
10 (32.8)	400	0.350	0.932	2.130

Table 102: dU/dt Values for P75K, 380–480 V

Cable length [m (ft)]	Mains voltage [V]	Rise time [ $\mu$ s]	$U_{\text{peak}}$ [kV]	dU/dt [kV/ $\mu$ s]
5 (16.4)	480	0.371	1.170	2.466

Table 103: dU/dt Values for P90K, 380–480 V

Cable length [m (ft)]	Mains voltage [V]	Rise time [ $\mu$ s]	$U_{\text{peak}}$ [kV]	dU/dt [kV/ $\mu$ s]
5 (16.4)	400	0.364	1.030	2.264

## 9.13 Acoustic Noise and Airflow

Table 104: Acoustic Noise Ratings

Enclosure size	50% fan speed [dBA] <sup>(1)</sup>	Full fan speed [dBA] <sup>(1)</sup>
A1	51	60
A2	51	60
A3	51	60
A4	51	60
A5	54	63
B1	61	67
B2	58	70
B4	52	62
C1	52	62
C2	55	65
C4	56	71
D3h <sup>(2)</sup>	58	71

1) Values are measured 1 m (3.28 ft) from the unit.

2) Details, see separate design guide VLT® HVAC Drive FC 102 90–710 kW

Drives are equipped with fans, which contribute to the airflow in enclosures and surroundings.

Table 105: Airflow Through the Drive

Enclosure size	IP protection rating	Size [mm (in)]	Airflow [m <sup>3</sup> /hr]	Effect [W]
A2	20/21	70x70 (2.75x2.75)	30.6	3.6
A3	20/21	80x80 (3.15x3.15)	37/59	4.0
A4	55/66	70x70 (2.75x2.75)	23	2.9

Table 105: Airflow Through the Drive - (continued)

Enclosure size	IP protection rating	Size [mm (in)]	Airflow [m <sup>3</sup> /hr]	Effect [W]
A5	55/66	92x92 (3.6x3.6)	96	4.2
B1	21/55/66	127x127 (5x5)	310	18
B2	21/55/66	140x140 (5.5x5.5)	370	22
B3	20/21	120x120 (4.7x4.7)	244	12
B4	20/21	127x127 (5x5)	310	18
C1	21/55/66	172x150 (6.8x5.9)	420	22
C2	21/55/66	172x150 (6.8x5.9)	420	22
C3	20	120x120 (4.7x4.7)	244	12
C4	20	127x127 (5x5)	310	18

## 9.14 Electromagnetic Compatibility (EMC)

### 9.14.1 EMC Test Results

The following test results have been obtained by using a system with a drive, a shielded control cable, a control box with potentiometer, a single motor, and shielded motor cable (Ölflex Classic 100 CY) at nominal switching frequency.

#### NOTICE

Conditions may change significantly for other setups. Contact Danfoss for parallel motor cable installation.

Table 106: EMC Test Results (Emission) Maximum Motor Cable Length

RFI filter type		Conducted emission			Radiated emission		
		Cable length [m (ft)]			Cable length [m (ft)]		
Standards and requirements	EN 55011/ CISPR 11	Class B	Class A, Group 1	Class A, Group 2	Class B	Class A, Group 1	Class A, Group 2
	EN/IEC 61800-3	Category C1	Category C2	Category C3	Category C1	Category C2	Category C3
<b>H1</b>							
FC 102	1.1–45 kW, 200–240 V	50 (164)	150 (492)	150 (492)	No	Yes	Yes
	1.1–90 kW, 380–480 V	50 (164)	150 (492)	150 (492)	No	Yes	Yes
<b>H2</b>							
FC 102	1.1–3.7 kW, 200–240 V	No	No	5 (16.4)	No	No	No
	5.5–45 kW, 200–240 V	No	No	25 (82)	No	No	No

Table 106: EMC Test Results (Emission) Maximum Motor Cable Length - (continued)

RFI filter type		Conducted emission			Radiated emission		
	1.1–7.5 kW, 380–500 V	No	No	5 (16.4)	No	No	No
	11–90 kW, 380–500 V <sup>(1)</sup>	No	No	25 (82)	No	No	No
	11–22 kW, 525–690 V <sup>(1), (2)</sup>	No	No	25 (82)	No	No	No
	30–90 kW, 525–690 V <sup>(1), (3)</sup>	No	No	25 (82)	No	No	No
<b>H3</b>							
FC 102	1.1–45 kW, 200–240 V	10 (32.8)	50 (164)	75 (246)	No	Yes	Yes
	1.1–90 kW, 380–480 V	10 (32.8)	50 (164)	75 (246)	No	Yes	Yes
<b>H4</b>							
	11–30 kW, 525–690 V <sup>(2)</sup>	No	100 (328)	100 (328)	No	Yes	Yes
	37–90 kW, 525–690 V <sup>(3)</sup>	No	150 (492)	150 (492)	No	Yes	Yes
<b>Hx<sup>(4)</sup></b>							
FC 102	1.1–90 kW, 525–600 V	No	No	No	No	No	No

1) T7, 37–90 kW complies with class A group 1 with 25 m (82 ft) motor cable. Some restrictions for the installation apply (contact Danfoss for details). Hx, H1, H2; H3; H4, or H5 is defined in the type code positions 16–17 for EMC filters.

2) Enclosure size B.

3) Enclosure size C.

4) Hx versions can be used according to EN/IEC 61800-3 category C4.

## 9.14.2 Emission Requirements

According to the EMC product standard for AC drives, EN/IEC 61800-3:2004, the EMC requirements depend on the intended use of the drive. Four categories are defined in the EMC product standard. The definitions of the 4 categories together with the requirements for mains supply voltage conducted emissions are provided in [Table 107](#).

Table 107: Emission Requirements

Category	Definition	Conducted emission requirement according to the limits given in EN 61800-3
C1	Drives installed in the 1st environment (home and office) with a supply voltage less than 1000 V.	Class B
C2	Drives installed in the 1st environment (home and office) with a supply voltage less than 1000 V, which are not plug-in or movable and are intended for installation and commissioning by a professional.	Class A Group 1
C3	Drives installed in the 2nd environment (industrial) with a supply voltage lower than 1000 V.	Class A Group 2
C4	Drives installed in the 2nd environment (industrial) with a supply voltage equal to or above 1000 V or rated current equal to or above 400 A or intended for use in complex systems.	No limit line. Make an EMC plan.

When the generic emission standards are used, the drives are required to comply with the limits in [Table 108](#).

Table 108: Emission Limit Classes

Environment	Generic standard	Conducted emission requirement according to the limits given in EN 55011
1st environment (home and office)	EN/IEC 61000-6-3 Emission standard for residential, commercial, and light industrial environments.	Class B
2nd environment (industrial environment)	EN/IEC 61000-6-4 Emission standard for industrial environments.	Class A Group 1

### NOTICE

According to the EMC Directive, a system is defined as a combination of several types of equipment, finished products, and/or components combined, designed and/or put together by the same person (system manufacturer) intended to be placed on the market for distribution as a single functional unit for an end user and intended to be installed and operated together to perform a specific task. The EMC directive applies to products/systems and installations, but in case the installation is built up of CE marked products/systems the installation can also be considered compliant with the EMC directive. Installations shall not be CE-marked.

According to the EMC Directive, Danfoss Drives as a manufacturer of product/systems is responsible for obtaining the essential requirements of the EMC directive and attaching the CE mark. For systems involving load sharing and other DC terminals, Danfoss Drives can only ensure compliance with EMC Directive when you connect combinations of Danfoss Drives products as described in our technical documentation.

If any third-party products are connected to the load share or other DC terminals on the AC drives, Danfoss Drives cannot guarantee that the EMC requirements are fulfilled.

### 9.14.3 Immunity Requirements

The immunity requirements for drives depend on the environment in which they are installed. The requirements for the industrial environment are higher than the requirements for the home and office environment. All Danfoss VLT® drives comply with the requirements for the industrial environment and therefore also comply with the lower requirements for the home and office environment with a large safety margin.

To document immunity against burst transient from electrical phenomena, the following immunity tests have been carried out on a system consisting of:

- A drive (with options if relevant).
- A shielded control cable.
- A control box with potentiometer, motor cable, and motor.

The tests were performed in accordance with the following basic standards:

- **EN 61000-4-2 (IEC 61000-4-2) Electrostatic discharges (ESD):** Simulation of electrostatic discharges from human beings.
- **EN 61000-4-3 (IEC 61000-4-3) Radiated immunity:** Amplitude modulated simulation of the effects of radar and radio communication equipment and mobile communications equipment.
- **EN 61000-4-4 (IEC 61000-4-4) Burst transients:** Simulation of interference brought about by switching a contactor, relay, or similar devices.
- **EN 61000-4-5 (IEC 61000-4-5) Surge transients:** Simulation of transients brought about by, for example, lightning that strikes near installations.
- **EN 61000-4-6 (IEC 61000-4-6) RF Common mode:** Simulation of the effect from radio-transmission equipment joined by connection cables.

The immunity requirements should follow product standard IEC 61800-3. See [Table 109](#).

Table 109: EMC Immunity, Voltage range: 200–240 V, 380–480 V

Basic standard	Burst IEC 61000-4-4	Surge IEC 61000-4-5	ESD IEC 61000-4-2	Radiated electromagnetic field IEC 61000-4-3	RF common- mode voltage IEC 61000-4-6
Acceptance crite- rion	B	B	B	A	A
Line	4 kV CM	2 kV/2 Ω DM 4 kV/12 Ω CM	–	–	10 V <sub>RMS</sub>
Motor	4 kV CM	4 kV/2 Ω <sup>(1)</sup>	–	–	10 V <sub>RMS</sub>
Brake	4 kV CM	4 kV/2 Ω <sup>(1)</sup>	–	–	10 V <sub>RMS</sub>
Load sharing	4 kV CM	4 kV/2 Ω <sup>(1)</sup>	–	–	10 V <sub>RMS</sub>
Control wires	2 kV CM	2 kV/2 Ω <sup>(1)</sup>	–	–	10 V <sub>RMS</sub>
Standard bus	2 kV CM	2 kV/2 Ω <sup>(1)</sup>	–	–	10 V <sub>RMS</sub>
Relay wires	2 kV CM	2 kV/2 Ω <sup>(1)</sup>	–	–	10 V <sub>RMS</sub>
Application and Fieldbus options	2 kV CM	2 kV/2 Ω <sup>(1)</sup>	–	–	10 V <sub>RMS</sub>

Table 109: EMC Immunity, Voltage range: 200–240 V, 380–480 V - (continued)

Basic standard	Burst IEC 61000-4-4	Surge IEC 61000-4-5	ESD IEC 61000-4-2	Radiated electromagnetic field IEC 61000-4-3	RF common- mode voltage IEC 61000-4-6
LCP cable	2 kV CM	2 kV/2 Ω <sup>(1)</sup>	–	–	10 V <sub>RMS</sub>
External 24 V DC	2 kV CM	0.5 kV/2 Ω DM 1 kV/12 Ω CM	–	–	10 V <sub>RMS</sub>
Enclosure	–	–	8 kV AD 6 kV CD	10 V/m	–

1) Injection on cable shield.

AD: Air Discharge

CD: Contact Discharge

CM: Common Mode

DM: Differential Mode

#### 9.14.4 EMC Compatibility

### NOTICE

#### OPERATOR RESPONSIBILITY

According to the EN 61800-3 standard for variable-speed drive systems, the operator is responsible for ensuring EMC compliance. Manufacturers can offer solutions for operation conforming to the standard. Operators are responsible for applying these solutions and for paying the associated costs.

There are 2 options for ensuring electromagnetic compatibility:

- Eliminate or minimize interference at the source of emitted interference.
- Increase the immunity to interference in devices affected by its reception.

#### RFI filters

The goal is to obtain systems that operate stably without radio frequency interference between components. To achieve a high level of immunity, use drives with high-quality RFI filters.


### NOTICE

In a residential environment, this product can cause radio interference, in which case supplementary mitigation measures may be required.

#### PELV and galvanic isolation compliance

All control and relay terminals comply with PELV (excluding grounded Delta leg above 400 V). To obtain galvanic (ensured) isolation, fulfill requirements for higher isolation and provide the relevant creepage/clearance distances. These requirements are described in EN 61800-5.1.

Electrical isolation is provided as shown in [Figure 86](#). The components described comply with both PELV and the galvanic isolation requirements.

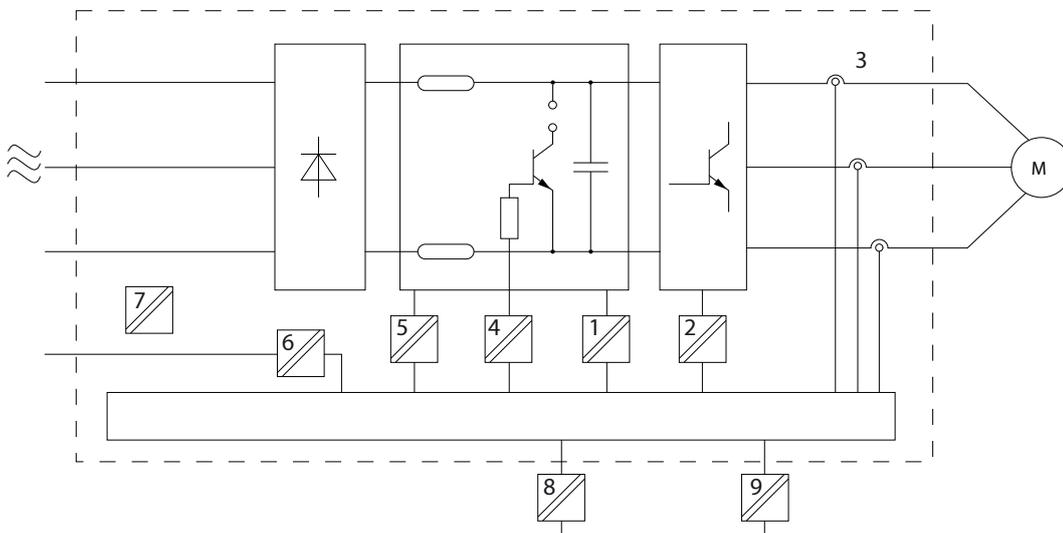

**Figure 86: Galvanic Isolation**

1	Power supply (SMPS) including signal isolation of DC link	2	Gate drive for the IGBTs
3	Current transducers	4	Opto-coupler, brake module (optional)
5	Internal inrush, RFI, and temperature measurement circuits	6	Custom relays
7	Mechanical brake	8	Functional galvanic isolation for the 24 V backup option and for the RS485 standard bus interface.
9	Functional galvanic isolation for the 24 V backup option and for the RS485 standard bus interface.		

## 9.15 Harmonics

Non-linear loads, such as found in drives, do not draw current uniformly from the power line. This non-sinusoidal current has components which are multiples of the basic current frequency. These components are referred to as harmonics. It is important to control the total harmonic distortion on the mains supply. Although the harmonic currents do not directly affect electrical energy consumption, they generate heat in the wiring and transformers that can affect other devices on the same power line.

### 9.15.1 Harmonics Analysis

Since harmonics increase heat losses, it is important to consider harmonics when designing systems to avoid overloading the transformer, the inductors, and the wiring. When necessary, perform an analysis of the system harmonics to determine equipment effects.

A non-sinusoidal current is transformed with a Fourier series analysis into sine-wave currents at different frequencies, that is, different harmonic currents  $I_N$  with 50 Hz or 60 Hz as the basic frequency.

Table 110: Harmonics-related Abbreviations

Abbreviation	Description
$f_1$	Basic frequency (50 Hz or 60 Hz)
$I_1$	Current at the basic frequency
$U_1$	Voltage at the basic frequency
$I_n$	Current at the $n^{\text{th}}$ harmonic frequency
$U_n$	Voltage at the $n^{\text{th}}$ harmonic frequency
$n$	Harmonic order

Table 111: Basic Currents and Harmonic Currents

	Basic current ( $I_1$ )	Harmonic current ( $I_n$ )		
Current	$I_1$	$I_5$	$I_7$	$I_{11}$
Frequency [Hz]	50	250	350	550

Table 112: Harmonic Currents versus RMS Input Current

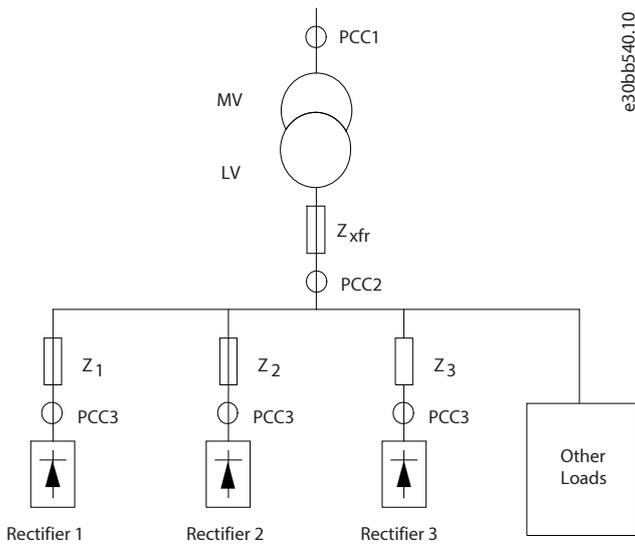
Current	Harmonic current				
	$I_{\text{RMS}}$	$I_1$	$I_5$	$I_7$	$I_{11-49}$
Input current	1.0	0.9	0.5	0.2	<0.1

The voltage distortion on the mains supply voltage depends on the size of the harmonic currents multiplied by the mains impedance for the frequency in question. The total voltage distortion (THDi) is calculated based on the individual voltage harmonics using this formula:

$$\text{THDi} = \frac{\sqrt{I_5^2 + I_7^2 + \dots + I_n^2}}{I}$$

### 9.15.2 Effect of Harmonics in a Power Distribution System

In [Figure 87](#), a transformer is connected on the primary side to a point of common coupling PCC1 on the medium voltage supply. The transformer has an impedance  $Z_{\text{xf}}$  and feeds several loads. The point of common coupling where all loads are connected together is PCC2. Each load is connected through cables that have an impedance  $Z_1, Z_2, Z_3$ .



e30bb540.10

Figure 87: Small Distribution System

Harmonic currents drawn by non-linear loads cause distortion of the voltage because of the voltage drop on the impedances of the distribution system. Higher impedances result in higher levels of voltage distortion.

Current distortion relates to apparatus performance and it relates to the individual load. Voltage distortion relates to system performance. It is not possible to determine the voltage distortion in the PCC knowing only the load's harmonic performance. To predict the distortion in the PCC, the configuration of the distribution system and relevant impedances must be known.

A commonly used term for describing the impedance of a grid is the short circuit ratio  $R_{sce}$ .  $R_{sce}$  is defined as the ratio between the short circuit apparent power of the supply at the PCC ( $S_{sc}$ ) and the rated apparent power of the load ( $S_{equ}$ ).


$$R_{sce} = \frac{S_{sc}}{S_{equ}}$$

Where

$$S_{sc} = \frac{U^2}{Z_{supply}} \text{ and } S_{equ} = U \cdot I_{equ}$$

**The negative effect of harmonics is twofold**

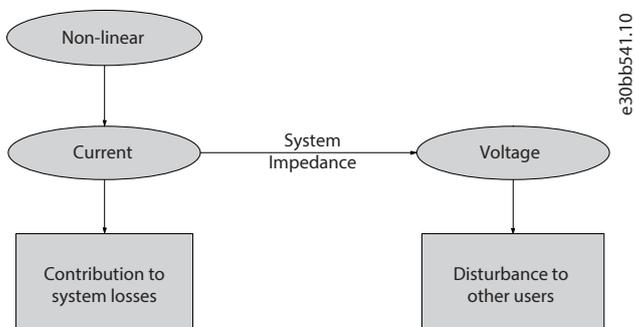- Harmonic currents contribute to system losses (in cabling, transformer).
- Harmonic voltage distortion causes disturbance to other loads and increase losses in other loads.



e30bb541.10

Figure 88: Negative Effects of Harmonics

### 9.15.3 IEC Harmonic Standards

In most of Europe, the basis for the objective assessment of the quality of mains power is the Electromagnetic Compatibility for Devices Act (EMVG). Compliance with these regulations ensures that all devices and networks connected to electrical distribution systems fulfill their intended purpose without generating problems.

**Table 113: EN Design Standards for Mains Power Quality**

Standard	Definition
EN 61000-2-2, EN 61000-2-4, EN 50160	Define the mains voltage limits required for public and industrial power grids.
EN 61000-3-2, 61000-3-12	Regulate mains interference generated by connected devices in lower current products.
EN 61800-3	Monitors electronic equipment for use in power installations.

There are 2 European standards that address harmonics in the frequency range from 0 Hz to 9 kHz:

- EN 61000-2-2 Compatibility Levels for Low-Frequency Conducted Disturbances and Signaling in Public Low-Voltage Power Supply Systems.
- EN 61000-2-4 Compatibility Levels for Low-Frequency Conducted Disturbances and Signaling in Industrial Plants.

The EN 61000-2-2 standard states the requirements for compatibility levels for PCC (point of common coupling) of low voltage AC systems on a public supply network. Limits are specified only for harmonic voltage and total harmonic distortion of the voltage. EN 61000-2-2 does not define limits for harmonic currents. In situations where the total harmonic distortion THD<sub>v</sub>=8%, PCC limits are identical to those limits specified in the EN 61000-2-4 Class 2.

The EN 61000-2-4 standard states the requirements for compatibility levels in industrial and private networks. The standard further defines the following 3 classes of electromagnetic environments:

- Class 1 relates to compatibility levels that are less than the public supply network, which affects equipment sensitive to disturbances (lab equipment, some automation equipment, and certain protection devices).
- Class 2 relates to compatibility levels that are equal to the public supply network. The class applies to PCCs on the public supply network and to IPCs (internal points of coupling) on industrial or other private supply networks. Any equipment designed for operation on a public supply network allowed in this class.
- Class 3 relates to compatibility levels greater than the public supply network. This class applies only to IPCs in industrial environments. Use this class where the following equipment is found:
  - Large drives.
  - Welding machines.
  - Large motors starting frequently.
  - Loads that change quickly.

Typically, a class cannot be defined ahead of time without considering the intended equipment and processes to be used in the environment.

Table 114: Compatibility Levels for Harmonics

Harmonic order (h)	Class 1 (V <sub>h</sub> %)	Class 2 (V <sub>h</sub> %)	Class 3 (V <sub>h</sub> %)
5	3	6	8
7	3	5	7
11	3	3.5	5
13	3	3	4.5
17	2	2	4
17<h≤49	2.27 x (17/h) - 0.27	2.27 x (17/h) - 0.27	4.5 x (17/h) - 0.5

Table 115: Compatibility Levels for the Total Harmonic Voltage Distortion THDv

	Class 1	Class 2	Class 3
THDv	5%	8%	10%

### 9.15.4 Harmonic Results (Emission)

Power sizes from P1K1 (1.1 kW) up to P18K (18.5 kW) in T2 (200–240 V) and up to P90K (90 kW) in T4 (380–480 V) fulfill the limits within IEC/EN 61000-3-12:2011, table 4.

Power sizes P110-P450 (110 kW–450 kW) in T4 (380–480 V) also comply with IEC/EN 61000-3-12:2011 even though not required because currents are above 75 A. Typical harmonic line current emission values for R<sub>SCE</sub> above 120 are shown in [Table 116](#) for power sizes below 90 kW and in [Table 117](#) for power sizes above 90 kW.

Table 116: Typical Harmonic Emission Values for VLT® Drives FC 102, FC 103, FC 202, FC 302 below 90 kW

	Individual harmonic current I <sub>h</sub> /I <sub>ref</sub> (%)			
	I5	I7	I11	I13
Typical value	38	20	10	8
Limit for R <sub>SCE</sub> ≥ 120 <sup>(1)</sup>	40	25	15	10
	THC/I <sub>ref</sub>		PWHC/I <sub>ref</sub>	
	Typical value <sup>(2)</sup>		41	
Limit for R <sub>SCE</sub> ≥ 120 <sup>(1)</sup>	48		46	

1) According to IEC 61000-3-12:2011

2) The value depends on voltage range, power size and other factors. Contact Danfoss to get information on specific values.

Table 117: Typical Harmonic Emission Values for VLT® Drives FC 102, FC 103, FC 202, FC 302 above 90 kW

	Individual harmonic current I <sub>h</sub> /I <sub>ref</sub> (%)			
	I5	I7	I11	I13
Typical value	38	20	10	8
Limit for R <sub>SCE</sub> ≥ 120 <sup>(1)</sup>	(no limit applies because currents are above 75A)			
Harmonic current distortion factor (%)				

Table 117: Typical Harmonic Emission Values for VLT® Drives FC 102, FC 103, FC 202, FC 302 above 90 kW - (continued)

	THC/Iref	PWHC/Iref
Typical value <sup>(2)</sup>	40	39
Limit for $R_{SCE} \geq 120$ <sup>(1)</sup>	(no limit applies because currents are above 75A)	

1) According to IEC 61000-3-12:2011

2) The value depends on voltage range, power size and other factors. Contact Danfoss to get information on specific values.

### NOTICE

It is the responsibility of the installer or user of the equipment to ensure that the equipment is connected only to a supply with a short-circuit power  $S_{SC}$  which is greater than or equal to what is specified below at the interface point between the users supply and the public system ( $R_{SCE}$ ). If necessary, consult the distribution network operator.

$$S_{SC} = \sqrt{3} \times R_{SCE} \times U_{mains} \times I_{equ} = \sqrt{3} \times 120 \times 400 \times I_{equ}$$

Other power sizes can be connected to the public supply network by consultation with the distribution network operator.

### 9.15.5 Harmonic Mitigation

In cases where extra harmonic suppression is required, Danfoss offers a wide range of mitigation equipment. These are:

- VLT® 12-pulse drives.
- VLT® AHF filters.
- VLT® Low Harmonic Drives.
- VLT® Active Filters.

The right solution depends on several factors:

- The grid (background distortion, mains unbalance, resonance, and type of supply (transformer/generator)).
- Application (load profile, number of loads, and load size).
- Local/national requirements/regulations (IEEE 519, IEC, G5/4, and so on).
- Total cost of ownership (initial cost, efficiency, maintenance, and so on).

### 9.15.6 Harmonic Calculation

To determine the degree of voltage pollution on the grid and needed precaution, use the Danfoss MyDrive® Harmonics calculation software. The free tool can be downloaded from [harmonics.mydrive.danfoss.com/](https://harmonics.mydrive.danfoss.com/).

### 9.15.7 Line Reactors

A line reactor is an inductor which is wired in series between a power source and a load. Line reactors, also called input AC reactors, are used in motor drive applications.

The main function of the line reactor is to limit the current. Line reactors also reduce the main harmonics, limit the inrush currents, and protect drives and motors. Line reactors help achieving an overall improvement of the true power factor and the quality of the input current waveform.

Line reactors are classified by their percent impedance (denoted as percent IZ or %IZ), which is the voltage drop due to impedance at the rated current expressed as a percent of rated voltage. The most common line reactors have either 3% or 5% impedance.

## When to use line reactors

It is important to consider where to install the drives. In some situations, disturbances from the grid can damage the drive and precautions must be taken to avoid this situation. To avoid disturbances, ensure that there is only a minimum of impedance in front of the drive. Refer to [9.15.5 Harmonic Mitigation](#) for advice on mitigation.

When calculating the impedance, also include the contribution from the supply transformer and the supply cables. In the following situations, add impedance (line reactor or transformer) in front of the drive:

- The installation site has switched power factor correction capacitors.
- The installation site has lightning strikes or voltage spikes.
- The installation site has power interruptions or voltage dips.
- The transformer is too large compared to the drive.

Also, when planning load sharing applications, pay special attention to different enclosure size combinations and inrush concepts. For technical advice on load sharing applications, contact Danfoss application support.

## 9.16 EMC-compliant Installation

To obtain an EMC-compliant installation, be sure to follow all electrical installation instructions.

Also, remember to practice the following:

- When using relays, control cables, a signal interface, fieldbus, or brake, connect the shield to the enclosure at both ends. If the ground path has high impedance, is noisy, or is carrying current, break the shield connection on 1 end to avoid ground current loops.
- Convey the currents back to the unit using a metal mounting plate. Ensure good electrical contact from the mounting plate by securely fastening the mounting screws to the drive chassis.
- Use shielded cables for motor output cables. An alternative is unshielded motor cables within metal conduit.
- Ensure that motor and brake cables are as short as possible to reduce the interference level from the entire system.
- Avoid placing cables with a sensitive signal level alongside motor and brake cables.
- For communication and command/control lines, follow the particular communication protocol standards. For example, USB must use shielded cables, but RS485/ethernet can use shielded UTP or unshielded UTP cables.
- Ensure that all control terminal connections are rated protective extra low voltage (PELV).

### NOTICE

#### TWISTED SHIELD ENDS (PIGTAILS)

Twisted shield ends increase the shield impedance at higher frequencies, which reduces the shield effect and increases the leakage current.

- Use integrated shield clamps instead of twisted shield ends.

### NOTICE

#### SHIELDED CABLES

If shielded cables or metal conduits are not used, the unit and the installation do not meet regulatory limits on radio frequency (RF) emission levels.

**NOTICE****EMC INTERFERENCE**

Failure to isolate power, motor, and control cables can result in unintended behavior or reduced performance.

- Use shielded cables for motor and control wiring.
- Provide a minimum 200 mm (7.9 in) separation between mains input, motor cables, and control cables.

**NOTICE****INSTALLATION AT HIGH ALTITUDE**

There is a risk for overvoltage. Isolation between components and critical parts could be insufficient and may not comply with PELV requirements.

- Use external protective devices or galvanic isolation. For installations above 2000 m (6500 ft) altitude, contact Danfoss regarding protective extra low voltage (PELV) compliance.

**NOTICE****PROTECTIVE EXTRA LOW VOLTAGE (PELV) COMPLIANCE**

Avoid electric shock by using PELV electrical supply and complying with local and national PELV regulations.

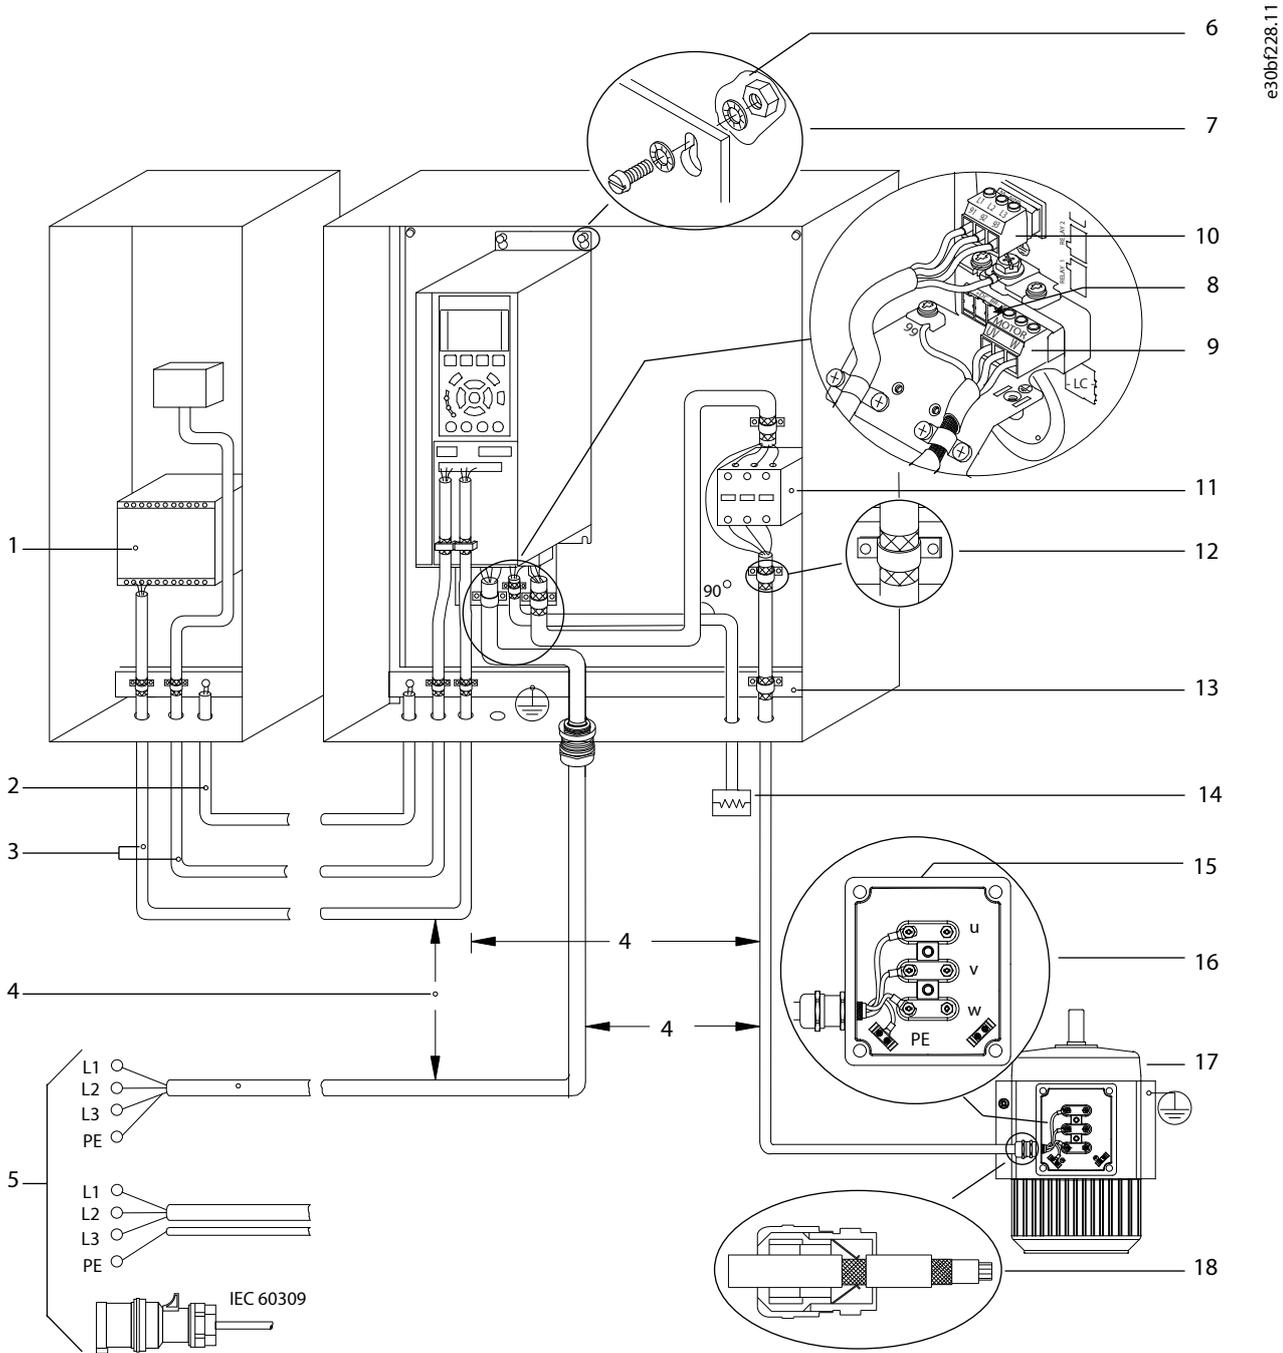


Figure 89: Example of Proper EMC Installation

1	Programmable logic controller (PLC)	2	Minimum 16 mm <sup>2</sup> (6 AWG) equalizing cable
3	Control cables	4	Minimum 200 mm (7.9 in) between control cables, motor cables, and mains cables
5	Mains supply options, see IEC/EN 61800-5-1	6	Bare (unpainted) surface
7	Star washers	8	Brake cable (shielded) – not shown, but the same grounding principle applies as for motor cable
9	Motor cable (shielded)	10	Mains cable (unshielded)
11	Output contactor, and so on	12	Cable insulation stripped

13	Common ground busbar. Follow local and national requirements for cabinet grounding	14	Brake resistor
15	Terminal box	16	Connection to motor
17	Motor	18	EMC cable gland

## 9.17 Connections

### 9.17.1 Power Connections

#### NOTICE

All cabling must comply with national and local regulations on cable cross-sections and ambient temperature. UL applications require 75 °C (167 °F) copper conductors. Non-UL applications can use 75 °C (167 °F) and 90 °C (194 °F) copper conductors.

#### NOTICE

The plug connector for power is pluggable on drives up to 7.5 kW (10 hp).

The power cable connections are located as shown in [Figure 90](#). See the *Electrical Data* section for correct dimensioning or motor cable cross-section and length. For protection of the drive, use the recommended fuses listed in the *Fuses and Circuit Breaker* section unless the unit has built-in fuses. Ensure that proper fusing complies with local regulations. The connection of mains is fitted to the mains switch, if included.

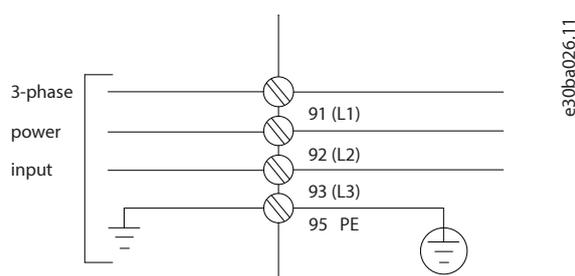


Figure 90: Connection of Mains

#### Aluminum conductors

Terminals can accept aluminum conductors, but the conductor surface must be clean, and the oxidation must be removed and sealed by neutral, acid-free Vaseline grease before the conductor is connected. Furthermore, the terminal screw must be retightened after 2 days due to the softness of the aluminum. It is crucial to keep the connection in a gas tight joint, otherwise the aluminum surface oxidizes again.

#### NOTICE

The motor cable must be shielded/armored. If an unshielded/unarmored cable is used, some EMC requirements are not complied with. Use a shielded/armored motor cable to comply with EMC emission specifications.

For more information on EMC, see [9.16 EMC-compliant Installation](#).

## Shielding of cables

Avoid installation with twisted shield ends (pigtailed). They spoil the shielding effect at higher frequencies. If it is necessary to break the shield to install a motor isolator or contactor, continue the shield at the lowest possible HF impedance. Connect the motor cable shield to both the decoupling plate of the drive and the metal housing of the motor. Make the shield connections with the largest possible surface area (cable clamp) by using the installation devices within the drive.

## Cable length and cross-section

The drive has been EMC-tested with a given length of cable. Keep the motor cable as short as possible to reduce noise level and leakage currents.

## Switching frequency

When drives are used together with sine-wave filters to reduce the acoustic noise from a motor, the switching frequency must be set according to the instructions in parameter **14-01 Switching Frequency**.

### NOTICE

In motors without phase insulation, paper, or other insulation reinforcement suitable for operation with a voltage supply, use a sine-wave filter on the output of the drive.

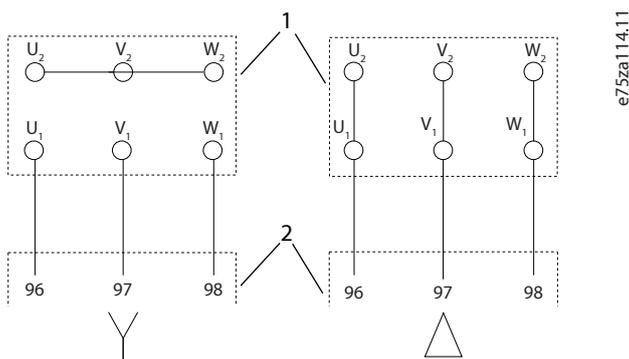


Figure 91: Motor Cable Connection

1	Motor	2	Drive
---	-------	---	-------

## 9.17.2 IT Grid Connection

### Mains supply isolated from ground

If the drive is supplied from an isolated mains source (IT mains, floating delta, or grounded delta) or TT/TN-S mains with grounded leg, the RFI switch is recommended to be turned off via parameter **14-50 RFI Filter** on the drive and parameter **14-50 RFI Filter** on the filter. For more detail, see IEC 364-3. In the off position, the filter capacitors between the chassis and the DC link are cut off to avoid damage to the DC link and to reduce the ground capacity currents, according to IEC 61800-3. If optimum EMC performance is needed, or parallel motors are connected, or the motor cable length is above 25 m (82 ft), Danfoss recommends setting parameter **14-50 RFI Filter** to [1] **On**. Refer also to the *Application Note, VLT on IT Grid*. It is important to use isolation monitors that are rated for use together with power electronics (IEC 61557-8).

Danfoss does not recommend using an output contactor for 525–690 V drives connected to an IT mains network.

### 9.17.3 DC-Bus Connection

#### NOTICE

##### EMC REQUIREMENTS

According to the EMC Directive, a system is defined as a combination of several types of equipment, finished products, and/or components combined, designed and/or put together by the same person (system manufacturer) intended to be placed on the market for distribution as a single functional unit for an end user and intended to be installed and operated together to perform a specific task.

The EMC directive applies to products/systems and installations, but in case the installation is built up of CE-marked products/systems, the installation can also be considered compliant with the EMC directive. Installations shall not be CE-marked.

According to the EMC Directive, Danfoss Drives as a manufacturer of product/systems is responsible for obtaining the essential requirements of the EMC directive and attaching the CE mark. For systems involving load sharing and other DC terminals, Danfoss Drives can only ensure compliance to EMC Directive when you connect combinations of Danfoss Drives products as described in our technical documentation.

If any third-party products are connected to the load share or other DC terminals on the AC drives, Danfoss Drives cannot guarantee that the EMC requirements are fulfilled.

The DC bus terminal is used for DC backup, with the DC link being supplied from an external source.

Terminals	Function
88, 89	DC bus

### 9.17.4 Load Sharing Connection

#### NOTICE

##### EMC REQUIREMENTS

According to the EMC Directive, a system is defined as a combination of several types of equipment, finished products, and/or components combined, designed and/or put together by the same person (system manufacturer) intended to be placed on the market for distribution as a single functional unit for an end user and intended to be installed and operated together to perform a specific task.

The EMC directive applies to products/systems and installations, but in case the installation is built up of CE-marked products/systems, the installation can also be considered compliant with the EMC directive. Installations shall not be CE-marked.

According to the EMC Directive, Danfoss Drives as a manufacturer of product/systems is responsible for obtaining the essential requirements of the EMC directive and attaching the CE mark. For systems involving load sharing and other DC terminals, Danfoss Drives can only ensure compliance with EMC Directive when you connect combinations of Danfoss Drives products as described in our technical documentation.

If any third-party products are connected to the load share or other DC terminals on the AC drives, Danfoss Drives cannot guarantee that the EMC requirements are fulfilled.

Load sharing links together the DC links of several drives. For an overview, see [5.3 Load Sharing](#).

The load sharing feature requires extra equipment and safety considerations. Consult Danfoss for ordering and installation recommendations.

Terminals	Function
88, 89	Load sharing

### 9.17.5 Brake Cable Connection

The connection cable to the brake resistor must be shielded and the maximum length from the drive to the DC bar is limited to 25 m (82 ft).

- Use cable clamps to connect the shield to the conductive mounting plate on the drive and to the metal cabinet of the brake resistor.
- Size the brake cable cross-section to match the brake torque.

Terminals	Function
81, 82	Brake resistor terminals

See the *VLT® Brake Resistor MCE 101 Design Guide* for more details.

#### NOTICE

If a short circuit in the brake module occurs, avoid excessive power dissipation in the brake resistor by using a mains switch or contactor to disconnect the mains from the drive.

### 9.17.6 Grounding

To obtain electromagnetic compatibility (EMC), consider the following basic issues when installing a drive.

- Safety grounding: The drive has a high leakage current and must be grounded appropriately for safety reasons. Apply local safety regulations.
- High-frequency grounding: Keep the ground wire connections as short as possible.

Connect the different ground systems at the lowest possible conductor impedance. The lowest possible conductor impedance is obtained by keeping the conductor as short as possible and by using the greatest possible surface area. The metal cabinets of the different devices are mounted on the cabinet rear plate using the lowest possible HF impedance. This method avoids having different HF voltages for the individual devices and avoids the risk of radio interference currents running in connection cables that may be used between the devices. The radio interference has been reduced. To obtain a low HF impedance, use the fastening bolts of the devices as HF connection to the rear plate. It is necessary to remove insulating paint or similar from the fastening points.

### 9.17.7 Safety Ground Connection

#### WARNING

##### LEAKAGE CURRENT HAZARD

Leakage currents exceed 3.5 mA. Failure to ground the drive properly can result in death or serious injury.

- Ensure the correct grounding of the equipment by a certified electrical installer.

The drive has a high leakage current and must be grounded appropriately for safety reasons according to IEC 61800-5-1.

## 10 Basic Operating Principles

### 10.1 Introduction

This chapter provides an overview of the primary assemblies and circuitry of a Danfoss VLT® drive. It describes the internal electrical and signal processing functions. A description of the internal control structure is also included.

### 10.2 Drive Controls

A drive is an electronic controller that supplies a regulated amount of AC power to a 3-phase inductive motor. By supplying variable frequency and voltage to the motor, the drive varies the motor speed or maintains a constant speed as the load on the motor changes. Also, the drive can stop and start a motor without the mechanical stress associated with a line start.

In its basic form, the drive can be divided into 4 main areas:

- A rectifier consisting of SCRs or diodes that convert 3-phase AC voltage to pulsating DC voltage.
- A DC link consisting of inductors and their capacitor banks that stabilize the pulsating DC voltage.
- An inverter using IGBTs to convert the DC voltage to variable voltage and variable frequency AC.
- A control area consisting of software that runs the hardware to produce the variable voltage that controls and regulates the AC motor.

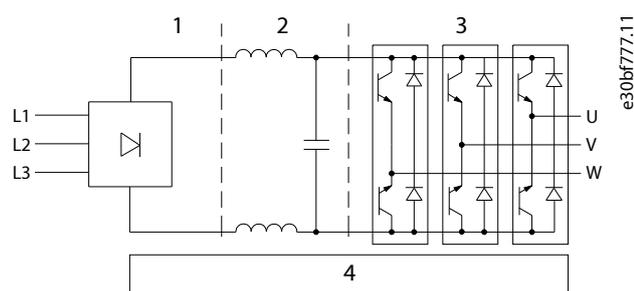


Figure 92: Internal Processing

1	Rectifier (SCR/diodes)	2	DC link (DC bus)
3	Inverter (IGBTs)	4	Control area

#### 10.2.1 Control Principle

The control structure is a software process that controls the motor based on user-defined references, for example RPM, and whether feedback is used or not (closed loop/open loop). The operator defines the control by selecting the configuration mode.

The control structures are as follows:

- Open-loop control structure:
  - Speed (RPM).
  - Torque (Nm).
- Closed-loop control structure:
  - Speed (RPM).
  - Torque (Nm).

- o Process (user-defined units, for example, ft, rpm, psi, %, and bar).

**User inputs/references**

The drive uses an input source (also called reference) to control and regulate the motor. The drive receives this input either:

- Manually via the LCP. This method is referred to as local (hand on).
- Remotely via analog/digital inputs and various serial interfaces (RS485, USB, or an optional fieldbus). This method is referred to as remote (auto on) and is the default input setting. See more details in [10.2.2 Local \(Hand On\) and Remote \(Auto On\) Control](#).

**10.2.2 Local (Hand On) and Remote (Auto On) Control**

Active reference refers to the active input source. The active reference is configured via parameters. For more information, refer to the product-specific programming guide.

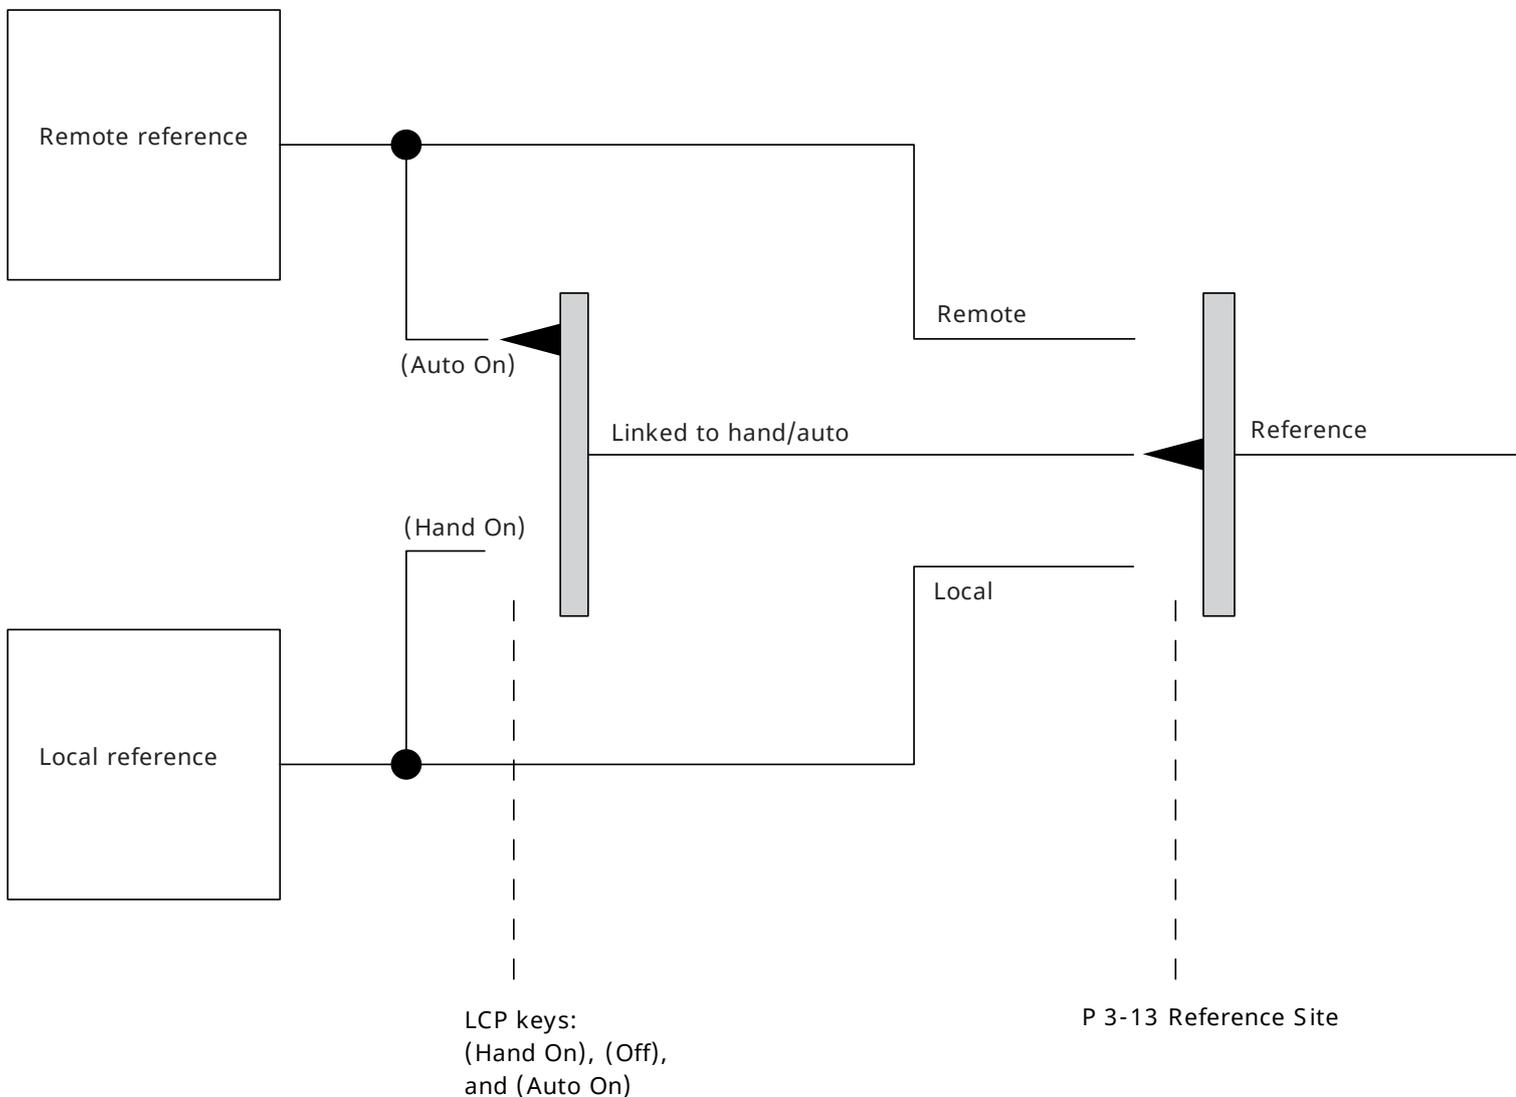


Figure 93: Selecting Active Reference

Remote handling of references applies to both open-loop and closed-loop operation. Up to 8 internal preset references can be programmed into the drive. The active internal preset reference can be selected externally through digital control inputs or through the serial communication bus.

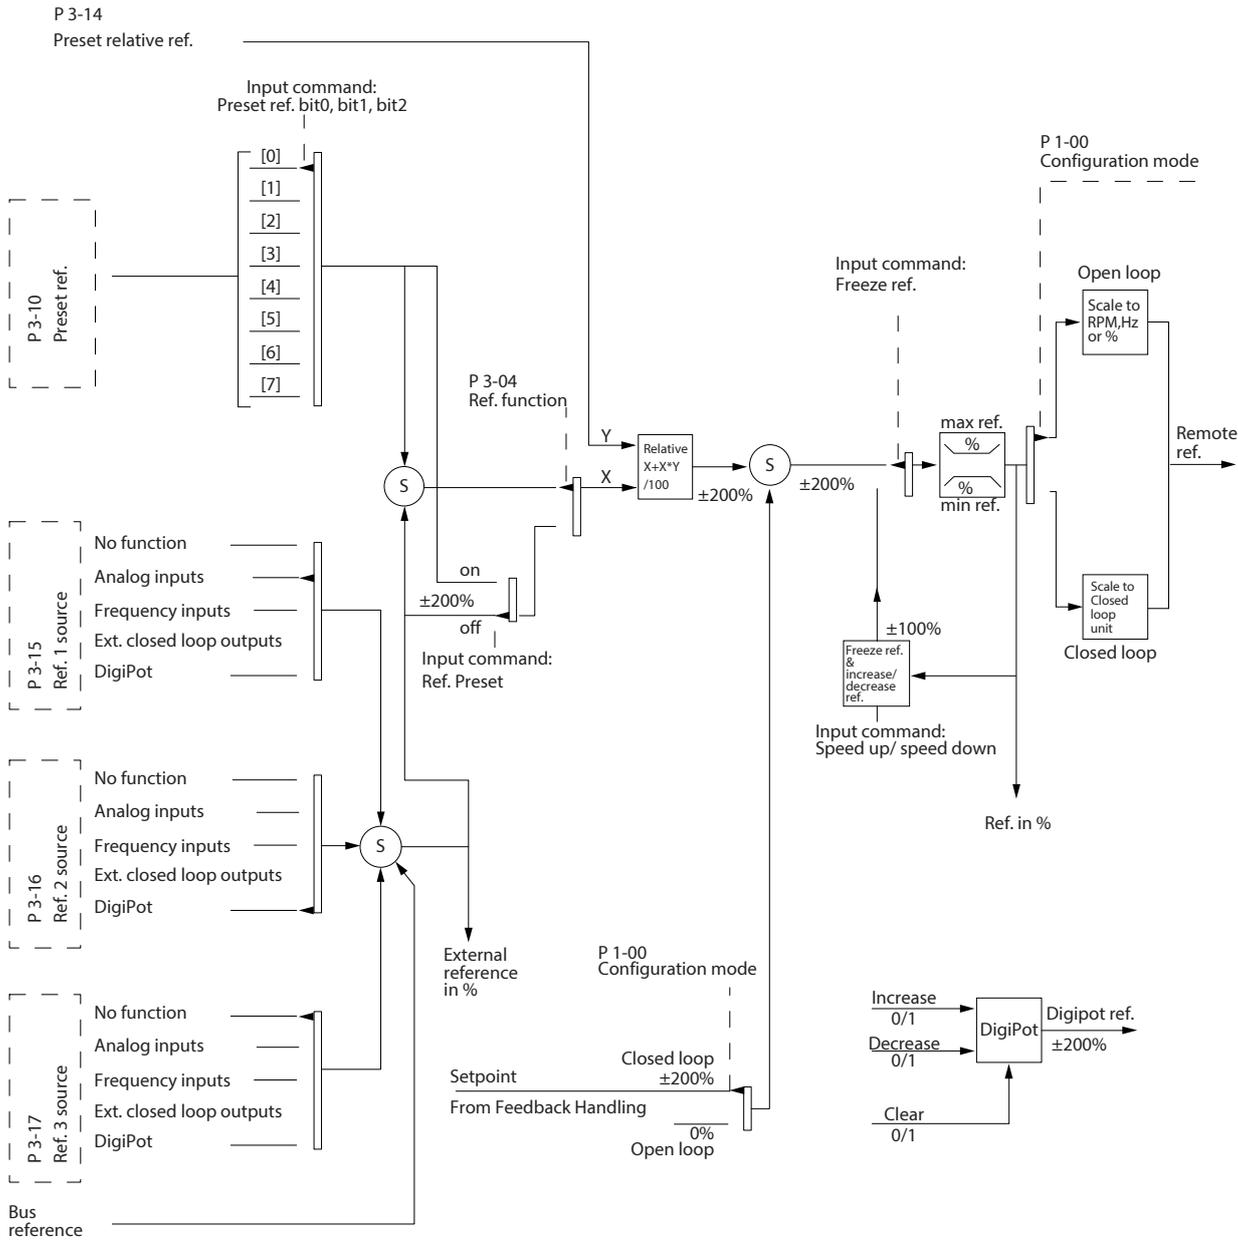
External references can also be supplied to the drive, most commonly through an analog control input. All reference sources and the bus references are added to produce the total external reference. The active reference can be selected from the following:

- External reference.
- Preset reference.
- Setpoint.
- Sum of the external reference, preset reference, and setpoint.

The active reference can be scaled. The scaled reference is calculated as follows:

$$\text{Reference} = X + X \times \left( \frac{Y}{100} \right)$$

X is the external reference, the preset reference, or the sum of these references, and Y is the internal preset relative reference I %. If Y, parameter **3-14 Preset Relative Reference**, is set to 0%, the scaling does not affect the reference.



e30ba357.13

Figure 94: Remote Handling of Reference

### 10.3 Reference Limits

The reference range, minimum reference, and maximum reference define the allowed range of the sum of all references. The sum of all references is clamped when necessary. The relation between the resulting reference (after clamping) and the sum of all references are shown in [Figure 95](#) and [Figure 96](#).

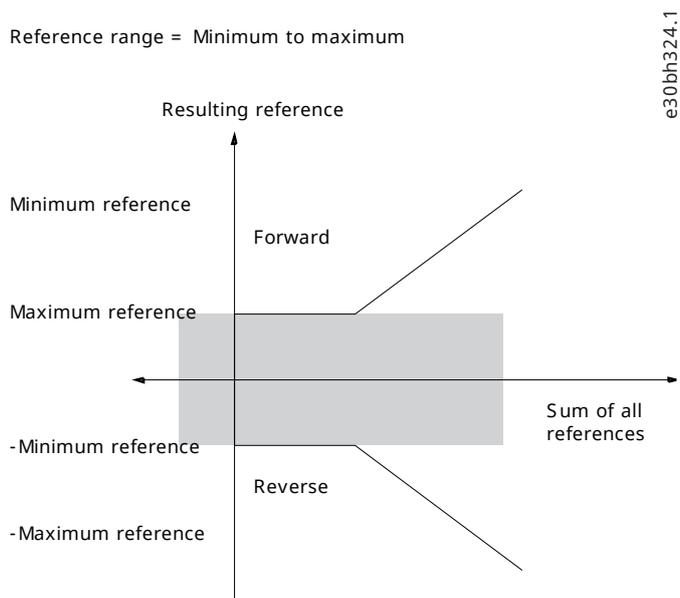


Figure 95: Sum of All References When the Reference Range is Set to 0

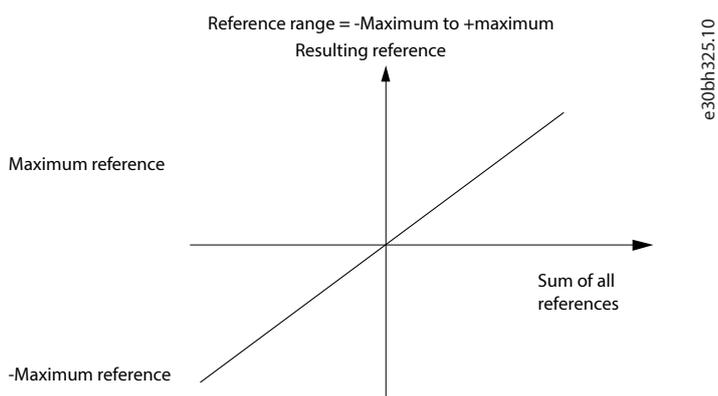


Figure 96: Sum of All References When the Reference Range is Set to 1

The minimum reference cannot be set to less than 0, unless the configuration mode is set to Process. In that case, the following relations between the resulting reference (after clamping) and the sum of all references are as shown in [Figure 97](#).

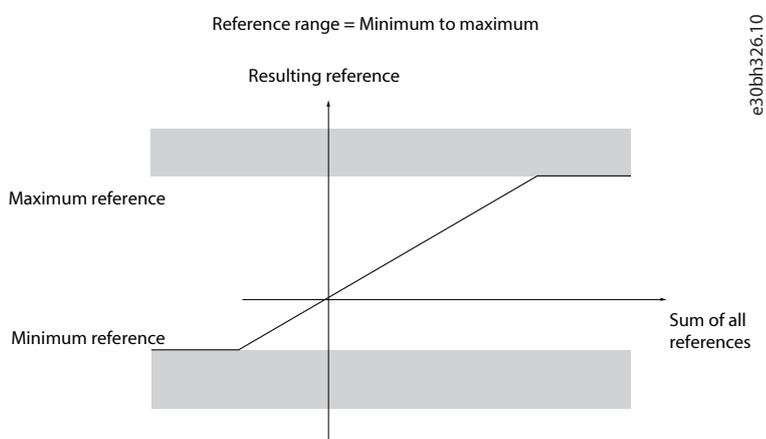


Figure 97: Sum of all References when Configuration Mode is set to Process

## 10.4 Control Principle

The drive rectifies the AC voltage from mains into DC voltage, after which the DC voltage is converted into an AC current with a variable amplitude and frequency.

The drive supplies the motor with variable voltage/current and frequency, standard induction motors, and non-salient permanent magnet motors.

The drive manages various motor control principles such as U/f special motor mode and VVC<sup>+</sup>. Short circuit behavior of the drive depends on the 3 current transducers in the motor phases.

The VLT® drives can run in open-loop and closed-loop application. Select the configuration mode when programming the drive.

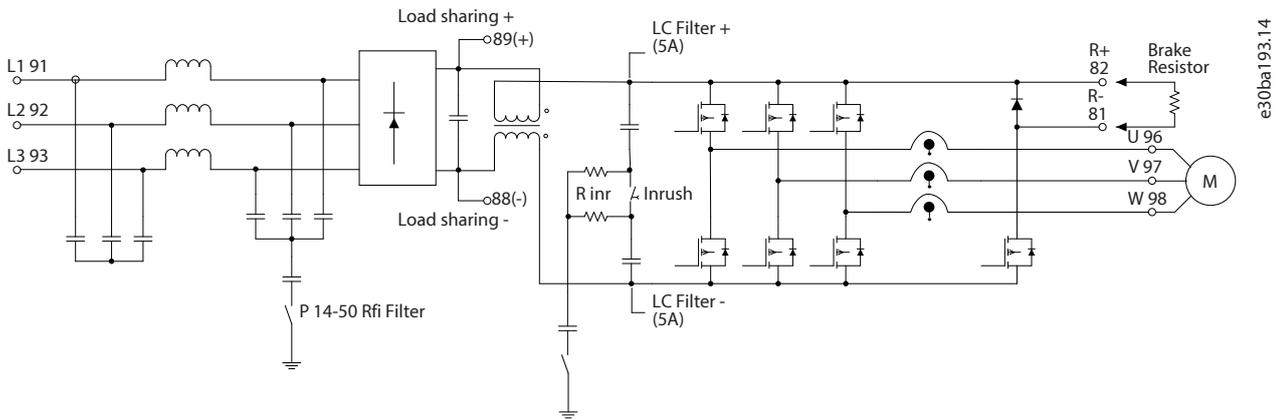


Figure 98: Control Structure Diagram

### 10.4.1 Control Structure Open Loop

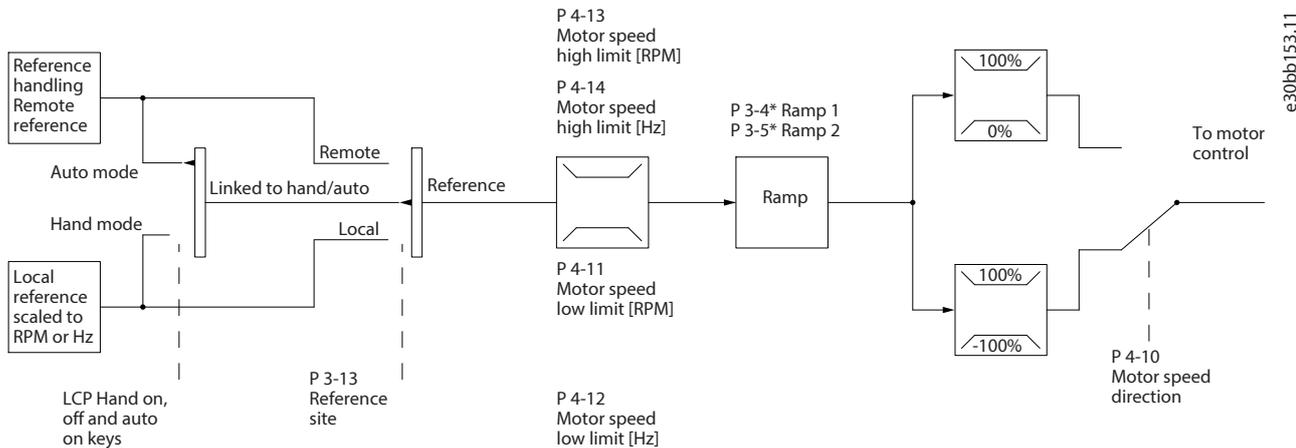


Figure 99: Open-loop Structure

In open-loop configurations, the resulting reference from the reference handling system or the local reference is received and fed through the ramp limitation and speed limitation before being sent to the motor control.

The output from the motor control is then limited by the maximum frequency limit.

## 10.4.2 Control Structure Closed Loop

The internal controller allows the drive to become a part of the controlled system. The drive receives a feedback signal from a sensor in the system. It then compares this feedback to a setpoint reference value and determines the error, if any, between these 2 signals. It then adjusts the speed of the motor to correct this error.

For example, consider a pump application where the speed of a pump is to be controlled to ensure a constant static pressure in a pipe. The static pressure value is supplied to the drive as the setpoint reference. A static pressure sensor measures the actual static pressure in the pipe and supplies this data to the drive as a feedback signal. If the feedback signal is greater than the setpoint reference, the drive slows the pump down to reduce the pressure. In a similar way, if the pipe pressure is lower than the setpoint reference, the drive automatically speeds the pump up to increase the pressure provided by the pump.

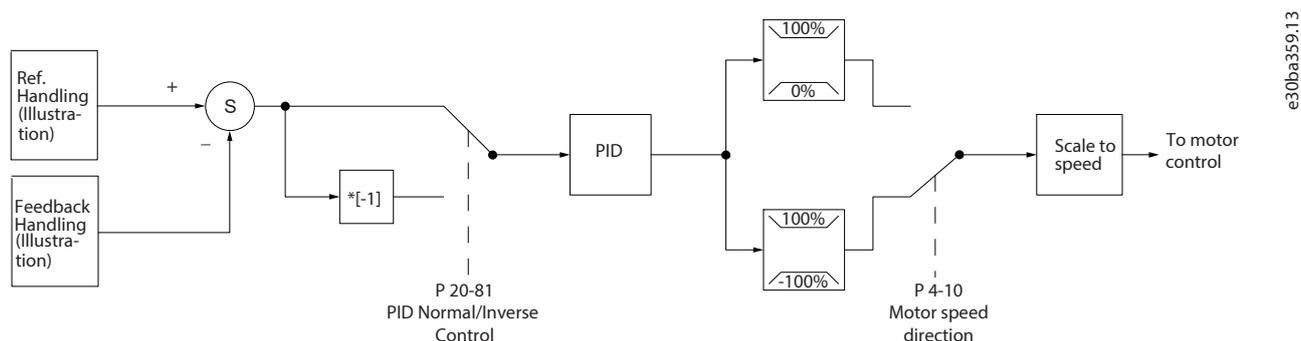


Figure 100: Control Structure Closed-loop

While the default values for the closed-loop controller of the drive often provide satisfactory performance, the control of the system can often be optimized by adjusting parameters. It is also possible to autotune the PI constants.

## 10.4.3 Example of Closed-loop PID Control

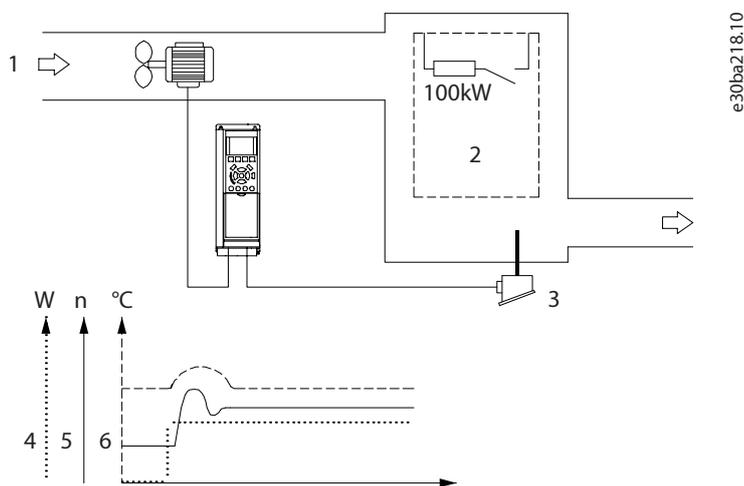


Figure 101: Closed-loop Control in a Ventilation System

In a ventilation system, the temperature is to be maintained at a constant value. The temperature is set from  $-5\text{ }^{\circ}\text{C}$  ( $23\text{ }^{\circ}\text{F}$ ) to  $+35\text{ }^{\circ}\text{C}$  ( $95\text{ }^{\circ}\text{F}$ ) using a 0–10 V potentiometer. Because this is a cooling application, the speed of the fan must be increased to provide more cooling airflow if the temperature is above the setpoint value. The temperature sensor has a range of  $-10\text{ }^{\circ}\text{C}$  ( $14\text{ }^{\circ}\text{F}$ ) to  $+40\text{ }^{\circ}\text{C}$  ( $104\text{ }^{\circ}\text{F}$ ) and uses a 2-wire transmitter to provide a 4–20 mA signal. The output frequency range of the drive is 10–50 Hz.

- Start/stop via switch connected between terminals 12 (+24 V) and 18.
- Temperature reference via a potentiometer ( $-5\text{ }^{\circ}\text{C}$  ( $23\text{ }^{\circ}\text{F}$ ) to  $+35\text{ }^{\circ}\text{C}$  ( $95\text{ }^{\circ}\text{F}$ ), 0–10 V) connected to terminals 50 (+10 V), 53 (input), and 55 (common).

- Temperature feedback via transmitter (-10 °C (14 °F) to +40 °C (104 °F), 4–20 mA) connected to terminal 54. Switch S202 behind the LCP set to ON (current input).

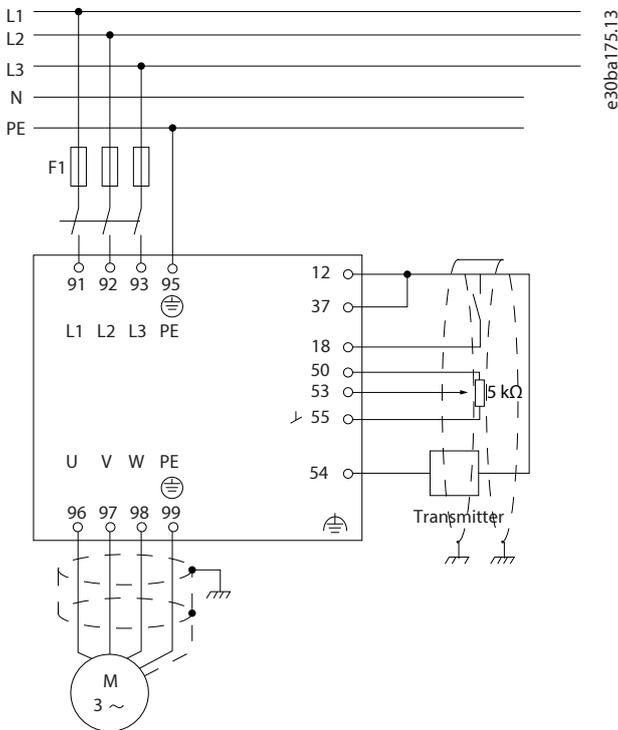


Figure 102: Example of Closed-loop PID Control

### 10.4.4 Control Structure in VVC+

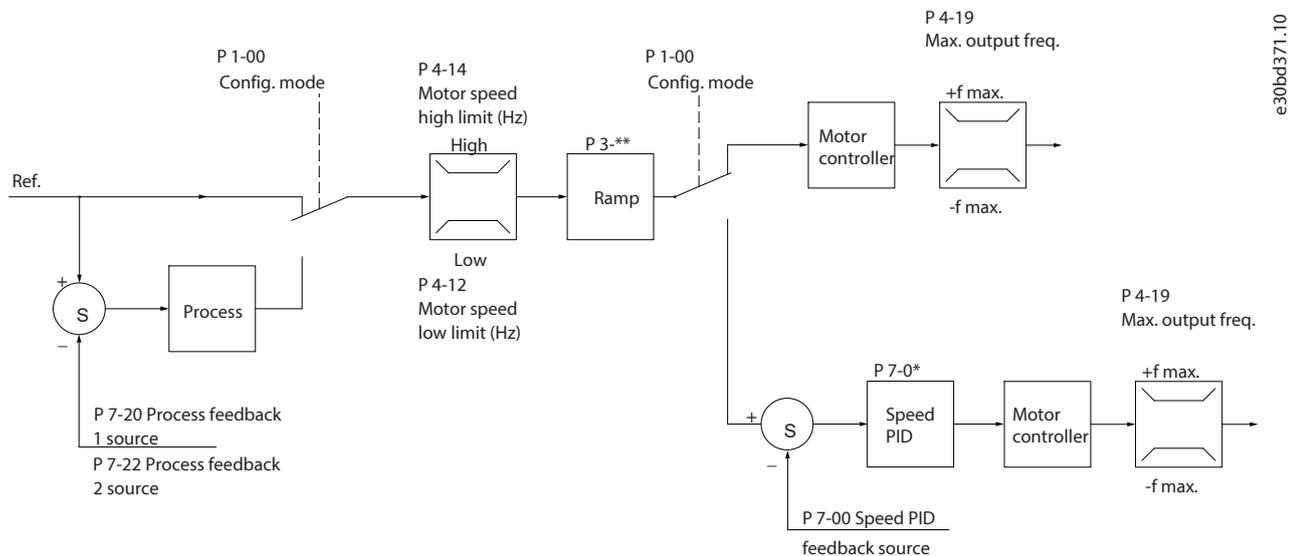


Figure 103: Control Structure in VVC+ Open-loop Configurations and Closed-loop Configurations

In the configuration shown in the above illustration, parameter **1-01 Motor Control Principle** is set to **[1] VVC+** and parameter **1-00 Configuration Mode** is set to **[0] Speed open loop**. The resulting reference from the reference handling system is received and fed through the ramp limitation and speed limitation before being sent to the motor control. The output of the motor control is then limited by the maximum frequency limit.

If parameter **1-00 Configuration Mode** is set to **[1] Speed closed loop**, the resulting reference is passed from the ramp limitation and speed limitation into a Speed PID control. The Speed PID control parameters are in parameter group **7-0\* Speed PID Ctrl.** The resulting reference from the Speed PID control is sent to the motor control limited by the frequency limit.

Select **[3] Process** in parameter **1-00 Configuration Mode** to use the process PID control for closed-loop control of speed or pressure in the controlled application. The process PID parameters are in parameter groups **7-2\* Process Ctrl. Feedb** and **7-3\* Process PID Ctrl.**

# 11 Basic I/O Configurations

## 11.1 Application Examples

The examples in this section are intended as a quick reference for common applications.

- Parameter settings are the regional default values unless otherwise indicated (selected in parameter **0-03 Regional Settings**).
- Parameters associated with the terminals and their settings are shown next to the drawings.
- Required switch settings for analog terminals A53 or A54 are also shown.

### 11.1.1 Wiring Configuration for Automatic Motor Adaptation (AMA)

Table 118: Wiring Configuration for AMA with T27 Connected

		Parameters	
	<b>Function</b>		<b>Setting</b>
	Parameter <b>1-29 Automatic Motor Adaptation (AMA)</b>		[1] <b>Enable complete AMA</b>
	Parameter <b>5-12 Terminal 27 Digital Input</b>		[2]* <b>Coast inverse</b>
	* = Default value		
	<b>Notes/comments:</b>		
	Set parameter group <b>1-2* Motor Data</b> according to the motor nameplate.		

### 11.1.2 Wiring Configuration for Automatic Motor Adaptation without T27

Table 119: AMA without T27 Connected

	Parameters	
	Function	Setting
e30bb930.11	Parameter 1-29 <i>Automatic Motor Adaptation (AMA)</i>	[1] <i>Enable complete AMA</i>
	Parameter 5-12 <i>Terminal 27 Digital Input</i>	[0] <i>No operation</i>
	*=Default value	
	<b>Notes/comments:</b> Parameter group 1-2* <i>Motor Data</i> must be set according to the motor.	

### 11.1.3 Wiring Configuration: Speed

Table 120: Analog Speed Reference (Voltage)

	Parameters	
	Function	Setting
e30bb926.11	Parameter 6-10 <i>Terminal 53 Low Voltage</i>	0.07 V*
	Parameter 6-11 <i>Terminal 53 High Voltage</i>	10 V*
	Parameter 6-14 <i>Terminal 53 Low Ref./ Feedb. value</i>	0 Hz
	Parameter 6-15 <i>Terminal 53 High Ref./ Feedb. Value</i>	50 Hz
	*=Default value	
<b>Notes/comments:</b> D IN 37 is an option.		

Table 121: Analog Speed Reference (Current)

Parameters	
Function	Setting
Parameter 6-12 Terminal 53 Low Current	4 mA*
Parameter 6-13 Terminal 53 High Current	20 mA*
Parameter 6-14 Terminal 53 Low Ref./ Feedb. value	0 Hz
Parameter 6-15 Terminal 53 High Ref./ Feedb. Value	50 Hz
* = Default value	
<b>Notes/comments:</b> D IN 37 is an option.	

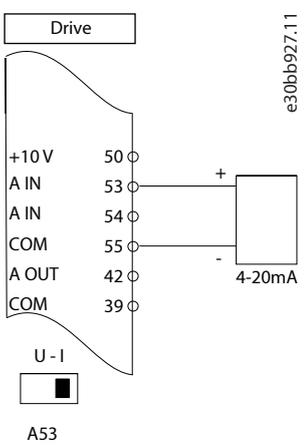


Table 122: Speed Reference (Using a Manual Potentiometer)

Parameters	
Function	Setting
Parameter 6-10 Terminal 53 Low Voltage	0.07 V*
Parameter 6-11 Terminal 53 High Voltage	10 V*
Parameter 6-14 Terminal 53 Low Ref./ Feedb. value	0 Hz
Parameter 6-15 Terminal 53 High Ref./ Feedb. Value	50 Hz
* = Default value	
<b>Notes/comments:</b> D IN 37 is an option.	



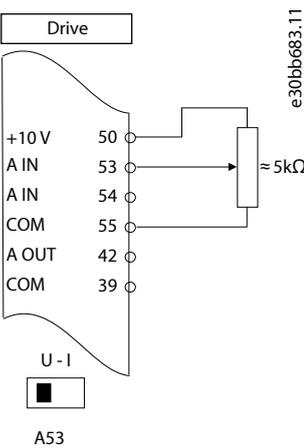


Table 123: Speed Up/Down

Parameter	
Function	Setting
Parameter 5-10 Terminal 18 Digital Input	[8] Start*
Parameter 5-12 Terminal 27 Digital Input	[19] Freeze Reference
Parameter 5-13 Terminal 29 Digital Input	[21] Speed Up
Parameter 5-14 Terminal 32 Digital Input	[22] Speed Down
* = Default value	
<b>Notes/comments:</b> D IN 37 is an option.	

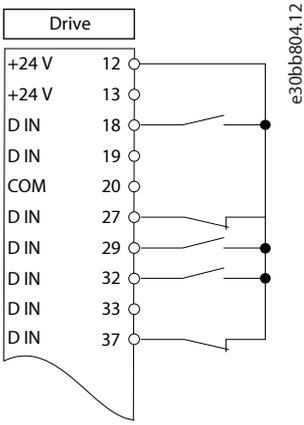

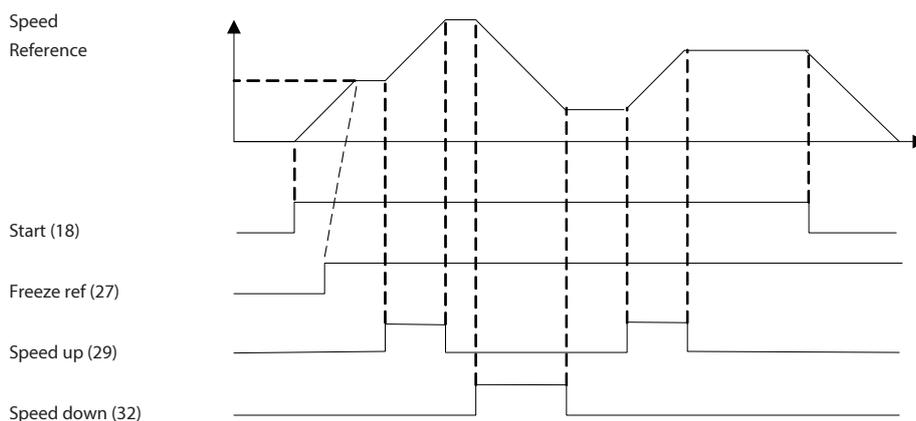

e30bb840.12

Figure 104: Speed Up/Down

### 11.1.4 Wiring Configuration: Feedback

Table 124: Analog Current Feedback Transducer (2-wire)

		Parameters	
		Function	Setting
		Parameter 6-22 Terminal 54 Low Current	4 mA*
		Parameter 6-23 Terminal 54 High Current	20 mA*
		Parameter 6-24 Terminal 54 Low Ref./Feedb. value	0*
		Parameter 6-25 Terminal 54 High Ref./Feedb. Value	50*
		*=Default value	
<b>Notes/comments:</b> D IN 37 is an option.			

Table 125: Analog Voltage Feedback Transducer (3-wire)

		Parameters	
		Function	Setting
		Parameter 6-20 Terminal 54 Low Voltage	0.07 V*
		Parameter 6-21 Terminal 54 High Voltage	10 V*
		Parameter 6-24 Terminal 54 Low Ref./ Feedb. value	0*
		Parameter 6-25 Terminal 54 High Ref./ Feedb. Value	50*
		* = Default value	
Notes/comments:			
D IN 37 is an option.			

Table 126: Analog Voltage Feedback Transducer (4-wire)

		Parameters	
		Function	Setting
		Parameter 6-20 Terminal 54 Low Voltage	0.07 V*
		Parameter 6-21 Terminal 54 High Voltage	10 V*
		Parameter 6-24 Terminal 54 Low Ref./ Feedb. value	0*
		Parameter 6-25 Terminal 54 High Ref./ Feedb. Value	50*
		* = Default value	
Notes/comments:			
D IN 37 is an option.			

### 11.1.5 Wiring Configuration: Run/Stop

**Table 127: Run/Stop Command with External Interlock**

	Parameter	
	Function	Setting
	Parameter 5-10 Terminal 18 Digital Input	[8] Start*
	Parameter 5-12 Terminal 27 Digital Input	[7] External interlock
	*=Default value	
	<b>Notes/comments:</b> D IN 37 is an option.	

Table 128: Run/Stop Command without External Interlock

	Parameter	
	Function	Setting
	Parameter 5-10 Terminal 18 Digital Input	[8] Start*
	Parameter 5-12 Terminal 27 Digital Input	[7] External interlock
	* = Default value	
<p><b>Notes/comments:</b></p> <p>If parameter 5-12 Terminal 27 Digital Inputs is set to [0] No operation, a jumper wire to terminal 27 is not needed.</p> <p>D IN 37 is an option.</p>		


Table 129: Run Permissive

		Parameter	
		<b>Function</b>	<b>Setting</b>
		Parameter 5-10 Terminal 18 Digital Input	[8] Start*
		Parameter 5-11 Terminal 19 Digital Input	[52] Run permissive
		Parameter 5-12 Terminal 27 Digital Input	[7] External interlock
		Parameter 5-40 Function Relay	[167] Start command act.
		*=Default value	
		<b>Notes/comments:</b> D IN 37 is an option.	

### 11.1.6 Wiring Configuration: Start/Stop

Table 130: Start/Stop Command with Safe Torque Off Option

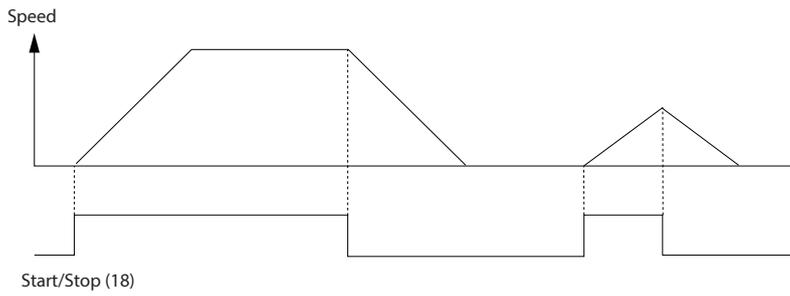		Parameter	
		<b>Function</b>	<b>Setting</b>
		Parameter 5-10 Terminal 18 Digital Input	[Start]*
		Parameter 5-12 Terminal 27 Digital Input	[0] No operation
		Parameter 5-19 Terminal 37 Safe Stop	
		*=Default value	
		<b>Notes/comments:</b> If parameter 5-12 Terminal 27 Digital Input is set [0] No operation, a jumper wire to terminal 27 is not needed. D IN 37 is an option.	




e30bb805.13

Figure 105: Start/Stop Command with Safe Torque Off

Table 131: Pulse Start/Stop

		Parameter	
		Function	Setting
		Parameter 5-10 Terminal 18 Digital Input	[9] Latched Start
	Parameter 5-12 Terminal 27 Digital Input	[6] Stop Inverse	
		* = Default value	
		<b>Notes/comments:</b> If parameter 5-12 Terminal 27 Digital Input is set [0] No operation, a jumper wire to terminal 27 is not needed. D IN 37 is an option.	

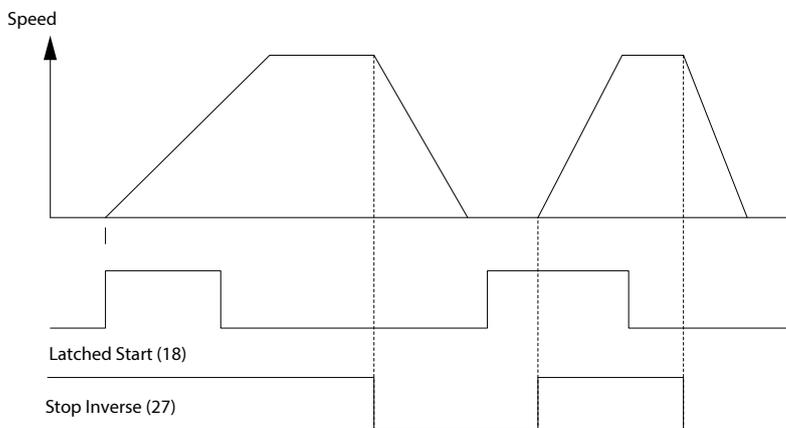


e130bb806.11

Figure 106: Latched Start/Stop Inverse

Table 132: Start/Stop with Reversing and 4 Preset Speeds


Parameters		Function	Setting
		Parameter 5-10 Terminal 18 Digital Input	[8] Start
Parameter 5-11 Terminal 19 Digital Input	[10] Reversing*		
Parameter 5-12 Terminal 27 Digital Input	[0] No operation		
Parameter 5-14 Terminal 32 Digital Input	[16] Preset ref bit 0		
Parameter 5-15 Terminal 33 Digital Input	[17] Preset ref bit 1		
Parameter 3-10 Preset Reference			
Preset ref. 0	25%		
Preset ref. 1	50%		
Preset ref. 2	75%		
Preset ref. 3	100%		
*=Default value			
<b>Notes/comments:</b>			
D IN 37 is an option.			

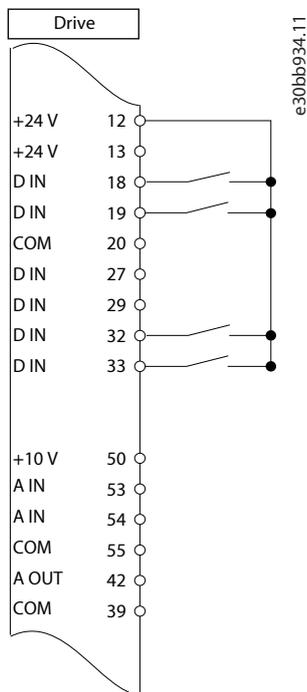

### 11.1.7 Wiring Configuration: External Alarm Reset

Table 133: External Alarm Reset

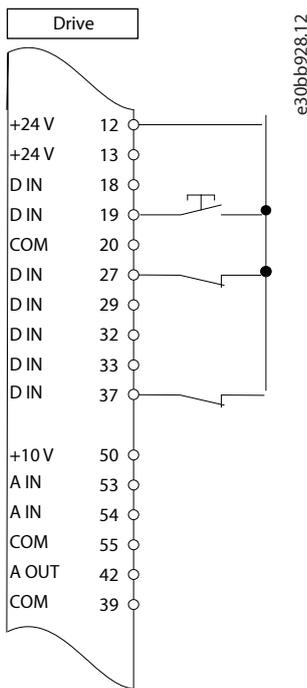Parameter		Function	Setting
		Parameter 5-11 Terminal 19 Digital Input	[1] Reset
*=Default value			
<b>Notes/comments:</b>			
D IN 37 is an option.			



### 11.1.8 Wiring Configuration: RS485

Table 134: RS485 Network Connection

	Parameter	
	Function	Setting
Parameter <b>8-30 Protocol</b>	FC*	
Parameter <b>8-31 Address</b>	1*	
Parameter <b>8-32 Baud Rate</b>	9600*	
*-=Default value		
<b>Notes/comments:</b> Select protocol, address, and baud rate in the above-mentioned parameters. D IN 37 is an option.		

### 11.1.9 Wiring Configuration: Motor Thermistor

**⚠ CAUTION**

**THERMISTOR INSULATION**

Risk of personal injury or equipment damage.

- To meet PELV insulation requirements, use only thermistors with reinforced or double insulation.


Table 135: Motor Thermistor

		Parameters	
	<b>Function</b>		<b>Setting</b>
	Parameter <i>1-90 Motor Thermal Protection</i>		<i>[2] Thermistor trip</i>
	Parameter <i>1-93 Thermistor Source</i>		<i>[1] Analog input 53</i>
	* = Default value		
	If only a warning is required, set parameter <i>1-90 Motor Thermal Protection</i> to <i>[1] Thermistor warning</i> . D IN 37 is an option.		

## 11.1.10 Wiring Configuration for a Relay Setup with Smart Logic Control

Table 136: Wiring Configuration for a Relay Setup with Smart Logic Control

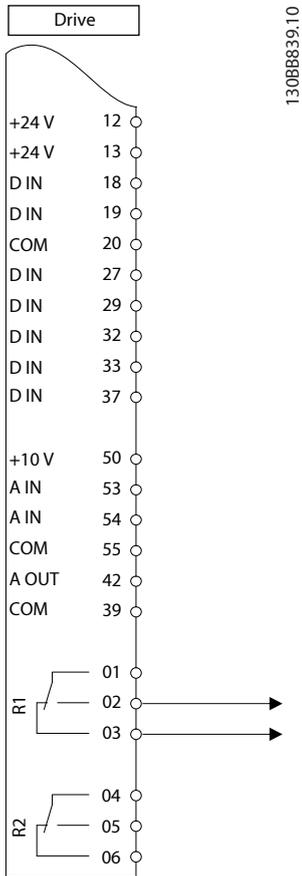Parameters	Function	Setting
	Parameter 4-30 <i>Motor Feedback Loss Function</i>	
Parameter 4-31 <i>Motor Feedback Speed Error</i>		100 RPM
Parameter 4-32 <i>Motor Feedback Loss Timeout</i>		5 s
Parameter 7-00 <i>Speed PID Feedback Source</i>		[2] <i>MCB 102</i>
Parameter 17-11 <i>Resolution (PPR)</i>		1024*
Parameter 13-00 <i>SL Controller Mode</i>		[1] <i>On</i>
Parameter 13-01 <i>Start Event</i>		[19] <i>Warning</i>
Parameter 13-02 <i>Stop Event</i>		[44] <i>Reset key</i>
Parameter 13-10 <i>Comparator Operand</i>		[21] <i>Warning no.</i>
Parameter 13-11 <i>Comparator Operator</i>		[1] <i>≈ (equal)*</i>
Parameter 13-12 <i>Comparator Value</i>		90
Parameter 13-51 <i>SL Controller Event</i>		[22] <i>Comparator 0</i>
Parameter 13-52 <i>SL Controller Action</i>		[32] <i>Set digital out A low</i>
Parameter 5-40 <i>Function Relay</i>		[80] <i>SL digital output A</i>
*=-Default value		
<b>Notes/comments:</b> If the limit in the feedback monitor is exceeded, <i>warning 90, Feedback Mon.</i> is issued. The SLC monitors <i>warning 90, Feedback Mon.</i> and if the warning becomes true, relay 1 is triggered. External equipment may require service. If the feedback error goes below the limit again within 5 s, the drive continues and the warning disappears. Reset relay 1 by pressing [ <i>Reset</i> ] on the LCP.		



## 12 How to Order a Drive

### 12.1 Drive Configurator

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	32	33	34	35	36	37	38	39
F	C	-				P				T											X	X	S	X	X	X	X	A		B		C						D

e30bb836.10

Figure 107: Type Code Example

Configure the right drive for the right application from the internet-based Drive Configurator and generate the type code string. The Drive Configurator automatically generates an 8-digit sales number to be delivered to the local sales office. Furthermore, it is possible to establish a project list with several products and send it to a Danfoss sales representative.

The Drive Configurator can be found on the global website: [www.danfoss.com/drives](http://www.danfoss.com/drives).

#### 12.1.1 Type Code

An example of the type code is:

FC-102P18KT4E21H1XGCXXXSXXXAGBKCXXXDX

The meaning of the characters in the string is in [Table 137](#). In the example above, a PROFIBUS V1 and a 24 V backup option is built in.

Table 137: Ordering Type Code, Enclosure Sizes A, B, and C

Description	Position	Possible options
Product group	1–3	FC-
Drive series	4–6	102
Power rating	8–10	1.1–90 kW (1.5–110 hp)
Phases	11	3-phases (T)
Mains voltage	11–12	T2: 3x200–240 V T2: 3x115Y/200–139Y/240 <sup>(1)</sup> T4: 3x380–480 V T4: 3x220Y/380–277Y/480 <sup>(1)</sup> T6: 3x525–600 V <sup>(2)</sup> T7: 3x525–690 V <sup>(2)</sup>
Enclosure	13–15	E20: IP20/UL Open Type E21: IP21/UL Type 1 E55: IP55/UL Type 12 E66: IP66/UL Type 4X P21: IP21/UL Type 12 (with mounting plate) P55: IP55/UL Type 12 (with mounting plate) Z55: A4 enclosure, IP55/UL Type 12 Z66: A4 enclosure, IP66/UL Type 4X

Table 137: Ordering Type Code, Enclosure Sizes A, B, and C - (continued)

Description	Position	Possible options
RFI filter	16–17	Hx: No EMC filters built in the drive (600 V units only) H1: Integrated EMC filter. Fulfill EN 55011 Class A1/B and EN/IEC 61800-3 Category 1/2. H2: No extra EMC filter. Fulfill EN 55011 Class A2 and EN/IEC 61800-3 Category 3. H3: Integrated EMC filter. Fulfill EN 55011 class A1/B and EN/IEC 61800-3 Category 1/2. H4: Integrated EMC filter. Fulfill EN 55011 Class A1 and EN/IEC 61800-3 Category 2. H5: Marine versions. Fulfills same emission levels as H2 versions.
Brake	18	B: Brake chopper included X: No brake chopper included T: Safe Torque Off no brake U: Safe Torque Off brake chopper
Display	19	G: Graphical local control panel (LCP) N: Numerical local control panel (LCP) X: No local control panel
Coating PCB	20	C: Coated PCB R: Ruggedized X: Non-coated PCB
Mains option	21	X: No mains option 1: Mains disconnect 3: Mains disconnect + fuse 5: Disconnect + fuse + load sharing 7: Fuse 8: Mains disconnect + load sharing A: Fuse + load sharing D: Load sharing
Adaptation	22	X: Standard cable entries O: European metric thread in cable entries (A4, A5, B1, B2, C1, and C2 only) S: Imperial cable entries (A5, B1, B2, C1, and C2 only)
Adaptation	23	X: No adaptation 6: UL 61800-5-1 ed 2.0 <sup>(2)(3), (4), (5)</sup>
Software release	24–27	SXXX: Latest release, standard software
Software language	28	X: Not used

1) Applies if position 23 in the type code = 6: UL 61800-5-1.

2) Not available for 600 V.

3) Factory-installed load share terminal cover for enclosure sizes A2, A3, A5 must not be removed.

4) Not available with brake or load share options.

5) UL 61800-5-1 is not valid for IT and delta grounded grids.

Table 138: Ordering Type Code, Options

Description	Position	Possible options
A options	29–30	AX: No A option A0: VLT® PROFIBUS DP-V1 MCA 101 (standard) A4: VLT® DeviceNet MCA 104 (standard) AG: VLT® LonWorks MCA 108 AJ: VLT® BACnet Gateway MCA 109 AL: VLT® PROFINET MCA 120 AN: VLT® EtherNet/IP MCA 121 AQ: VLT® Modbus TCP MCA 122
B options	31–32	BX: No option BK: VLT® General Purpose I/O Option MCB 101 BP: VLT® Relay Option MCB 105 BO: VLT® Analog I/O Option MCB 109 BP: VLT® Relay Option MCB 105 B2: VLT® PTC Thermistor Card MCB 112 B4: VLT® Sensor Input MCB 114
C0 options	33–34	CX: No option
C1 options	35	X: No options
C option software/E1 options	36–37	XX: Standard software
D options	38–39	DX: No option D0: VLT® Extended 24 V DC Backup MCB 107

### NOTICE

For power sizes over 90 kW, see the *VLT® HVAC Drive 110–800 kW Design Guide*.

## 12.1.2 Language Packages

Drives are automatically delivered with a language package relevant to the region from which it is ordered. 4 regional language packages cover the following languages:

Table 139: Regional Language Packages

Language package 1	Language package 2	Language package 3	Language package 4
English	English	English	English
German	German	German	German
French	Chinese	Slovenian	Spanish
Danish	Korean	Bulgarian	English US

Table 139: Regional Language Packages - (continued)

Language package 1	Language package 2	Language package 3	Language package 4
Spanish	Thai	Romanian	Brazilian Portuguese
Swedish	Traditional Chinese	Hungarian	Turkish
Italian	Bahasa Indonesian	Czech	Polish
Finnish		Russian	

To order drives with a different language package, contact the local sales office.

## 12.2 Code Numbers for Options and Accessories

### 12.2.1 Code Numbers for Options for Slot A

Table 140: Code Numbers for A Options

Description	Code number	
	Uncoated	Coated
VLT® PROFIBUS DP MCA 101	130B1100	130B1200
VLT® DeviceNet MCA 104	130B1102	130B1202
VLT® LonWorks MCA 108	130B1106	130B1206
VLT® BACnet MS/TP MCA 109	130B1144	130B1244
VLT® PROFINET MCA 120	130B1135	130B1235
VLT® EtherNet/IP MCA 121	130B1119	130B1219
VLT® Modbus TCP MCA 122	130B1196	130B1296
VLT® BACnet/IP MCA 125	–	130B1586

### 12.2.2 Code Numbers for Options for Slot B

Table 141: Code Numbers for B Options

Descriptions	Code number	
	Uncoated	Coated
VLT® General Purpose I/O MCB 101	130B1125	130B1212
VLT® Relay Option MCB 105	130B1110	130B1210
VLT® Analog I/O MCB 109 (including RTC backup)	130B1143	130B1243
VLT® PTC Thermistor Card MCB 112	–	130B1137
VLT® Sensor Input MCB 114	130B1172	130B1272
VLT® Real-time Clock MCB 117	–	130B6544

### 12.2.3 Code Numbers for Options for Slot C

**Table 142: Code Numbers for C Options**

Description	Code number	
	Uncoated	Coated
VLT® Extended Relay Card MCB 113	130B1164	130B1264
VLT® Mounting Kit for C Option, 40 mm, enclosure sizes A2/A3	130B7530	
VLT® Mounting Kit for C Option, 60 mm, enclosure sizes A2/A3	130B7531	
VLT® Mounting Kit for C Option, enclosure size A5	130B7532	
VLT® Mounting Kit for C Option, enclosure sizes B/C/D/E/F (except B3)	130B7533	
VLT® Mounting Kit for C Option, 40 mm, enclosure size B3	130B1413	
VLT® Mounting Kit for C Option, 60 mm, enclosure size B3	130B1414	

### 12.2.4 Code Numbers for Options for Slot D

**Table 143: Code Numbers for D Options**

Description	Code number	
	Uncoated	Coated
VLT® 24 V Power Supply MCB 107	130B1108	130B1208

### 12.2.5 Code Numbers for Miscellaneous Hardware

**Table 144: Code Numbers for Hardware Options**

Description	Code number
	Uncoated
Panel through mounting kit through kit enclosure size A5	130B1028
Panel through mounting kit through kit enclosure size B1	130B1046
Panel through mounting kit through kit enclosure size B2	130B1047
Panel through mounting kit through kit enclosure size C1	130B1048
Panel through mounting kit through kit enclosure size C2	130B1049
VLT® Mounting brackets for enclosure size A5	130B1080
VLT® Mounting brackets for enclosure size B1	130B1081
VLT® Mounting brackets for enclosure size B2	130B1082
VLT® Mounting brackets for enclosure size C1	130B1083
VLT® Mounting brackets for enclosure size C2	130B1084
VLT® IP 21/Type 1 Kit, enclosure size A2	130B1122
VLT® IP 21/Type 1 Kit, enclosure size A3	130B1123

Table 144: Code Numbers for Hardware Options - (continued)

Description	Code number
VLT® IP 21/Type 1 Kit, enclosure size B3	130B1187
VLT® IP 21/Type 1 Kit, enclosure size B4	130B1189
VLT® IP 21/Type 1 Kit, enclosure size C3	130B1191
VLT® IP 21/Type 1 Kit, enclosure size C4	130B1193
VLT® IP 21/Type 1 Top Kit, enclosure size A2	130B1132
VLT® IP 21/Type 1 Top Kit, enclosure size A3	130B1133
VLT® IP 21/Type 1 Top Kit, enclosure size B3	130B1188
VLT® IP 21/Type 1 Top Kit, enclosure size B4	130B1190
VLT® IP 21/Type 1 Top Kit, enclosure size C3	130B1192
VLT® IP 21/Type 1 Top Kit, enclosure size C4	130B1194
VLT® Back plate IP55/Type12, enclosure size A5	130B1098
VLT® Back plate IP21/Type 1, IP55/Type 12, enclosure size B1	130B3383
VLT® Back plate IP21/Type 1, IP55/Type 12, enclosure size B2	130B3397
VLT® Back plate IP21/Type 1, IP55/Type 12, enclosure size C1	130B3910
VLT® Back plate IP21/Type 1, IP55/Type 12, enclosure size C2	130B3911
VLT® Back plate IP66/Type 4X, enclosure size A5	130B3242
VLT® Back plate in stainless steel IP66/Type 4X, enclosure size B1	130B3434
VLT® Back plate in stainless steel IP66/Type 4X, enclosure size B2	130B3465
VLT® Back plate in stainless steel IP66/Type 4X, enclosure size C1	130B3468
VLT® Back plate in stainless steel IP66/Type 4X, enclosure size C2	130B3491
VLT® PROFIBUS Adapter Sub-D9 Connector	130B1112
Terminal block for DC-link connection on enclosure sizes A2/A3	130B1064
VLT® Screw terminals	130B1116
VLT® USB extension, 350 mm (13.8 in) cable	130B1155
VLT® USB extension, 650 mm (25.6 in) cable	130B1156

## 12.2.6 Code Numbers for Local Control Panel Options

Table 145: Code Numbers for Local Control Panels

Description	Code number
VLT® LCP 101 Numeric Local Control Pad	130B1124
VLT® LCP 102 Graphical Local Control Pad	130B1107
VLT® Wireless Control Panel LCP 103	134B0460

Table 145: Code Numbers for Local Control Panels - (continued)

Description	Code number
VLT® Cable for LCP 2, 3 m (9.8 ft)	175Z0929
LCP mounting kit for all LCP types	130B1170
LCP mounting kit with graphical LCP	130B1113
LCP mounting kit with numerical LCP	130B1114
VLT® LCP Mounting Kit, without LCP	130B1117
VLT® LCP Mounting Kit Blind Cover IP55/66, 8 m (26.2 ft)	130B1129
VLT® Control Panel LCP 102, graphical	130B1078
VLT® Blind cover, with Danfoss logo, IP55/66	130B1077
Remote mounting kit for LCP with cover for outdoor mounting with 3 m (10 ft) cable	134B5223
Remote mounting kit for LCP with cover for outdoor mounting with 5 m (16 ft) cable	134B5224
Remote mounting kit for LCP with cover for outdoor mounting with 10 m (33 ft) cable	134B5225

### 12.2.7 Code Numbers for PC Software

Table 146: Code Numbers for VLT® Motion Control Tool MCT 10

Description	Code number
VLT® Motion Control Tool MCT 10, 1 license	130B1000
VLT® Motion Control Tool MCT 10, 5 licenses	130B1001
VLT® Motion Control Tool MCT 10, 10 licenses	130B1002
VLT® Motion Control Tool MCT 10, 25 licenses	130B1003
VLT® Motion Control Tool MCT 10, 50 licenses	130B1004
VLT® Motion Control Tool MCT 10, 100 licenses	130B1005
VLT® Motion Control Tool MCT 10, >100 licenses	130B1006

### 12.2.8 Ordering of Brake Resistors

#### Explanation of terms used in the tables for ordering brake resistors

Horizontal braking: Duty cycle 10% and maximum 120 s repetition rates according to the reference brake profile. Average power corresponds to 6%.

Vertical braking: Duty cycle 40% and maximum 120 s repetition rates according to the reference brake profile. Average power corresponds to 27%.

Cable cross-section: Recommended minimum value based on PVC-insulated copper cable, 30 °C (86 °F) ambient temperature with normal heat dissipation. All cabling must comply with national and local regulations on cable cross-sections and ambient temperature.

Thermal relay: Brake current setting of external thermal relay. All resistors have a built-in thermal relay switch N.C.

The IP54 is with 1000 mm (39.4 in) fixed, unshielded cable. Can be used for vertical and horizontal mounting. For horizontal mounting, derating is required.

IP21 and IP65 are with screw terminal for cable termination and can be used for horizontal and vertical mounting. For horizontal mounting, derating is required.

IP20 is with a bolt connection for cable termination. Used for floor mounting.

IP65 is a flat-pack type brake resistor with a fixed cable.

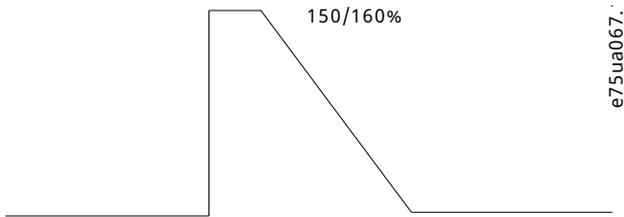


Figure 108: Horizontal Loads



Figure 109: Vertical Loads

### 12.2.8.1 Code Numbers for Brake Resistors, T2, Horizontal Braking 10% Duty Cycle

Table 147: Code Numbers for Brake Resistors, T2, Horizontal Braking 10% Duty Cycle

FC 102				Horizontal braking 10% duty cycle							
Drive data				Brake resistor data						Installation	
Mains type	P <sub>m</sub> [kW]	R <sub>min</sub> [Ω]	R <sub>br.nom</sub> [Ω]	R <sub>rec</sub> [Ω]	P <sub>br.cont</sub> [kW]	Danfoss part numbers				Cable cross-section [mm <sup>2</sup> (AWG)]	Thermo relay [A]
						Wire IP54	Screw terminal IP65	Screw terminal IP20	Bolt connection IP20		
T2	1.1 (1.5)	130	152.9	145	0.100	175U3016	-	-	-	1.5 (16)	0.8
T2	1.5 (2.0)	81	110.5	100	0.100	175U3021	-	-	-	1.5 (16)	0.9
T2	2.2 (3.0)	58.5	74.1	70	0.200	175U3026	-	-	-	1.5 (16)	1.6
T2	3.0 (4.0)	45	53.7	48	0.200	175U3031	-	-	-	1.5 (16)	1.9
T2	3.7 (5.0)	31.5	39.9	35	0.300	175U3325	-	-	-	1.5 (16)	2.7

Table 147: Code Numbers for Brake Resistors, T2, Horizontal Braking 10% Duty Cycle - (continued)

FC 102				Horizontal braking 10% duty cycle							
T2	5.5 (7.5)	22.5	28.7	27	0.360	175U332 6	175U347 7	175U347 8	–	1.5 (16)	3.5
T2	7.5 (10)	17.7	20.8	18	0.570	175U332 7	175U344 2	175U344 1	–	1.5 (16)	5.3
T2	11 (15)	12.6	14	13	0.680	175U332 8	175U305 9	175U306 0	–	1.5 (16)	6.8
T2	15 (20)	8.7	10.2	9.0	1.130	175U332 9	175U306 8	175U306 9	–	2.5 (14)	10.5
T2	18.5 (25)	5.3	8.2	5.7	1.400	175U333 0	175U307 3	175U307 4	–	4 (12)	14.7
T2	22 (30)	5.1	6.9	5.7	1.700	175U333 1	175U348 3	175U348 4	–	4 (12)	16
T2	30 (40)	3.2	5.0	3.5	2.200	175U333 2	175U308 0	175U308 1	–	6 (10)	24
T2	37 (50)	3.0	4.1	3.5	2.800	175U333 3	175U344 8	175U344 7	–	10 (8)	27
T2	45 (60)	2.4	3.3	2.8	3.200	175U333 4	175U308 6	175U308 7	–	16 (6)	32

### 12.2.8.2 Code Numbers for Brake Resistors, T2, Vertical Braking 40% Duty Cycle

Table 148: Code Numbers for Brake Resistors, T2, Vertical Braking 40% Duty Cycle

FC 102				Vertical braking 40% duty cycle							
Drive data				Brake resistor data						Installation	
Mains type	P <sub>m</sub> [kW]	R <sub>min</sub> [Ω]	R <sub>br.nom</sub> [Ω]	R <sub>rec</sub> [Ω]	P <sub>br.cont</sub> [kW]	Danfoss part numbers				Cable cross-section [mm <sup>2</sup> (AWG)]	Thermo relay [A]
						Wire IP54	Screw terminal IP65	Screw terminal IP20	Bolt connection IP20		
T2	1.1 (1.5)	130	152.9	145	0.300	175U330 0	–	–	–	1.5 (16)	1.3
T2	1.5 (2.0)	81	110.5	100	0.450	175U330 1	175U340 2	175U340 1	–	1.5 (16)	2.0
T2	2.2 (3.0)	58.5	74.1	70	0.570	175U330 2	175U340 4	175U340 3	–	1.5 (16)	2.7
T2	3.0 (4.0)	45	53.7	48	0.960	175U330 3	175U340 6	175U340 5	–	1.5 (16)	4.2
T2	3.7 (5.0)	31.5	39.9	35	1.130	175U330 4	175U340 8	175U340 7	–	1.5 (16)	5.4

Table 148: Code Numbers for Brake Resistors, T2, Vertical Braking 40% Duty Cycle - (continued)

FC 102				Vertical braking 40% duty cycle							
T2	5.5 (7.5)	22.5	28.7	27	1.400	175U330 5	175U341 0	175U340 9	–	1.5 (16)	6.8
T2	7.5 (10)	17.7	20.8	18	2.200	175U330 6	175U341 2	175U341 1	–	1.5 (16)	10.4
T2	11 (15)	12.6	14	13	3.200	175U330 7	175U341 4	175U341 3	–	2.5 (14)	14.7
T2	15 (20)	8.7	10.2	9.0	5.500	–	175U317 6	175U317 7	–	4 (12)	23
T2	18.5 (25)	5.3	8.2	5.7	6.000	–	–	–	175U323 3	10 (8)	33
T2	22 (30)	5.1	6.9	5.7	8.000	–	–	–	175U323 4	10 (8)	38
T2	30 (40)	3.2	5.0	3.5	9.000	–	–	–	175U323 5	16 (6)	51
T2	37 (50)	3.0	4.1	3.5	14.000	–	–	–	175U322 4	25 (4)	63
T2	45 (60)	2.4	3.3	2.8	17.000	–	–	–	175U322 7	35 (2)	78

### 12.2.8.3 Code Numbers for Brake Resistors, T2, Flat-pack for Horizontal Conveyors

Table 149: Flat-pack IP65 Brake Resistors for Horizontal Conveyors, 200–240 V Drives, T2

FC 102 T2	P <sub>m</sub> [kW (hp)]	R <sub>min</sub> [Ω]	Flat-pack IP65 for horizontal conveyors			
			R <sub>br,nom</sub> [Ω]	R <sub>rec</sub> per item [Ω/ W]	Duty cycle [%]	Order number
P1K1	1.1 (1.5)	130	152.9	150/100	9	175U1005
P1K1	1.1 (1.5)	130	152.9	150/100	18	175U0989
P1K5	1.5 (2.0)	81	110.5	100/100	7	175U1006
P1K5	1.5 (2.0)	81	110.5	100/200	14	175U0991
P2K2	2.2 (3.0)	58.5	74.1	72/200	9	175U0992
P3K0	3.0 (4.0)	45	53.7	50/200	7	175U0993
P3K7	3.7 (5.0)	31.5	39.9	35/200	6	175U0994
P3K7	3.7 (5.0)	31.5	39.9	72/200	11	2 x 175U0992

## 12.2.8.4 Code Numbers for Brake Resistors, T4, Horizontal Braking 10% Duty Cycle

Table 150: Code Numbers for Brake Resistors, T4, Horizontal Braking 10% Duty Cycle

FC 102				Horizontal braking 10% duty cycle							
Drive data				Brake resistor data						Installation	
Mains type	P <sub>m</sub> [kW]	R <sub>min</sub> [Ω]	R <sub>br.nom</sub> [Ω]	R <sub>rec</sub> [Ω]	P <sub>br.cont</sub> [kW]	Danfoss part numbers				Cable cross-section [mm <sup>2</sup> (AWG)]	Thermo relay [A]
						Wire IP54	Screw terminal IP65	Screw terminal IP20	Bolt connection IP20		
T4	1.1 (1.5)	546	607.3	630	0.100	175U3002	–	–	–	1.5 (16)	0.4
T4	1.5 (2.0)	382	437.3	410	0.100	175U3004	–	–	–	1.5 (16)	0.5
T4	2.2 (3.0)	260	293.3	270	0.200	175U3007	–	–	–	1.5 (16)	0.8
T4	3.0 (4.0)	189	212.7	200	0.200	175U3008	–	–	–	1.5 (16)	0.9
T4	4.0 (5.0)	135	157.3	145	0.300	175U3300	–	–	–	1.5 (16)	1.3
T4	5.5 (7.5)	99	113.3	110	0.450	175U3335	175U3450	175U3449	–	1.5 (16)	1.9
T4	7.5 (10)	72	82.4	80	0.570	175U3336	175U3452	175U3451	–	1.5 (16)	2.5
T4	11 (15)	50	55.3	56	0.680	175U3337	175U3027	175U3028	–	1.5 (16)	3.3
T4	15 (20)	36	40.3	38	1.130	175U3338	175U3034	175U3035	–	1.5 (16)	5.2
T4	18.5 (25)	27	32.5	28	1.400	175U3339	175U3039	175U3040	–	1.5 (16)	6.7
T4	22 (30)	20.3	27.2	22	1.700	175U3340	175U3047	175U3048	–	1.5 (16)	8.3
T4	30 (40)	18	19.8	19	2.200	175U3357	175U3049	175U3050	–	1.5 (16)	10.1
T4	37 (50)	13.4	16	14	2.800	175U3341	175U3055	175U3056	–	2.5 (14)	13.3
T4	45 (60)	10.8	13.1	12	3.200	175U3359	175U3061	175U3062	–	2.5 (14)	15.3
T4	55 (75)	8.8	10.7	9.5	4.200	–	175U3065	175U3066	–	4 (12)	20



Table 151: Code Numbers for Brake Resistors, T4, Vertical Braking 40% Duty Cycle - (continued)

FC 102				Vertical braking 40% duty cycle							
Mains type	P <sub>m</sub> [kW]	R <sub>min</sub> [Ω]	R <sub>br.nom</sub> [Ω]	R <sub>rec</sub> [Ω]	P <sub>br.cont</sub> [kW]	Wire IP54	Screw terminal IP65	Screw terminal IP20	Bolt connection IP20	Cable cross-section [mm <sup>2</sup> (AWG)]	Thermo relay [A]
T4	1.1 (1.5)	546	607.3	630	0.300	175U3309	–	–	–	1.5 (16)	0.7
T4	1.5 (2.0)	382	437.3	410	0.450	175U3310	175U3416	175U3415	–	1.5 (16)	1.0
T4	2.2 (3.0)	260	293.3	270	0.570	175U3311	175U3418	175U3417	–	1.5 (16)	1.4
T4	3.0 (4.0)	189	212.7	200	0.960	175U3312	175U3420	175U3419	–	1.5 (16)	2.1
T4	4.0 (5.0)	135	157.3	145	1.130	175U3313	175U3422	175U3421	–	1.5 (16)	2.7
T4	5.5 (7.5)	99	113.3	110	1.700	175U3314	175U3424	175U3423	–	1.5 (16)	3.7
T4	7.5 (10)	72	82.4	80	2.200	175U3315	175U3138	175U3139	–	1.5 (16)	5.0
T4	11 (15)	50	55.3	56	3.200	175U3316	175U3428	175U3427	–	1.5 (16)	7.1
T4	15 (20)	36	40.3	38	5.000	–	–	–	175U3236	1.5 (16)	11.5
T4	18.5 (25)	27	32.5	28	6.000	–	–	–	175U3237	2.5 (14)	14.7
T4	22 (30)	20.3	27.2	22	8.000	–	–	–	175U3238	4 (12)	19
T4	30 (40)	18	19.8	19	10.000	–	–	–	175U3203	4 (12)	23
T4	37 (50)	13.4	16	14	14.000	–	–	–	175U3206	10 (8)	32
T4	45 (60)	10.8	13.1	12	17.000	–	–	–	175U3210	10 (8)	38
T4	55 (75)	8.8	10.7	9.5	21.000	–	–	–	175U3213	16 (6)	47
T4	75 (100)	6.5	7.8	7.0	26.000	–	–	–	175U3216	25 (4)	61
T4	90 (125)	4.2	6.5	5.5	36.000	–	–	–	175U3219	35 (2)	81

Table 151: Code Numbers for Brake Resistors, T4, Vertical Braking 40% Duty Cycle - (continued)

FC 102				Vertical braking 40% duty cycle							
T4	110 (150)	3.6	5.3	4.7	42.000	-	-	-	175U322 1	50 (1-1/0)	95
T4	132 (175)	3.0	4.4	3.7	52.000	-	-	-	175U322 3	70 (2/0)	119
T4	160 (250)	2.5	3.6	3.3	60.000	-	-	-	175U322 5	2 x 35 (2 x 2)	135
T4	200 (300)	2.0	2.9	2.7	78.000	-	-	-	175U322 8	2 x 50 (2 x 1-1/0)	170
T4	250 (350)	1.6	2.3	2.1	90.000	-	-	-	175U323 0	2 x 70 (2 x 2/0)	207
T4	315 (450)	1.2	1.8	1.7	-	-	-	-	-	-	-
T4	355 (475)	1.2	1.6	1.3	-	-	-	-	-	-	-
T4	400 (550)	1.2	1.4	1.2	-	-	-	-	-	-	-
T4	450 (600)	1.1	1.3	1.1	-	-	-	-	-	-	-
T4	500 (650)	0.9	1.1	2 x 1.9	-	-	-	-	-	-	-
T4	560 (750)	0.9	1.0	2 x 1.7	-	-	-	-	-	-	-
T4	630 (850)	0.8	0.9	2 x 1.5	-	-	-	-	-	-	-
T4	710 (950)	0.7	0.8	2 x 1.3	-	-	-	-	-	-	-
T4	800 (1075)	0.6	0.7	3 x 1.8	-	-	-	-	-	-	-
T4	1000 (1350)	0.5	0.6	3 x 1.6	-	-	-	-	-	-	-

### 12.2.8.6 Code Numbers for Brake Resistors, T4, Flat-pack for Horizontal Conveyors

Table 152: Flat-pack IP65 Brake Resistors for Horizontal Conveyors, 380–480 V Drives, T4

FC 102 T4	P <sub>m</sub> [kW]	R <sub>min</sub> [Ω]	Flat-pack IP65 for horizontal conveyors			
			R <sub>br,nom</sub> [Ω]	R <sub>rec</sub> per item [Ω/W]	Duty cycle [%]	Ordering number
P1K1	1.1 (1.5)	546	607.3	620/100	9	175U1001
P1K1	1.1 (1.5)	546	607.3	620/200	18	175U0982
P1K5	1.5 (2.0)	382	437.3	430/100	7	175U1002
P1K5	1.5 (2.0)	382	437.3	430/200	14	175U0983
P2K2	2.2 (3.0)	260	293.3	310/200	9	175U0984
P3K0	3.0 (4.0)	189	212.7	210/200	7	175U0987
P4K0	4.0 (5.0)	135	157.3	150/200	5	175U0989

Table 152: Flat-pack IP65 Brake Resistors for Horizontal Conveyors, 380–480 V Drives, T4 - (continued)

Flat-pack IP65 for horizontal conveyors						
P4K0	4.0 (5.0)	135	157.3	300/200	20	2 x 175U0985
P5K5	5.5 (7.5)	99	113.3	130/200	7	2 x 175U0990

### 12.2.8.7 Code Numbers for Brake Resistors, T6, Horizontal Braking 10% Duty Cycle

Table 153: Code Numbers for Brake Resistors, T6, Horizontal Braking 10% Duty Cycle

FC 102				Horizontal braking 10% duty cycle							
Drive data				Brake resistor data						Installation	
Mains type	P <sub>m</sub> [kW]	R <sub>min</sub> [Ω]	R <sub>br.nom</sub> [Ω]	R <sub>rec</sub> [Ω]	P <sub>br.cont</sub> [kW]	Danfoss part numbers				Cable cross-section [mm <sup>2</sup> (AWG)]	Thermo relay [A]
						Wire IP54	Screw terminal IP65	Screw terminal IP20	Bolt connection IP20		
T6	1.1 (1.5)	620	889.1	850	0.100	175U300 1	–	–	–	1.5 (16)	0.4
T6	1.5 (2.0)	550	642.7	570	0.100	175U300 3	–	–	–	1.5 (16)	0.4
T6	2.2 (3.0)	380	431.1	415	0.200	175U300 5	–	–	–	1.5 (16)	0.7
T6	3.0 (4.0)	260	312.5	270	0.200	175U300 7	–	–	–	1.5 (16)	0.8
T6	4.0 (5.0)	189	231.6	200	0.300	175U334 2	–	–	–	1.5 (16)	1.1
T6	5.5 (7.5)	135	166.6	145	0.450	175U334 3	175U301 2	175U301 3	–	1.5 (16)	1.7
T6	7.5 (10)	99	121.1	100	0.570	175U334 4	175U313 6	175U313 7	–	1.5 (16)	2.3
T6	11 (15)	69	81.6	72	0.680	175U334 5	175U345 6	175U345 5	–	1.5 (16)	2.9
T6	15 (20)	48.6	59.4	52	1.130	175U334 6	175U345 8	175U345 7	–	1.5 (16)	4.4
T6	18.5 (25)	35.1	47.9	38	1.400	175U334 7	175U346 0	175U345 9	–	1.5 (16)	5.7
T6	22 (30)	27	40.1	31	1.700	175U334 8	175U303 7	175U303 8	–	1.5 (16)	7.0
T6	30 (40)	22.5	29.2	27	2.200	175U334 9	175U304 3	175U304 4	–	1.5 (16)	8.5

Table 153: Code Numbers for Brake Resistors, T6, Horizontal Braking 10% Duty Cycle - (continued)

FC 102				Horizontal braking 10% duty cycle							
T6	37 (50)	17.1	23.6	19	2.800	175U335 0	175U346 2	175U346 1	–	2.5 (14)	11.4
T6	45 (60)	13.5	19.4	14	3.200	175U335 8	175U346 4	175U346 3	–	2.5 (14)	14.2
T6	55 (75)	11.7	15.8	13.5	4.200	–	175U305 7	175U305 8	–	4 (12)	17
T6	75 (100)	9.9	11.5	11	5.500	–	175U306 3	175U306 4	–	6 (10)	21
T6	90 (125)	8.6	9.6	7.0	7.000	–	–	–	175U324 5	10 (8)	32

### 12.2.8.8 Code Numbers for Brake Resistors, T6, Vertical Braking 40% Duty Cycle

Table 154: Code Numbers for Brake Resistors, T6, Vertical Braking 40% Duty Cycle

FC 102				Horizontal braking 10% duty cycle							
Drive data				Brake resistor data						Installation	
Mains type	P <sub>m</sub> [kW]	R <sub>min</sub> [Ω]	R <sub>br.nom</sub> [Ω]	R <sub>rec</sub> [Ω]	P <sub>br.cont</sub> [kW]	Danfoss part numbers				Cable cross-section [mm <sup>2</sup> (AWG)]	Thermo relay [A]
						Wire IP54	Screw terminal IP65	Screw terminal IP20	Bolt connection IP20		
T6	1.1 (1.5)	620	889.1	850	0.280	175U331 7	175U310 4	175U310 5	–	1.5 (16)	0.6
T6	1.5 (2.0)	550	642.7	570	0.450	175U331 8	175U343 0	175U342 9	–	1.5 (16)	0.9
T6	2.2 (3.0)	380	431.1	415	0.570	175U331 9	175U343 2	175U343 1	–	1.5 (16)	1.1
T6	3.0 (4.0)	260	312.5	270	0.960	175U332 0	175U343 4	175U343 3	–	1.5 (16)	1.8
T6	4.0 (5.0)	189	231.6	200	1.130	175U332 1	175U343 6	175U343 5	–	1.5 (16)	2.3
T6	5.5 (7.5)	135	166.6	145	1.700	175U332 2	175U312 6	175U312 7	–	1.5 (16)	3.3
T6	7.5 (10)	99	121.1	100	2.200	175U332 3	175U313 8	175U343 7	–	1.5 (16)	4.4
T6	11 (15)	69	81.6	72	3.200	175U332 4	175U344 0	175U343 9	–	1.5 (16)	6.3
T6	15 (20)	48.6	59.4	52	5.500	–	175U314 8	175U314 9	–	1.5 (16)	9.7

Table 154: Code Numbers for Brake Resistors, T6, Vertical Braking 40% Duty Cycle - (continued)

FC 102				Horizontal braking 10% duty cycle							
T6	18.5 (25)	35.1	47.9	38	6.000	–	–	–	175U3239	2.5 (14)	12.6
T6	22 (30)	27	40.1	31	8.000	–	–	–	175U3240	4 (12)	16
T6	30 (40)	22.5	29.2	27	10.000	–	–	–	175U3200	4 (12)	19
T6	37 (50)	17.1	23.6	19	14.000	–	–	–	175U3204	10 (8)	27
T6	45 (60)	13.5	19.4	14	17.000	–	–	–	175U3207	10 (8)	35
T6	55 (75)	11.7	15.8	13.5	21.000	–	–	–	175U3208	16 (6)	40
T6	75 (100)	9.9	11.5	11	26.000	–	–	–	175U3211	25 (4)	49
T6	90 (125)	8.6	9.6	7.0	30.000	–	–	–	175U3241	35 (2)	66

### 12.2.8.9 Code Numbers for Brake Resistors, T7, Horizontal Braking 10% Duty Cycle

Table 155: Code Numbers for Brake Resistors, T7, Horizontal Braking 10% Duty Cycle

FC 102				Horizontal braking 10% duty cycle							
Drive data				Brake resistor data						Installation	
Mains type	P <sub>m</sub> [kW]	R <sub>min</sub> [Ω]	R <sub>br.nom</sub> [Ω]	R <sub>rec</sub> [Ω]	P <sub>br.cont</sub> [kW]	Danfoss part numbers				Cable cross-section [mm <sup>2</sup> (AWG)]	Thermo relay [A]
						Wire IP54	Screw terminal IP65	Screw terminal IP20	Bolt connection IP20		
T7	1.1 (1.5)	620	830	630	0.100	175U3002	–	–	–	1.5 (16)	0.4
T7	1.5 (2.0)	513	600	570	0.100	175U3003	–	–	–	1.5 (16)	0.4
T7	2.2 (3.0)	340	403	415	0.200	175U3005	–	–	–	1.5 (16)	0.7
T7	3.0 (4.0)	243	292	270	0.300	175U3361	–	–	–	1.5 (16)	1.0
T7	4.0 (5.0)	180	216	200	0.360	–	175U3009	175U3010	–	1.5 (16)	1.3
T7	5.5 (7.5)	130	156	145	0.450	–	175U3012	175U3013	–	1.5 (16)	1.7

Table 155: Code Numbers for Brake Resistors, T7, Horizontal Braking 10% Duty Cycle - (continued)

FC 102				Horizontal braking 10% duty cycle							
T7	7.5 (10)	94	113	105	0.790	–	175U348 1	175U348 2	–	1.5 (16)	2.6
T7	11 (15)	94.5	110.9	105	0.790	175U336 0	175U348 1	175U348 2	–	1.5 (16)	2.7
T7	15 (20)	69.7	80.7	72	1.130	175U335 1	175U346 6	175U346 5	–	1.5 (16)	3.8
T7	18.5 (25)	46.8	65.1	52	1.400	175U335 2	175U346 8	175U346 7	–	1.5 (16)	4.9
T7	22 (30)	36	54.5	42	1.700	175U335 3	175U303 2	175U303 3	–	1.5 (16)	6.0
T7	30 (40)	29	39.7	31	2.200	175U335 4	175U347 0	175U346 9	–	1.5 (16)	7.9
T7	37 (50)	22.5	32.1	27	2.800	175U335 5	175U347 2	175U347 1	–	2.5 (14)	9.6
T7	45 (60)	18	26.3	22	3.200	175U335 6	175U347 9	175U348 0	–	2.5 (14)	11.3
T7	55 (75)	13.5	21.4	15.5	4.200	–	175U347 4	175U347 3	–	4 (12)	15.4
T7	75 (100)	13.5	15.6	13.5	5.500	–	175U347 6	175U347 5	–	6 (10)	19
T7	90 (125)	8.8	13	11	7.000	–	–	–	175U323 2	10 (8)	25
T7	110 (150)	8.8	10.6	9.1	9.000	–	–	–	175U306 7	16 (6)	32
T7	132 (175)	6.6	8.8	7.4	11.000	–	–	–	175U307 2	16 (6)	39
T7	160 (250)	4.2	7.2	6.1	13.000	–	–	–	175U307 5	16 (6)	46
T7	200 (300)	4.2	5.8	5.0	16.000	–	–	–	175U307 8	25 (4)	57
T7	250 (350)	3.4	4.6	4.0	20.000	–	–	–	175U308 2	35 (2)	71
T7	315 (450)	2.3	3.7	3.2	26.000	–	–	–	175U308 5	50 (1-1/0)	90
T7	400 (550)	2.3	2.9	2.5	32.000	–	–	–	175U308 9	70 (2/0)	113
T7	450 (600)	2.0	2.6	2.3	36.000	–	–	–	175U309 0	2 x 35 (2 x 2)	125

Table 155: Code Numbers for Brake Resistors, T7, Horizontal Braking 10% Duty Cycle - (continued)

FC 102				Horizontal braking 10% duty cycle							
T7	500 (650)	1.9	2.3	2.0	42.000	–	–	–	175U309 2	2 x 35 (2 x 2)	145
T7	560 (750)	1.5	2.1	1.6	52.000	–	–	–	175U309 4	2 x 50 (2 x 1-1/0)	180
T7	630 (850)	1.4	1.8	1.4	60.000	–	–	–	175U309 5	2 x 50 (2 x 1-1/0)	207
T7	710 (950)	1.2	1.6	2 x 2.6	–	–	–	–	–	–	–
T7	800 (1075)	1.1	1.4	2 x 2.2	–	–	–	–	–	–	–
T7	900 (1200)	1.0	1.3	3 x 2.0	–	–	–	–	–	–	–
T7	1000 (1350)	0.9	1.1	3 x 2.6	–	–	–	–	–	–	–
T7	1200 (1600)	0.8	1.0	3 x 2.4	–	–	–	–	–	–	–
T7	1400 (1875)	0.6	0.8	3 x 2.0	–	–	–	–	–	–	–

### 12.2.8.10 Code Numbers for Brake Resistors, T7, Vertical Braking 40% Duty Cycle

Table 156: Code Numbers for Brake Resistors, T7, Vertical Braking 40% Duty Cycle

FC 102				Vertical braking 40% duty cycle							
Drive data				Brake resistor data						Installation	
Mains type	P <sub>m</sub> [kW]	R <sub>min</sub> [Ω]	R <sub>br.nom</sub> [Ω]	R <sub>rec</sub> [Ω]	P <sub>br.cont</sub> [kW]	Danfoss part numbers				Cable cross-section [mm <sup>2</sup> (AWG)]	Thermo relay [A]
						Wire IP54	Screw terminal IP65	Screw terminal IP20	Bolt connection IP20		
T7	1.1 (1.5)	620	830	630	0.360	–	175U310 8	175U310 9	–	1.5 (16)	0.8
T7	1.5 (2.0)	513	600	570	0.570	–	175U311 0	175U311 1	–	1.5 (16)	1.0
T7	2.2 (3.0)	340	403	415	0.790	–	175U311 2	175U311 3	–	1.5 (16)	1.3
T7	3.0 (4.0)	243	292	270	1.130	–	175U311 8	175U311 9	–	1.5 (16)	2.0
T7	4.0 (5.0)	180	216	200	1.700	–	175U312 2	175U312 3	–	1.5 (16)	2.8

Table 156: Code Numbers for Brake Resistors, T7, Vertical Braking 40% Duty Cycle - (continued)

FC 102				Vertical braking 40% duty cycle							
T7	5.5 (7.5)	130	156	145	2.200	-	175U310 6	175U310 7	-	1.5 (16)	3.7
T7	7.5 (10)	94	113	105	3.200	-	175U313 2	175U313 3	-	1.5 (16)	5.2
T7	11 (15)	94.5	110.9	105	4.200	-	175U313 4	175U313 5	-	1.5 (16)	6.0
T7	15 (20)	69.7	80.7	72	4.200	-	175U314 2	175U314 3	-	1.5 (16)	7.2
T7	18.5 (25)	46.8	65.1	52	6.000	-	-	-	175U324 2	2.5 (14)	10.8
T7	22 (30)	36	54.5	42	8.000	-	-	-	175U324 3	2.5 (14)	13.9
T7	30 (40)	29	39.7	31	10.000	-	-	-	175U324 4	4 (12)	18
T7	37 (50)	22.5	32.1	27	14.000	-	-	-	175U320 1	10 (8)	23
T7	45 (60)	18	26.3	22	17.000	-	-	-	175U320 2	10 (8)	28
T7	55 (75)	13.5	21.4	15.5	21.000	-	-	-	175U320 5	16 (6)	37
T7	75 (100)	13.5	15.6	13.5	26.000	-	-	-	175U320 9	16 (6)	44
T7	90 (125)	8.8	13	11	36.000	-	-	-	175U321 2	25 (4)	57
T7	110 (150)	8.8	10.6	9.1	42.000	-	-	-	175U321 4	35 (2)	68
T7	132 (175)	6.6	8.8	7.4	52.000	-	-	-	175U321 5	50 (1-1/0)	84
T7	160 (250)	4.2	7.2	6.1	60.000	-	-	-	175U321 8	70 (2/0)	99
T7	200 (300)	4.2	5.8	5.0	78.000	-	-	-	175U322 0	2 x 35 (2 x 2)	125
T7	250 (350)	3.4	4.6	4.0	90.000	-	-	-	175U322 2	2 x 35 (2 x 2)	150
T7	315 (450)	2.3	3.7	3.2	-	-	-	-	-	-	-
T7	400 (550)	2.3	2.9	2.5	-	-	-	-	-	-	-
T7	450 (600)	2.0	2.6	2.3	-	-	-	-	-	-	-
T7	500 (650)	1.9	2.3	2.0	-	-	-	-	-	-	-

Table 156: Code Numbers for Brake Resistors, T7, Vertical Braking 40% Duty Cycle - (continued)

FC 102				Vertical braking 40% duty cycle							
T7	560 (750)	1.5	2.1	1.6	–	–	–	–	–	–	–
T7	630 (850)	1.4	1.8	1.4	–	–	–	–	–	–	–
T7	710 (950)	1.2	1.6	2 x 2.6	–	–	–	–	–	–	–
T7	800 (1075)	1.1	1.4	2 x 2.2	–	–	–	–	–	–	–
T7	900 (1200)	1.0	1.3	2 x 2.0	–	–	–	–			
T7	1000 (1350)	0.9	1.1	3 x 2.6	–	–	–	–	–	–	–
T7	1200 (1600)	0.8	1.0	3 x 2.4	–	–	–	–	–	–	–
T7	1400 (1875)	0.6	0.8	3 x 2.0	–	–	–	–	–	–	–

### 12.2.9 Code Numbers for Accessory Bags

Table 157: Code Numbers for Accessory Bags

Accessory bag type	Description	Code number
Accessory bag A2/A3	Accessory bag, enclosure sizes A2/A3	130B1022
Accessory bag A4	Accessory bag for enclosure size A4 without thread	130B0536
Accessory bag A5	Accessory bag, enclosure size A5	130B1023
Accessory bag B1	Accessory bag, enclosure size B1	130B2060
Accessory bag B2	Accessory bag, enclosure size B2	130B2061
Accessory bag B3	Accessory bag, enclosure size B3	130B0980
Accessory bag B4	Accessory bag, enclosure size B4, 18.5–22 kW	130B1300
Accessory bag B4	Accessory bag, enclosure size B4, 30 kW	130B1301
Accessory bag C1	Accessory bag, enclosure size C1	130B0046
Accessory bag C2	Accessory bag, enclosure size C2	130B0047
Accessory bag C3	Accessory bag, enclosure size C3	130B0981
Accessory bag C4	Accessory bag, enclosure type C4, 55 kW	130B0982
Accessory bag C4	Accessory bag, enclosure type C4, 75 kW	130B0983

#### Example of an accessory bag content (130B0046)

- Load share warning label
- Eye bolt M10
- 2 relay plugs

- 3-pole spring cage connector
- 6-pole spring cage connector
- Label
- Terminal strap
- 3 cable clamps
- 4 metric screws M4 and M6
- 1 thread forming screw
- 3 cable bearers

### 12.2.10 Ordering of Harmonic Filters

Harmonic filters are used to reduce mains harmonics. Danfoss offers 2 different harmonic filters:

- VLT® Advanced Harmonic Filter AHF 005 with 5% current distortion.
- VLT® Advanced Harmonic Filter AHF 010 with 10% current distortion.

The filters are cooled by natural convection or with built-in fans. Secure sufficient airflow through the filter during installation to avoid overheating the filter. An airflow of minimum 2 m/s is required through the filter.

#### 12.2.10.1 Code Numbers for Harmonic Filters, 380–415 V, 50 Hz

Table 158: Code Numbers for Harmonic Filters, 380–415 V, 50 Hz

Drive values		AHF values				
Power rating [kW] <sup>(1)</sup>	Input current 380–440 V [A]	Current rating [A]	Code numbers <sup>(2)</sup>		Enclosure type	
			AHF 005 IP20	AHF 010 IP20	AHF 005 IP20	AHF 010 IP20
0.37	1.2	10	130B1229	130B1027	X1-V3 IP20 if	X1-V3 IP20 if
0.55	1.6					
0.75	2.2					
1.1	2.7					
1.5	3.7					
2.2	5.0					
3.0	6.5					
4.0	9.0	14	130B1231	130B1058	X1-V3 IP20 ef	X1-V3 IP20 ef
5.5	11.7					
7.5	14.4	22	130B1232	130B1059	X2-V3 IP20 ef	X2-V3 IP20 if
11	22					
15	29	29	130B1233	130B1089	X2-V3 IP20 ef	X2-V3 IP20 if
18.5	34					
22	40	40	130B1238	130B1094	X3-V3 IP20 if	X3-V3 IP20 if
	40					
			130B1239	130B1111	X3-V3 IP20 if	X3-V3 IP20 if

Table 158: Code Numbers for Harmonic Filters, 380–415 V, 50 Hz - (continued)

Drive values		AHF values				
30	55	55	130B1240	130B1176	X3-V3 IP20 if	X3-V3 IP20 if
37	66	66	130B1241	130B1180	X4-V3 IP20 if	X4-V3 IP20 if
45	82	82	130B1247	130B1201	X4-V3 IP20 ef	X4-V3 IP20 ef
55	96	96	130B1248	130B1204	X5-V3 IP20 ef	X5-V3 IP20 ef
75	133	133	130B1249	130B1207	X5-V3 IP20 ef	X5-V3 IP20 ef
90	171	171	130B1250	130B1213	X6-V3 IP20 ef	X6-V3 IP20 if
110	204	204	130B1251	130B1214	X6-V3 IP20 ef	X6-V3 IP20 if
132	251	251	130B1258	130B1215	X7-V3 IP20 if	X7-V3 IP20 if
160	304	304	130B1259	130B1216	X7-V3 IP20 if	X7-V3 IP20 if
–	–	325	130B3152 <sup>(3)</sup>	130B3136 <sup>(3)</sup>	X8-V3 IP20 if	X7-V3 IP20 if
200	381	381	130B1260	130B1217	X8-V3 IP20 ef	X7-V3 IP20 if
250	463	480	130B1261	130B1228	X8-V3 IP20 ef	X8-V3 IP20 ef
315	590	608	2 x 130B1259	2 x 130B1216	See individual filters	
355	647	650	2 x 130B3152	2 x 130B3136		
400	684	685	130B1259 + 130B1260	130B1216 + 130B1217		
450	779	762	2 x 130B1260	2 x 130B1217		
500	857	861	130B1260 + 130B1261	130B1217 + 130B1228		
560	964	960	2 x 130B1261	2 x 130B1228		
630	1090	1140	3 x 130B1260	3 x 130B1217		
710	1227	1240	2 x 130B1260 + 130B1261	2 x 130B1217 + 130B1228		
800	1422	1440	3 x 130B1261	3 x 130B1228		
1000	1675	1720	2 x 130B1260 + 2 x 130B1261	2 x 130B1217 + 2 x 130B1228		

1) The power rating in the selection table is the actual operating power and not necessarily the type code power rating. Changing operating conditions between HO and NO changes the actual operating conditions and the filter selection must reflect actual operating conditions.

2) The fan control system allows extended input voltage range as 200–415 V. The AHFs for 380–415 V/50 Hz mains operation can be operated with 200–240 V mains supply.

3) Filters are used as paralleling for 355 kW drive.

## 12.2.10.2 Code Numbers for Harmonic Filters, 380–415 V, 60 Hz

Table 159: Code Numbers for Harmonic Filters, 380–415 V, 60 Hz

Drive values		AHF values				
Power rating [kW] <sup>(1)</sup>	Input current 380–440 V [A]	Current rating [A]	Code numbers <sup>(2)</sup>		Enclosure type	
			AHF 005 IP20	AHF 010 IP20	AHF 005 IP20	AHF 010 IP20
0.37	1.2	10	130B2857	130B2262	X1-V3 IP20 if	X1-V3 IP20 if
0.55	1.6					
0.75	2.2					
1.1	2.7					
1.5	3.7					
2.2	5.0					
3.0	6.5					
4.0	9.0	14	130B2858	130B2265	X1-V3 IP20 ef	X1-V3 IP20 ef
5.5	11.7					
7.5	14.4	22	130B2859	130B2268	X2-V3 IP20 ef	X2-V3 IP20 if
11	22					
15	29	29	130B2860	130B2294	X2-V3 IP20 ef	X2-V3 IP20 if
18.5	34					
22	40	34	130B2861	130B2297	X3-V3 IP20 if	X3-V3 IP20 if
30	55					
37	66	40	130B2862	130B2303	X3-V3 IP20 if	X3-V3 IP20 if
45	82					
55	96	55	130B2863	130B2445	X3-V3 IP20 if	X3-V3 IP20 if
75	133					
90	171	66	130B2864	130B2459	X4-V3 IP20 if	X4-V3 IP20 if
110	204					
132	251	82	130B2865	130B2488	X4-V3 IP20 ef	X4-V3 IP20 ef
160	304					
–	–	96	130B2866	130B2489	X5-V3 IP20 ef	X5-V3 IP20 ef
200	381					
250	463	133	130B2867	130B2498	X5-V3 IP20 ef	X5-V3 IP20 ef
–	–					
–	–	171	130B2868	130B2499	X6-V3 IP20 ef	X6-V3 IP20 if
–	–					
–	–	204	130B2869	130B2500	X6-V3 IP20 ef	X6-V3 IP20 if
–	–					
–	–	251	130B2870	130B2700	X7-V3 IP20 if	X7-V3 IP20 if
–	–					
–	–	304	130B2871	130B2819	X8-V3 IP20 if	X7-V3 IP20 if
–	–					
–	–	325	130B3156 <sup>(3)</sup>	130B3154 <sup>(3)</sup>	X8-V3 IP20 ef	X7-V3 IP20 ef
–	–					
–	–	381	130B2872	130B2855	X8-V3 IP20 ef	X7-V3 IP20 ef
–	–					
–	–	480	130B2873	130B2856	X8-V3 IP20 ef	X8-V3 IP20 ef
–	–					

Table 159: Code Numbers for Harmonic Filters, 380–415 V, 60 Hz - (continued)

Drive values		AHF values			
315	590	608	2 x 130B2871	2 x 130B2819	See individual filters
355	647	650	2 x 130B3156	2 x 130B3154	
400	684	685	130B2871 + 130B2872	130B2819 + 130B2855	
450	779	762	2 x 130B2872	2 x 130B2855	
500	857	861	130B2872 + 130B2873	130B2855 + 130B2856	
560	964	960	2 x 130B2873	2 x 130B2856	
630	1090	1140	3 x 130B2872	3 x 130B2855	
710	1227	1240	2 x 130B2872 + 130B2873	2 x 130B2855 + 130B2856	
800	1422	1440	3 x 130B2873	3 x 130B2856	
1000	1675	1720	2 x 130B2872 + 2 x 130B2873	2 x 130B2855 + 2 x 130B2856	

1) The power ratings in the selection table are the actual operating power and not necessarily the type code power rating. Changing operating conditions between HO and NO changes the actual operating conditions and the filter selection must reflect actual operating conditions.

2) The fan control system allows extended input voltage range as 200–415 V. The AHFs for 380–415 V/60 Hz mains operation can be operated with 200–240 V mains supply.

3) Filters are used as paralleling for 355 kW drive.

### 12.2.10.3 Code Numbers for Harmonic Filters, 440–480 V, 60 Hz

Table 160: Code Numbers for Harmonic Filters, 440–480 V, 60 Hz

Drive values			AHF values					
Power rating		Input current 441–500 V [A]	Current rating [A]		Code numbers		Enclosure type	
[kW] <sup>(1)</sup>	[Hp] <sup>(2)</sup>		AHF 005	AHF 010	AHF 005 IP20	AHF 010 IP20	AHF 005 IP20	AHF 010 IP20
0.37	0.50	1.0	10	10	130B1752	130B1482	X1-V3 IP20 if	X1-V3 IP20 if
0.55	0.75	1.4						
0.75	1.0	1.9						
1.1	1.5	2.7						
1.5	2.0	3.1						
2.2	3.0	4.3						
3.0	4.0	5.7						
4.0	5.5	7.4	14	14	130B1753	130B1483	X1-V3 IP20 ef	X1-V3 IP20 ef
5.5	7.5	9.9						
7.5	10	13						

Table 160: Code Numbers for Harmonic Filters, 440–480 V, 60 Hz - (continued)

Drive values			AHF values					
11	15	19	19	19	130B1754	130B1484	X2-V3 IP20 ef	X2-V3 IP20 if
15	20	25	25	25	130B1755	130B1485	X2-V3 IP20 ef	X2-V3 IP20 if
18.5	25	31	31	31	130B1756	130B1486	X3-V3 IP20 if	X3-V3 IP20 if
22	30	36	36	36	130B1757	130B1487	X3-V3 IP20 if	X3-V3 IP20 if
30	40	47	48	48	130B1758	130B1488	X3-V3 IP20 if	X3-V3 IP20 if
37	50	59	60	60	130B1759	130B1491	X4-V3 IP20 if	X4-V3 IP20 if
45	60	73	73	73	130B1760	130B1492	X4-V3 IP20 ef	X4-V3 IP20 ef
55	75	95	95	95	130B1761	130B1493	X5-V3 IP20 ef	X5-V3 IP20 ef
75	100	118	118	118	130B1762	130B1494	X5-V3 IP20 ef	X5-V3 IP20 ef
90	125	154	154	154	130B1763	130B1495	X6-V3 IP20 ef	X6-V3 IP20 if
110	150	183	183	183	130B1764	130B1496	X6-V3 IP20 ef	X6-V3 IP20 if
132	200	231	231	231	130B1765	130B1497	X7-V3 IP20 if	X7-V3 IP20 if
160	250	291	291	291	130B1766	130B1498	X8-V3 IP20 if	X7-V3 IP20 if
200	300	348	355	355	130B1768	130B1499	X8-V3 IP20 ef	X7-V3 IP20 ef
–	–	–	380	380	130B3167 <sup>(3)</sup>	130B3165 <sup>(3)</sup>	X8-V3 IP20 ef	X7-V3 IP20 ef
250	350	427	436	436	130B1769	130B1751	X8-V3 IP20 ef	X8-V3 IP20 ef

Table 160: Code Numbers for Harmonic Filters, 440–480 V, 60 Hz - (continued)

Drive values			AHF values				See individual filters
315	450	531	522	522	130B1765 + 130B1766	130B1497 + 130B1498	
355	500	580	582	582	2 x 130B1766	2 x 130B1498	
400	550	667	671	671	130B1766 + 130B3167	130B1498 + 130B3165	
450	600	771	710	710	2 x 130B1768	2 x 130B1499	
500	650	759	760	760	2 x 130B3167	2 x 130B3165	
560	750	867	872	872	2 x 130B1769	2 x 130B1751	
630	900	1022	1065	1065	3 x 130B1768	3 x 130B1499	
710	1000	1129	1140	1140	3 x 130B3167	3 x 130B3165	
800	1200	1344	1308	1308	3 x 130B1769	3 x 130B1751	
1000	1350	1490	1582	1582	2 x 130B1768 + 2 x 130B1769	2 x 130B1499 + 2 x 130B1751	

1) The power ratings in the selection table are the actual operating power and not necessarily the type code power rating. Changing operating conditions between HO and NO changes the actual operating conditions and the filter selection must reflect actual operating conditions.

2) Typical hp shaft output at 460 V.

3) Filters are used as paralleling for 500 kW and 710 kW.

#### 12.2.10.4 Code Numbers for Harmonic Filters, 600 V, 60 Hz

Table 161: Code Numbers for Harmonic Filters, 600 V, 60 Hz

Drive values			AHF values							
Power rating			Input current [A]		Current rating at 600 V		Code numbers		Enclosure type	
[kW] <sup>(1)</sup>	T6 [hp]	T7 [hp]	T6 551– 600 V	T7 551– 600 V	AHF 005 [A]	AHF 010 [A]	AHF 005 IP20	AHF 010 IP20	AHF 005 IP20	AHF 010 IP20
11	15	10	16	15	15	15	130B5246	130B5212	X3-V3 IP20 if	X3-V3 IP20 if
15	20	15	20	19.5	20	20	130B5247	130B5213	X3-V3 IP20 if	X3-V3 IP20 if
18.5	25	20	24	24	24	24	130B5248	130B5214	X3-V3 IP20 ef	X3-V3 IP20 ef

Table 161: Code Numbers for Harmonic Filters, 600 V, 60 Hz - (continued)

Drive values					AHF values					
22	30	25	31	29	29	29	130B5249	130B5215	X4-V3 IP20 ef	X4-V3 IP20 ef
30	40	30	37	36	36	36	130B5250	130B5216	X4-V3 IP20 ef	X4-V3 IP20 ef
37	50	40	47	49	50	50	130B5251	130B5217	X5-V3 IP20 ef	X5-V3 IP20 ef
45	60	50	56	59	58	58	130B5252	130B5218	X5-V3 IP20 ef	X5-V3 IP20 ef
55	75	60	75	74	77	77	130B5253	130B5219	X6-V3 IP20 ef	X6-V3 IP20 ef
75	100	75	91	85	87	87	130B5254	130B5220	X6-V3 IP20 ef	X6-V3 IP20 ef
90	125	100	119	106	109	109	130B5255	130B5221	X6-V3 IP20 ef	X6-V3 IP20 ef
110	–	125	–	124	128	128	130B5256	130B5222	X6-V3 IP20 ef	X6-V3 IP20 ef
132	–	150	–	151	155	155	130B5257	130B5223	X7-V3 IP20 ef	X7-V3 IP20 ef
160	–	200	–	189	197	197	130B5258	130B5224	X7-V3 IP20 ef	X7-V3 IP20 ef
200	–	250	–	234	240	240	130B5259	130B5225	X8-V3 IP20 ef	X7-V3 IP20 ef
250	–	300	–	286	296	296	130B5260	130B5226	X8-V3 IP20 ef	X8-V3 IP20 ef
315	–	350	–	339	394	366	2 x 130B5258	130B5227		X8-V3 IP20 ef
355	–	400	–	366	394	366	2 x 130B5258	130B5227		X8-V3 IP20 ef
400	–	400	–	395	394	395	2 x 130B5258	130B5228		X8-V3 IP20 ef

Table 161: Code Numbers for Harmonic Filters, 600 V, 60 Hz - (continued)

Drive values					AHF values				
500	–	500	–	482	480	480	2 x 130B5259	2 x 130B5225	See individual filters
560	–	550	–	549	592	592	2 x 130B5260	2 x 130B5226	
630	–	650	–	613	720	732	3 x 130B5259	2 x 130B5227	
710	–	750	–	711	720	732	3 x 130B5259	2 x 130B5227	
800	–	950	–	828	888	888	3 x 130B5260	3 x 139B5226	
900	–	1050	–	920	960	960	4 x 130B5259	3 x 130B5227	
1000	–	1150	–	1032	1184	1098	4 x 130B5260	3 x 130B5227	

1) The power ratings in the selection table are the actual operating power and not necessarily the type code power rating. Changing operating conditions between HO and NO changes the actual operating conditions and the filter selection must reflect actual operating conditions.

2) Typical hp shaft output at 575 V.

### 12.2.10.5 Code Numbers for Harmonic Filters, 500–690 V, 50 Hz

Table 162: Code Numbers for Harmonic Filters, 500–690 V, 50 Hz

Drive values				AHF values					
Power rating [kW]	Input current [A]			Current rating at 690 V		Code numbers		Enclosure type	
	T6 525– 550 V	T7 525– 550 V	T7 690 V	AHF 005 [A]	AHF 010 [A]	AHF 005 IP20	AHF 010 IP20	AHF 005 IP20	AHF 010 IP20
11	17.2	15.0	14.5	15	15	130B5088	130B5280	X3-V3 IP20 if	X3-V3 IP20 if
15	20.9	19.5	19.5	20	20	130B5089	130B5281	X3-V3 IP20 if	X3-V3 IP20 if
18.5	25.4	24	24	24	24	130B5090	130B5282	X3-V3 IP20 ef	X3-V3 IP20 ef
22	32.7	29	29	29	29	130B5092	130B5283	X4-V3 IP20 ef	X4-V3 IP20 ef
30	39	36	36	36	36	130B5125	130B5284	X4-V3 IP20 ef	X4-V3 IP20 ef
37	49	49	48	50	50	130B5144	130B5285	X5-V3 IP20 ef	X5-V3 IP20 ef
45	59	59	58	58	58	130B5168	130B5286	X5-V3 IP20 ef	X5-V3 IP20 ef
55	78.9	77	77	77	77	130B5169	130B5287	X6-V3 IP20 ef	X6-V3 IP20 ef
75	95.3	89	87	87	87	130B5170	130B5288	X6-V3 IP20 ef	X6-V3 IP20 ef
90	124.3	110	109	109	109	130B5172	130B5289	X6-V3 IP20 ef	X6-V3 IP20 ef
110	–	130	128	128	128	130B5195	130B5290	X6-V3 IP20 ef	X6-V3 IP20 ef

Table 162: Code Numbers for Harmonic Filters, 500–690 V, 50 Hz - (continued)

Drive values				AHF values					
132	–	158	155	155	155	130B5196	130B5291	X7-V3 IP20 ef	X7-V3 IP20 ef
160	–	198	197	197	197	130B5197	130B5292	X7-V3 IP20 ef	X7-V3 IP20 ef
200	–	245	240	240	240	130B5198	130B5293	X8-V3 IP20 ef	X7-V3 IP20 ef
250	–	299	296	296	296	130B5199	130B5294	X8-V3 IP20 ef	X8-V3 IP20 ef
315	–	355	352	394	366	2 x 130B5197	130B5295		X8-V3 IP20 ef
355	–	381	366	394	395	2 x 130B5197	130B5296		X8-V3 IP20 ef
400	–	413	400	437	437	130B5197 + 130B5198	130B5292 + 130B5293	See individual filters	
500	–	504	482	536	536	130B5198 + 130B5199	130B5293 + 130B5294		
560	–	574	549	592	592	2 x 130B5199	2 x 130B5294		
630	–	642	613	662	662	130B5199 + 2 x 130B5197	130B5294 + 130B5295		
710	–	743	711	788	732	4 x 130B5197	2 x 130B5295		
800	–	866	828	888	888	3 x 130B5199	3 x 130B5294		
900	–	962	920	986	958	2 x 130B5199 + 2 x 130B5197	2 x 130B5294 + 130B5295		

1) The power ratings in the selection table are the actual operating power and not necessarily the type code power rating. Changing operating conditions between HO and NO changes the actual operating conditions and the filter selection must reflect actual operating conditions.

### 12.2.11 Code Numbers for VLT® Sine-wave Filters MCC 101

Table 163: Code Numbers for Sine-wave Filters for 200–500 V Drives

Drive power and current ratings						Filter current rating			Switching frequency	Code numbers	
200–240 V		380–400 V		441–500 V		50 Hz	60 Hz	100 Hz		IP00	IP20/23 <sup>(1)</sup>
[kW]	[A]	[kW]	[A]	[kW]	[A]	[A]	[A]	[A]	[kHz]		

Table 163: Code Numbers for Sine-wave Filters for 200–500 V Drives - (continued)

Drive power and current ratings						Filter current rating			Switching frequency	Code numbers	
–	–	0.37	1.3	0.37	1.1	2.5	2.5	2.0	5.0	130B2404	130B2439
0.25	1.8	0.55	1.8	0.55	1.6						
0.37	2.4	0.75	2.4	0.75	2.1						
–	–	1.1	3.0	1.1	3.0	4.5	4.0	3.5	5.0	130B2406	130B2441
0.55	3.5	1.5	4.1	1.5	3.4						
0.75	4.6	2.2	5.6	2.2	4.8	8.0	7.5	5.5	5.0	130B2408	130B2443
1.1	6.6	3.0	7.2	3.0	6.3						
1.5	7.5	–	–	–	–						
–	–	4.0	10	4.0	8.2	10	9.5	7.5	5.0	130B2409	130B2444
2.2	10.6	5.5	13	5.5	11						
3.0	12.5	7.5	16	7.5	14.5	17	16	13	5.0	130B2411	130B2446
3.7	16.7	–	–	–	–						
5.5	24.2	11	24	11	21	24	23	18	4.0	130B2412	130B2447
7.5	30.8	15	32	15	27	38	36	28.5	4.0	130B2413	130B2448
		18.5	37.5	18.5	34						
11	46.2	22	44	22	40	48	45.5	36	4.0	130B2281	130B2307
15	59.4	30	61	30	52	62	59	46.5	3.0	130B2282	130B2308
18.5	74.8	37	73	37	65	75	71	56	3.0	130B2283	130B2309
22	88	45	90	55	80	115	109	86	3.0	130B3179	130B3181*
30	115	55	106	75	105						
37	143	75	147	90	130	180	170	135	3.0	130B3182	130B3183*
45	170	90	177								

1) Code numbers marked with \* are IP23.

Table 164: Ordering Numbers for Sine-wave Filters for 525–690 V Drives

Drive Power and Current Ratings						Filter current rating			Switching frequency	Code numbers	
525–600 V		690 V		525–550 V		50 Hz	60 Hz	100 Hz		IP00	IP20/23 <sup>(1)</sup>
[kW]	[A]	[kW]	[A]	[kW]	[A]	[A]	[A]	[A]	[kHz]		
0.75	1.7	1.1	1.6	–	–	4.5	4.0	3.0	4.0	130B7335	130B7356
1.1	2.4	1.5	2.2								
1.5	2.7	2.2	3.2								
2.2	3.9	3.0	4.5								

Table 164: Ordering Numbers for Sine-wave Filters for 525–690 V Drives - (continued)

Drive Power and Current Ratings						Filter current rating			Switching frequency	Code numbers	
3.0	4.9	4.0	5.5	–	–	10	9.0	7.0	4.0	130B7289	130B7324
4.0	6.1	5.5	7.5								
5.5	9.0	7.5	10								
7.5	11	11	13	7.5	14	13	12	9.0	3.0	130B3195	130B3196
11	18	15	18	11	19	28	26	21	3.0	130B4112	130B4113
15	22	18.5	22	15	23						
18.5	27	22	27	18	28						
22	34	30	34	22	36	45	42	33	3.0	130B4114	130B34115
30	41	37	41	30	48						
37	52	45	52	37	54	76	72	57	3.0	130B4116	130B4117*
45	62	55	62	45	65						
55	83	75	83	55	87	115	109	86	3.0	130B4118	130B4119*
75	100	90	100	75	105						
90	131	–	–	90	137	165	156	124	2.0	130B4121	130B4124*

1) Code numbers marked with \* are IP23.

## 12.2.12 Code Numbers for VLT® dU/dt Filters MCC 102

Table 165: Code Numbers for dU/dt Filters for 200–500 V Drives

Drive ratings [V]						Filter current rating [V]		Code number		
200–240		380–440		441–500		380@ 60 Hz, 200– 400/440@ 50 Hz	460/480@ 60 Hz, 500/525@ 50 Hz	IP00	IP20	IP54
[kW]	[A]	[kW]	[A]	[kW]	[A]	[A]	[A]			
3.0	12.5	5.5	13	5.5	11	17	15	N/A	130B7367 <sup>(1)</sup>	N/A
3.7	16	7.5	16	7.5	14.5					
–	–	–	–	–	–					
5.5	24.2	11	24	11	21	44	40	130B2835	130B2836	130B2837
7.5	30.8	15	32	15	27					
–	–	18.5	37.5	18.5	34					
–	–	22	44	22	40					

Table 165: Code Numbers for dU/dt Filters for 200–500 V Drives - (continued)

Drive ratings [V]						Filter current rating [V]		Code number		
11	46.2	30	61	30	52	90	80	130B2838	130B2839	130B2840
15	59.4	37	73	37	65					
18.5	74.8	45	90	55	80					
22	88	–	–	–	–					
–	–	55	106	75	105	106	105	130B2841	130B2842	130B2843
–	–	55	106	75	105					
30	115	75	147	90	130	177	160	130B2844	130B2845	130B2846
37	143	90	177	–	–					
45	170	–	–	–	–					

1) Dedicated A3 enclosures supporting footprint mounting and book style mounting. Fixed shielded cable connection to the drive.

Table 166: Code Numbers for dU/dt Filters for 525–690 V Drives

Drive ratings [V]				Filter current rating [V]			Code number		
525–550		551–690		460/480 @ 60 Hz, 500/525 @ 50 Hz	575/600@ 60 Hz	690@ 50 Hz	IP00	IP20	IP54
[kW]	[A]	[kW]	[A]	[A]	[A]	[A]			
5.5	9.5	1.1	1.6	15	13	10	N/A	130B7367 <sup>(1)</sup>	N/A
7.5	11.5	1.5	2.2						
–	–	2.2	3.2						
		3.0	4.5						
		4.0	5.5						
		5.5	7.5						
7.5	10								
7.5	14	11	13	40	32	27	130B2835	130B2836	130B2837
11	19	15	18						
15	23	18.5	22						
18.5	28	22	27						
30	43	30	34	80	58	54	130B2838	130B2839	130B2840
37	54	37	41						
45	65	45	52						
–	–	–	–						

Table 166: Code Numbers for dU/dt Filters for 525–690 V Drives - (continued)

Drive ratings [V]				Filter current rating [V]			Code number		
55	87	55	62	105	94	86	130B2841	130B2842	130B2843
55	87	75	83						
75	113	90	108	160	131	108	130B2844	130B2845	130B2846
90	137	–	–						
–	–	–	–						

1) Dedicated A3 enclosures supporting footprint mounting and book style mounting. Fixed shielded cable connection to the drive.

### 12.2.13 Spare Parts

Visit the VLT® Shop or the configurator for ordering spare parts available for a specific application on <http://VLTshop.danfoss.com>.

## 13 Appendix

### 13.1 Symbols and Abbreviations

---

60° AVM	Pulse width modulation
°C	Degrees Celsius
°F	Degrees Fahrenheit
AC	Alternating current
AEO	Automatic energy optimization
AWG	American wire gauge
AMA	Automatic motor adaptation
BDM	Basic Drive Module
CBM	Condition-based monitoring
CDM	Complete Drive Module
DC	Direct current
EMC	Electromagnetic compatibility
ETR	Electronic thermal relay
$f_{M,N}$	Nominal motor frequency
$I_{INV}$	Rated inverter output current
$I_{LIM}$	Current limit
$I_{M,N}$	Nominal motor current
$I_{VLT,MAX}$	Maximum output current
$I_{VLT,N}$	Rated output current supplied by the drive
IMC	Integrated motion controller
IP	Ingress protection
LCP	Local control panel
MCT	Motion control tool
$n_s$	Synchronous motor speed
$P_{M,N}$	Nominal motor power
PDS	Power drive system
PELV	Protective extra low voltage
PCB	Printed circuit board
PM motor	Permanent magnet motor
PWM	Pulse width modulation

---

RPM	Revolutions per minute
Regen	Regenerative terminals
SFAVM	Stator frequency asynchronous vector modulation
T <sub>LIM</sub>	Torque limit
TAS	Temperature-adaptive switching frequency function
U <sub>M,N</sub>	Nominal motor voltage

---



**Danfoss A/S**  
Ulsnaes 1  
DK-6300 Graasten

.....  
Any information, including, but not limited to information on selection of product, its application or use, product design, weight, dimensions, capacity or any other technical data in product manuals, catalog descriptions, advertisements, etc. and whether made available in writing, orally, electronically, online or via download, shall be considered informative, and is only binding if and to the extent, explicit reference is made in a quotation or order confirmation. Danfoss cannot accept any responsibility for possible errors in catalogs, brochures, videos and other material. Danfoss reserves the right to alter its products without notice. This also applies to products ordered but not delivered provided that such alterations can be made without changes to form, fit or function of the product. All trademarks in this material are property of Danfoss A/S or Danfoss group companies. Danfoss and the Danfoss logo are trademarks of Danfoss A/S. All rights reserved.  
.....

M00193

